



Leader in
Level Measurement

Installation and Operating Instructions

SIL IntelliPoint RF™ SXRXL Series Line Powered Point Level Safety Switch



Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.sales@ametek.com
Website: www.drexelbrook.com

AMETEK Drexelbrook makes no warranty of any kind with regard to the material contained in this manual, including, but not limited to, implied warranties or fitness for a particular purpose. Drexelbrook shall not be liable for errors contained herein or for incidental or consequential damages in connection with the performance or use of material.

© AMETEK Drexelbrook

SXRXLXX1-LM
Issue# 04

SIL IntelliPoint RF™ SXRXL Series Line Powered Point Level Safety Switch



AMETEK®
DREXELBROOK
An ISO 9001 Certified Company

205 Keith Valley Road, Horsham, PA 19044
Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.info@ametek.com
Website: www.drexelbrook.com

Contents

Contents

Section 1: Introduction	
1.1	System Description 1
1.2	Technology 1
1.3	Model Number 2
1.4	SIL Sensing Element List 3
1.5	Dual Compartment Housing Detail 4
Section 2: Installation	
2.1	Unpacking 5
2.2	Mounting and Installation Guidelines 5
2.3	Input Wiring 8
2.4	Spark Protection 8
2.5	Output Wiring - Relay Version 8
2.6	Circuit Board 9
2.7	Output & Status LEDs 13
2.8	Sensing Element Connection 13
2.9	Calibration 16
Section 3: Spare Parts List	20
Section 4: Troubleshooting	
4.1	RF Point Level Troubleshooting Guide 22
4.2	Testing Electronic Unit 23
4.3	Over Range 24
4.4	Under Range 24
4.5	Testing the Relay Circuits 24
4.6	Testing The Sensing Element 25
4.7	Testing the Integral Cable 28
4.8	Testing the Remote Cable 28
4.9	Testing the Power Supply 29
4.10	Factory Assistance 30
4.11	Field Service 30
4.12	Customer Training 30
4.13	Equipment Return 31
Section 5: Specifications	
5.1	Approvals 34
Section 6: Control Drawings	
6.1	FM / FMc Control Drawings 36
6.2	ATEX Control Drawings 50
6.3	CE Mark Declaration of Conformity 59
6.4	IECEX Control Drawings 60
6.5	Mounting and Wiring for Spark Protector Drawings 69
6.6	Adding a Padded Capacitor 72
6.7	Dual Seal Assembly for 700 Series Sensing Elements 75
Appendix A:	
Shortening or Lengthening the Sensing Element	A-1
CE Installation Supplement	A-2
CE Installation Supplement (Continued)	A-3
Appendix B: SIL Certification Information	
EXIDA Management Summary	B-1
EXIDA Report Results	B-2

Section 1

Section 1: Introduction

1.1 System Description

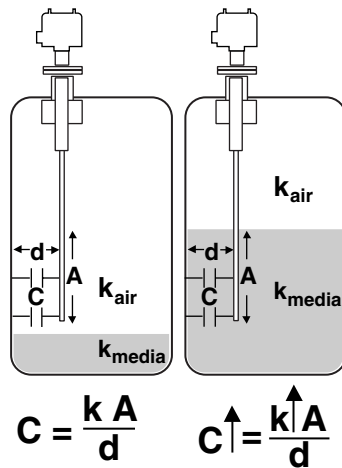


Figure 1-1

Simple Capacitance Probe
(Insulating Media Shown)

1.2 Technology

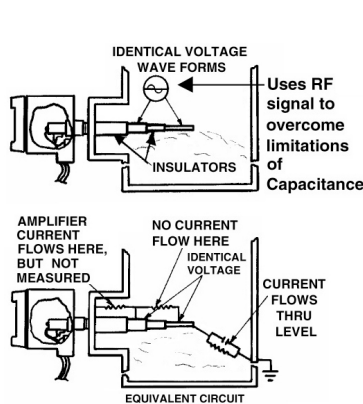


Figure 1-2

RF Admittance Probe
with Cote-Shield

Installation is simple and easy on the AMETEK Drexelbrook **IntelliPoint™** Series products. Simply apply power and the IntelliPoint system is ready to detect the presence or absence of material. Since the IntelliPoint instrument does not require calibration or setpoint adjustments, it is capable of operating in non-dedicated tanks regardless of the material being measured.

Notice: Material to be Measured Must Be Below Sensor when Power is Applied.

The **AutoVerify™** self-testing function continuously monitors the entire system to ensure proper operation. **Manual Certify™** changes the outputs in order to test the loop current and ensure proper operation of the control systems.

In a simple capacitance probe-type sensing element, when the level rises and material covers the probe, the capacitance within the circuit between the probe and the media (conductive applications) or the probe and the vessel wall (insulating applications) increases. This is due to the dielectric constant (k) of the material, which causes a bridge mis-balance. The signal is demodulated (rectified), amplified, and the output is increased. There are drawbacks, however, especially when there is coating of the probe.

An RF Admittance level transmitter is the next generation. Although similar to the capacitance concept, The IntelliPoint employs a radio frequency signal and adds the Cote-Shield™ circuitry within the Electronics Unit.



This patented Cote-Shield™ circuitry is designed into the IntelliPoint series and enables the instrument to ignore the effect of buildup or material coating on the sensing element. The sensing element is mounted in the vessel and provides a change in RF admittance indicating presence or absence of material.

The Cote-Shield element of the sensor prevents the transmission of RF current through the coating on the sensing element. The only path to ground available for the RF current is through the material being measured.

The result is an accurate measurement regardless of the amount of coating on the probe, making it by far the most versatile technology, good for very wide range conditions from cryogenics to high temperature, from vacuum to 10,000psi pressure, and works with all types of materials.

1.3 Model Number

Safety IntelliPoint RF™

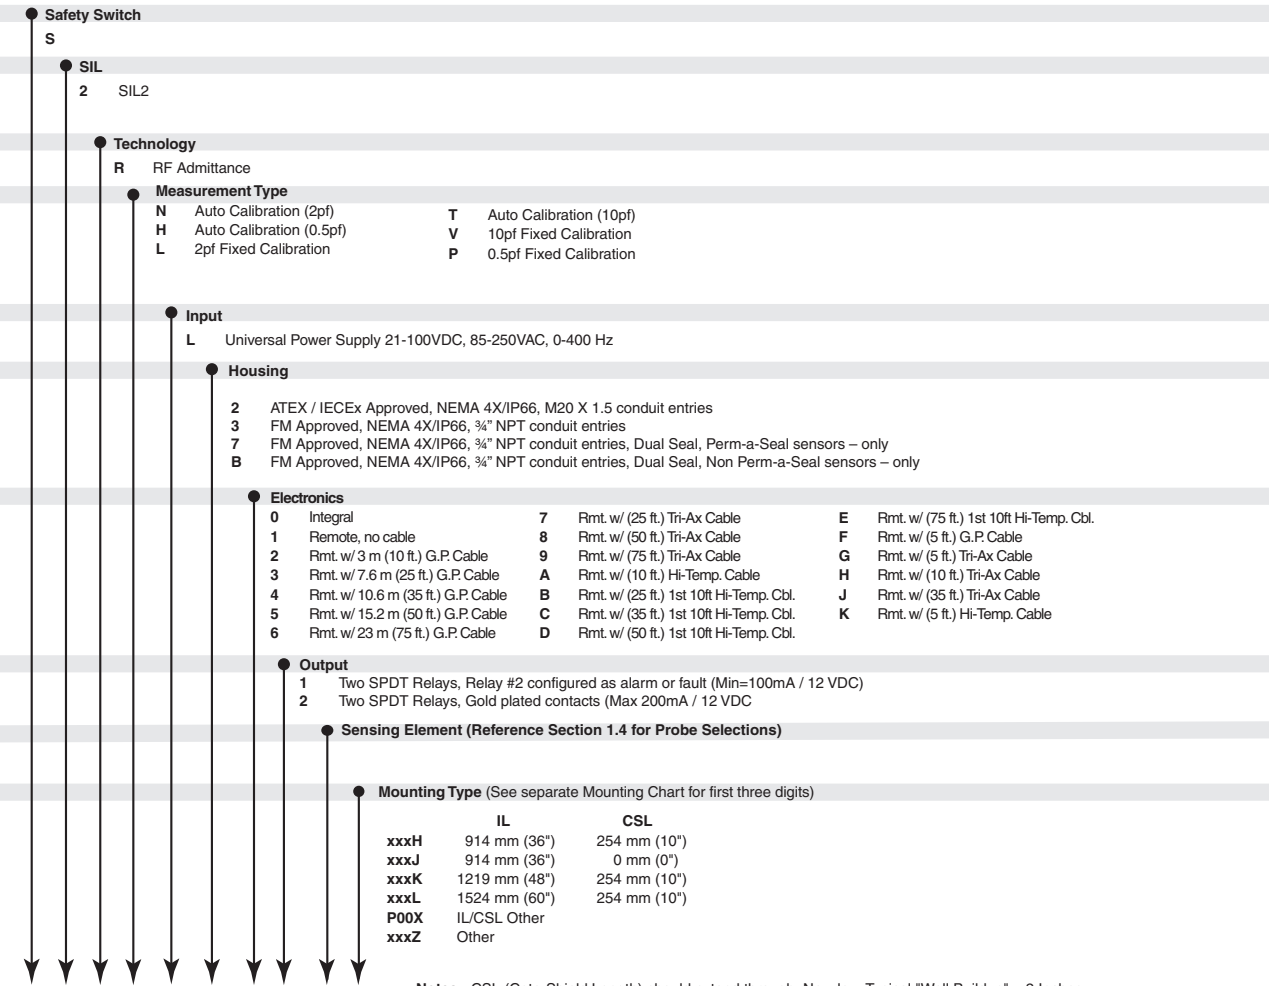

Notes: CSL (Cote-Shield Length) should extend through Nozzle + Typical "Wall Buildup" + 2 Inches

(1) Available with remote electronics only
 (2) Use A1P mounting option
 (3) Choose only sanitary mounting options
 (4) Available with 0-inch CSL only
 (5) Use P00X mounting option

(6) Use A1B mounting option
 (7) Use A8B mounting option (1/4-inch NPT)
 (8) Choose from flange mounting only
 (9) FM approved with remote electronics only

Not all mounting options are available with all sensing elements

NPT Threads		
A1B	3/4"NPT	316SS
A1C	3/4"NPT	Hastelloy C
A1P	3/4"NPT	PFA
A2B	1"NPT	316SS
A2C	1"NPT	Hastelloy C

Sanitary TriClamps					
C2B	1"TriClamp	316SS	C5B	2-1/2"TriClamp	316SS
C3B	1 1/2"TriClamp	316SS	C6B	3"TriClamp	316SS
C4B	2"TriClamp	316SS	C7B	3"TriClamp	316SS

DIN Flanges			
E01	25 mm	16 bar	RF 316/316L SS
EP1	25 mm	40 bar	RF 316/316L SS
EQ1	50 mm	16 bar	RF 316/316L SS
ER1	50 mm	40 bar	RF 316/316L SS
ES1	80 mm	16 bar	RF 316/316L SS
ET1	80 mm	40 bar	RF 316/316L SS
EU1	100 mm	16 bar	RF 316/316L SS
EV1	100 mm	40 bar	RF 316/316L SS
EW1	150 mm	16 bar	RF 316/316L SS
EX1	150 mm	40 bar	RF 316/316L SS
E02	25 mm	16 bar	RF CS
EP2	25 mm	40 bar	RF CS
EQ2	50 mm	16 bar	RF CS
ER2	50 mm	40 bar	RF CS
ES2	80 mm	16 bar	RF CS
ET2	80 mm	40 bar	RF CS
EU2	100 mm	16 bar	RF CS
EV2	100 mm	40 bar	RF CS
EW2	150 mm	16 bar	RF CS
EX2	150 mm	40 bar	RF CS

ANSI Flanges			
DA1	1"	150#	RF 316/316L SS
DB1	1 1/2"	150#	RF 316/316L SS
DC1	2"	150#	RF 316/316L SS
DD1	2 1/2"	150#	RF 316/316L SS
DE1	1"	300#	RF 316/316L SS
DF1	1 1/2"	300#	RF 316/316L SS
DG1	2"	300#	RF 316/316L SS
DH1	2 1/2"	300#	RF 316/316L SS
DI1	3"	150#	RF 316/316L SS
DJ1	3"	300#	RF 316/316L SS
DK1	4"	150#	RF 316/316L SS
DL1	4"	300#	RF 316/316L SS
DM1	6"	150#	RF 316/316L SS
DN1	6"	300#	RF 316/316L SS
DA2	1"	150#	RF CS
DB2	1 1/2"	150#	RF CS
DC2	2"	150#	RF CS
DD2	2 1/2"	150#	RF CS
DE2	1"	300#	RF CS
DF2	1 1/2"	300#	RF CS
DG2	2"	300#	RF CS
DH2	2 1/2"	300#	RF CS
DI2	3"	150#	RF CS
DJ2	3"	300#	RF CS
DK2	4"	150#	RF CS
DL2	4"	300#	RF CS
DM2	6"	150#	RF CS
DN2	6"	300#	RF CS

1.4 SIL Sensing Element List

#	Application	Sensing Element Part Number	Pressure/Temperature	Wetted Parts	
00	General purpose	700-1202-001 Remote & 700-1202-021 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK	
02	General purpose, longer insertion lengths w/cable attachment and 316/316L SS bottom weight	700-1202-014 Remote & 700-1202-024 Integral	13.8 bar @ 177°C (200 PSI @ 350°F)	316/316L SS and PEEK	
03	Proximity	700-1202-018 Remote & 700-1202-028 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK with 76mm (3) 216SS proximity plate	
04	General purpose, high temperature and pressure	700-1202-041 Remote 700-1202-042 Integral	69 bar @ 121°C (1000 PSI @ 250°F) 20.7 bar @ 232°C (300 PSI @ 450°F)	316/316L SS and PEEK	
06	General purpose with FDA approved materials of construction	700-1202-031 Remote & 700-1202-032 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and FDA grade PEEK	
07	General purpose for granular materials	700-1202-010 Remote & 700-1202-020 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK with 7/8 inch dia. 316/316L SS collar	
09	General purpose for granular materials w/FDA approved materials of construction	700-1202-033 Remote & 700-1202-034 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and FDA grade PEEK with 7/8 inch dia. 316/316L SS collar	
10	Corrosive liquids	700-0001-018 Remote	3.4 bar @ 149°C (50 PSI @ 300°F)	PFA	
11	General purpose, higher pressure, TFE compatibility required	700-0201-005 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and TFE	
12	Corrosive material, higher pressure	700-0201-005 Integral or Remote (Hastelloy C)	69 bar @ 38°C (1000 PSI @ 100°F) 13.8 bar @ 232°C (200 PSI @ 450°F)	Hastelloy C and TFE	
13	Sanitary (Non- 3A Approved)	700-0201-019 Integral or Remote	13.8 bar @ 149°C (200 psi @ 300°F)	316/316L SS and TFE	
14	General purpose, low pressure	700-0202-002 Integral or Remote	3.4 bar @ 149°C (50 PSI @ 300°F) 1.4 bar @ 232°C (20 PSI @ 450°F)	316/316L SS and TFE	
15	Heavy Duty agitated tanks or material w/bulk density	700-0202-043 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and TFE	
16	High integrity seal for hazardous materials	700-0002-360 Integral or Remote	34.5 bar @ 149°C (500 PSI @ 300°F)	PFA	
17	Sanitary low pressure	700-0202-029 Integral or Remote	34.5 bar @ 149°C (50 PSI @ 300°F)	316/316L SS and TFE	
18	Corrosive material, higher pressure with water like viscosity	700-0001-022 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 34.5 bar @ 149°C (500 PSI @ 300°F)	TFE	
19	Interface Measurement	700-0002-023 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 34.5 bar @ 149°C (500 PSI @ 300°F)	316/316L SS and TFE	
20	Miniature Pilot Plant Sensor	700-0209-002 Remote	69 bar @ 121°C (1000 PSI @ 250°F) 0 bar @ 232°C (0 PSI @ 450°F)	316/316L SS and TFE	
21	Heavy Duty agitated tanks or material w/bulk density and corrosive	700-0202-043 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 13.8 bar @ 232°C (200 PSI @ 450°F)	Hastelloy C and TFE	
22	700-0202-043 with proximity plate	700-0202-044 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F) 13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and TFE	
24	Inactive cable probe with active weight - liquids only	700-0005-485 Integral & 700-0005-285 Remote	200 psi @ 200°F	316/316L SS and FEP	
25	Inactive cable probe with active weight - corrosive liquids	700-0005-485 Integral & 700-0005-285 Remote	200 psi @ 200°F	Hastelloy C and FEP	
26	Extra heavy duty rear mount	700-0220-001 Remote	20 psi @ 180°F	316/316L SS and FEP	
27	Extra heavy duty	700-0221-002 Remote	50 psi @ 300°F 20 psi @ 450°F	316/316L SS and FEP	
28	General purpose very high pressure	700-1202-051 Remote 700-1202-052 Integral	1500 PSI @ 250°F 500 psi @ 450°F	316/316L SS and PEEK	
High Pressure/Temperature	60	High Pressure and High Temperature	700-0204-038 Remote	137.9 bar @ 93°C (2000 PSI @ 200°F) 68.9 bar @ 260°C (1000 PSI @ 500°F)	316/316L SS and Ceramic
	61	High Temperature	700-0204-002 Remote	1 psi @ 700°F 0 bar @ 816°C (0 PSI @ 1500°F)	316/316L SS and Ceramic
	62	Very high pressure - not for steam	700-0204-048 Remote	4000 psi @ 600°F	316/316L SS, Vespel and Ceramic
	64	High pressure and high temperature	700-0204-024 Remote	1000 psi @ 750°F	316/316L SS, Monel 400 and Alumina Ceramic
66	700-0204-002 with secondary seal - vertical only in liquids	700-0204-022 Remote	1000 psi @ 100°F 200 psi @ 800°F	316/316L SS and Ceramic	
3A	700-3201 Series 3A Sanitary Probe	700-3201-001 Remote & 700-3201-002 Integral	13.8 bar @ 121°C (200 psi @ 250°F)	316/316L SS and PEEK	
Retractable	72	Retractable, insulated center rod	700-0201-027 Integral or Remote	150 psi @ 300°F	316/316L SS and TFE
	73	Retractable, bare center rod	700-0201-028 Integral or Remote	150 psi @ 300°F	316/316L SS and TFE
Specialty	85	Leak detection	700-9000-494 Remote	0 psi @ 185°F	316/316L SS and TFE
	87	SIL floating roof and hydrocarbon liquids - 1.5"	700-0005-595 Integral	0 psi @ 185°F	Brass Polyolefin and FEP - 1.5 inch diameter probe
Integrated Ground Reference	90	Perforated concentric shield	700-0201-059 Integral or Remote	300 psi @ 300°F	316/316L SS and TFE
	91	General purpose with perforated concentric shield	700-1202-015 Remote & 700-1202-016 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK
	92	General purpose higher pressure with perforated concentric shield	700-1202-045 Remote 700-1202-046 Integral	1000 PSI @ 250°F 300 psi @ 450°F	316/316L SS and PEEK
	93	General purpose very high pressure with perforated concentric shield	700-1202-055 Remote 700-1202-056 Integral	1500 PSI @ 250°F 500 psi @ 450°F	316/316L SS and PEEK
	94	Miniature Pilot Plant Sensor with concentric shield	700-0209-024 Remote	69 bar @ 121°C (1000 PSI @ 250°F) 0 bar @ 232°C (0 PSI @ 450°F)	316/316L SS and TFE

1.5 Dual Compartment Housing Detail


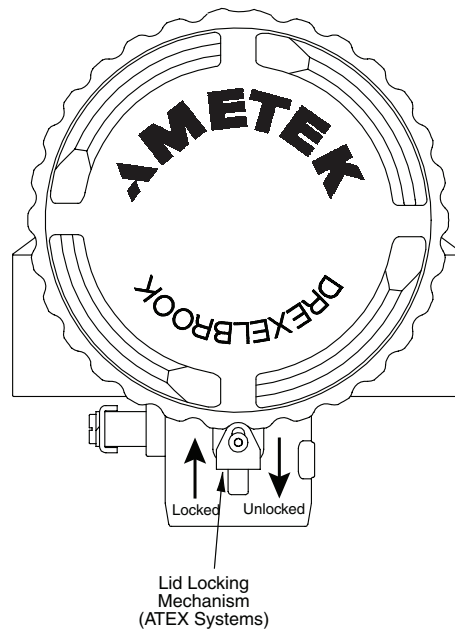


Figure 1-3
 Dual Compartment Housing Detail

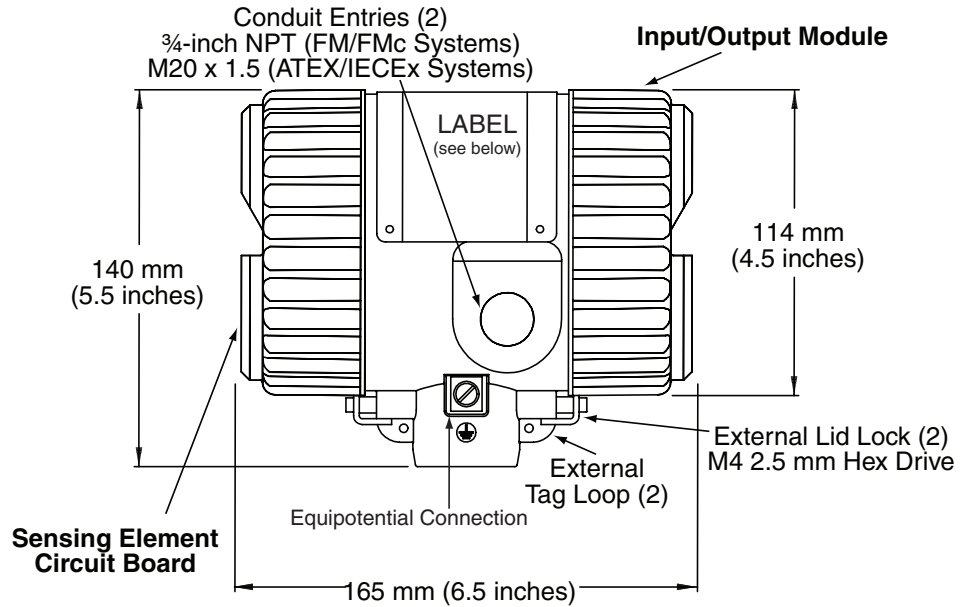

The Input/Output Module (IOM) is located on Customer Connection side; sensing element/circuit board are on opposite side.

Section 2: Installation

2.1 Unpacking

Carefully remove the contents of the shipping carton and check each item against the packing list before destroying any packing material. If there is any shortage or damage, report it to the factory immediately.

2.2 Mounting and Installation Guidelines



CAUTION:

The IntelliPoint RF instrument must be powered AFTER it is installed in the application and with material BELOW the sensing element.

The IntelliPoint RF instrument can be mounted vertically or horizontally at any angle. The mounting location should be as free as possible from vibration, corrosive atmospheres, and any possibility of mechanical damage. Ambient temperatures at electronics should be between limits as specified by control drawings in section 6.

The IntelliPoint RF instrument uses a dual compartment housing and a completely encapsulated input/output module to reduce the possibility that damage may occur from water migrating into the housing through the conduit. To further reduce the possibility of damage caused by water in the conduit, install a drip loop and breather drain to purge any accumulating moisture. *Refer to Figure 2-1.*

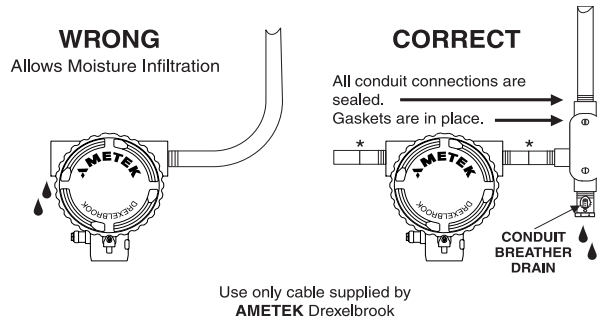


Figure 2-1
Recommended Conduit Connection

2.2 Mounting and Installation Guidelines (Continued)

After system is installed and level is **below** the sensing element, apply power. The RF Series instrument automatically calibrates and is ready to detect change in level. If properly installed, the Green LED lights when power is applied. The Red LED should not be flashing. If the Red LED is flashing, refer to **Section 4: Troubleshooting**.



Cable fittings supplied are weather-resistant. They are NOT certified as explosion-proof (XP) or flameproof (d) unless they are specifically marked.

The IntelliPoint RF instrument is rated Intrinsically Safe (I.S.) when power is provided from an I.S. supply.



WARNING:

IntelliPoint RF equipment is rated explosion-proof. When installing in explosion hazardous areas [rated “potentially hazardous” (EU) or “hazardous classified” (USA)] observe all national and local regulations as well as specifications in the certificate.

Mount sensing element using the following installation guidelines. **See Figure 2-2.**

When installing IntelliPoint RF instrument, ambient temperature at electronics must not exceed 70°C (158°F).

When installing flange-mounted sensing elements, keep mating surfaces and bolts free of paint and corrosion to ensure proper electrical contact with vessel. Avoid using excessive amounts of Teflon™ tape when installing threaded sensing elements.

Install systems with threaded NPT connection via wrench flats on the process connection **ONLY**.

Locate sensing element to avoid enhancing electrostatic discharge from process medium, as is good practice with any thermowell, displacer, or sampler. This includes correct bonding to the tank or silo wall.

If installation area is rated explosion-proof and requires conduit seal fittings, they should be used in accordance with company standards and local codes.

2.2 Mounting and Installation Guidelines (Continued)

Mounting sensing element inside a pipe is not recommended.

Do not mount a Cote-Shield sensing element through a nozzle that exceeds length of first insulator.

Ensure that there are no obstructions or agitator blades to interfere with sensing element.

Rigid sensing elements can be mounted either vertically or horizontally.




Do Not Shorten the sensing element without checking with the factory. 215-674-1234.




After the system has been installed, a proof test must be performed (See Section 4.2).

WRONG
Allows Moisture Infiltration

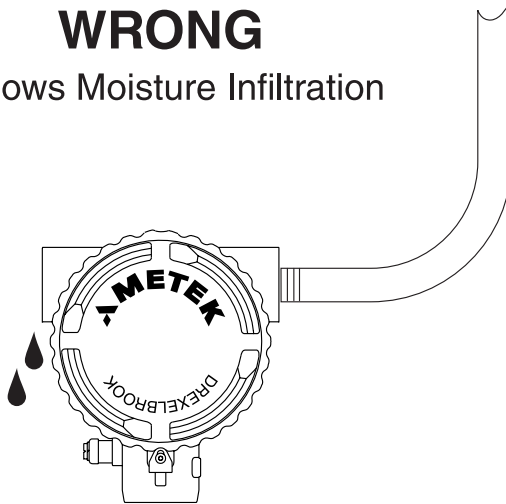

CORRECT

All conduit connections are sealed. →
Gaskets are in place. →

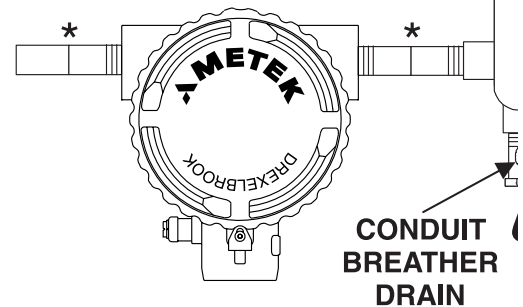

Use only cable supplied by
AMETEK Drexelbrook

WRONG
Allows Moisture Infiltration



CORRECT

* Fill Pipe Ends with

Figure 2-2
Installation Considerations

2.3 Input Wiring

WARNING:



If The IntelliPoint instrument is located in a hazardous environment, do not open the enclosure cover or make/break any electrical connections without first disconnecting electrical power at the source. Ensure that the wiring, electrical fittings and conduit connections conform to electrical codes for the specific location and hazard level.

The IntelliPoint RF instrument utilizes a universal power supply and can be operated from any source between 85-250 VAC or 21 to 100 VDC. The universal power supply automatically detects the input voltage regardless of polarity and does not require jumper changes. To access, remove the housing lid on the customer connections side to reveal the Input/Output Module (IOM). The IOM is an encapsulated assembly that contains the power supply, outputs and eight wiring terminals. IOM is held in place with three screws. *See Figure 2-3.*

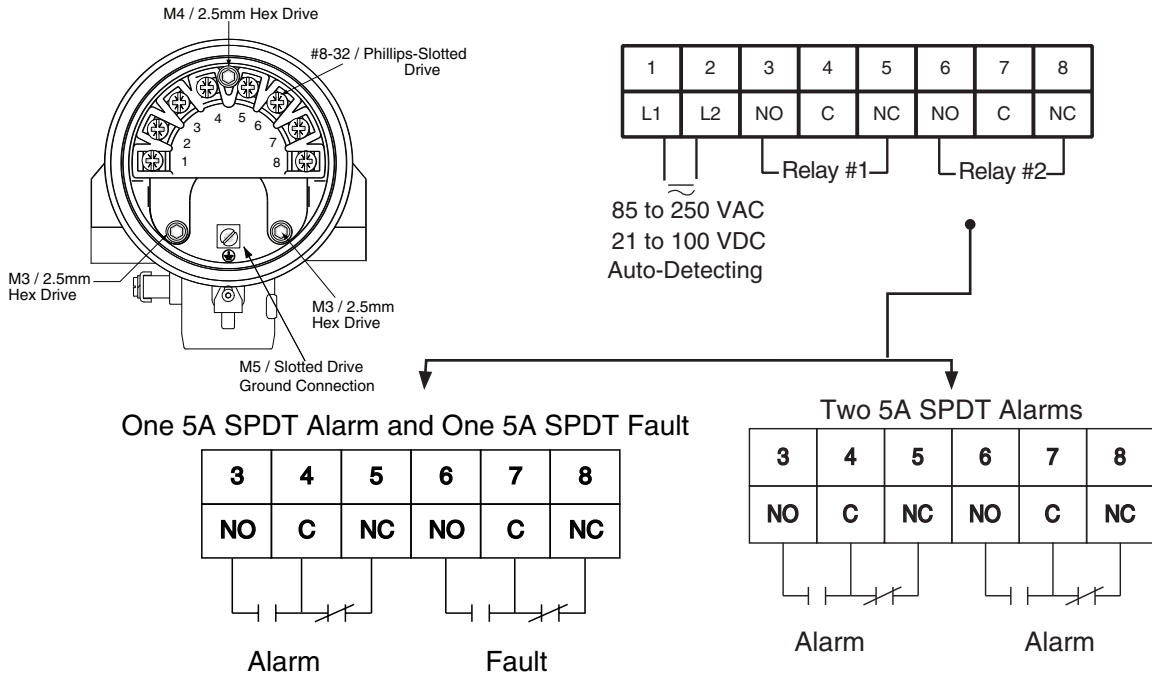


Figure 2-3

Input and Relay Wiring / Customer Connections Side

2.4 Spark Protection

Applications involving insulating granulars and insulating liquids may produce a static discharge that can damage the electronics. The RF series instrument is supplied with integral heavy-duty spark protection to prevent static discharges from damaging the electronic circuits.

2.5 Output Wiring - Relay Version

The IntelliPoint RF series instrument is supplied with two sets of contacts. The relay contacts can be used as one of the following configurations depending on the RELAY #2 jumper configuration (see Figure 2-3 and 2-4)

- One 5A SPDT alarm relay and one 5A SPDT fault relay.
- Two 5A SPDT alarm relays.

2.6 Circuit Board

The circuit board is located on the sensing element/circuit side of the housing (marked on label). Remove the housing lid to access the status LEDs, time delay adjustment, and configuration jumpers. See Figure 2-4.

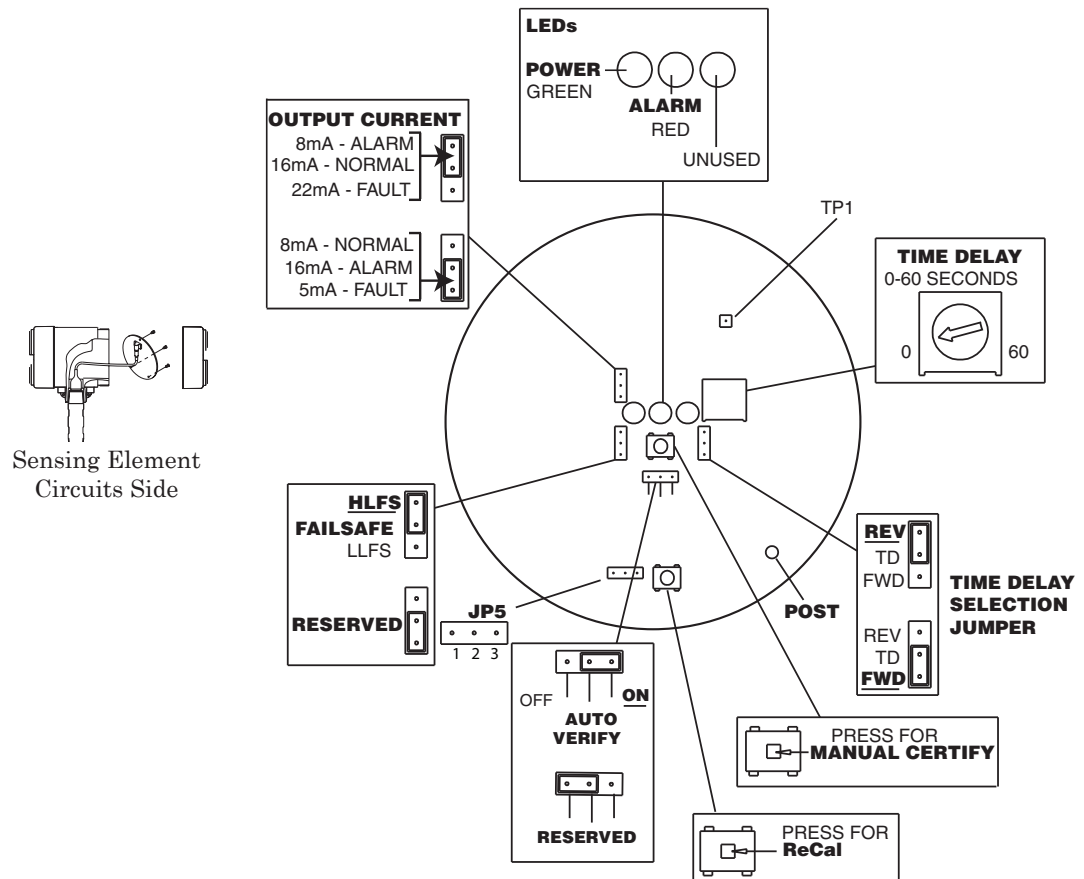


Figure 2-4
Circuit Board



Do NOT push the ReCal button without first ensuring the material being measured is below the sensing element

2.6.1 Time Delay

The "Time Delay" adjustment is located on the sensing element/ circuit board side of the housing (marked on label). It is used to help stop an oscillating current output due to agitation or waves in the vessel. The time delay adjustment can be field adjusted from 0 to 60 seconds. The unit is shipped with the Time Delay set to zero (0) seconds.



The Time Delay adjustment is a 270-Degree turn pot and is at zero seconds when in the full counter-clockwise position. Do not force the pot past the stop or damage will occur.

2.6.2 Time Delay Action

"Time Delay Action" describes if loop current is delayed from going into alarm state or recovering after an alarm state.

- The Time Delay Action is field-selectable using the TD jumper on sensing element side of the housing.
- **FWD**: delays system from coming out of alarm.
- **REV**: delays system from going in alarm.
- The instrument is supplied with time delay action set in forward mode (**FWD**) position.

2.6.3 Failsafe

"Failsafe" describes the level condition that causes the transmitter to go into alarm.

- Safety Switches are only applicable to High Level Fail Safe (HLFS) applications. Fail Safe is factory pre-set and tamper proof sealed. This mode cannot be changed.

2.6.4 Relay #2 Assignment

RELAY #2 assignment refers to operation of **RELAY #2**, and configures relays as (1) SPDT alarm and (1) SPDT fault relay or (2) SPDT alarm relays. **RELAY #1** is always an alarm relay.

- Alarm: **RELAY #2** will follow **RELAY #1**, providing a second SPDT alarm relay.
- Fault: **RELAY #2** will de-energize under a fault condition when **AutoVerify™** self-test function is enabled. *See Section 2.6.6*
- Instrument is supplied with **RELAY #2** jumper set in alarm position.
- **RELAY #2** assignment is field-selectable using a jumper located on sensing element/ circuit board side of housing.

2.6.5 Manual / Remote Certify™

The "Certify" test feature performs a confidence test of the system by duplicating the same signal as a high-level alarm condition without requiring the system to be removed from the tank. Simulating a high level with the Manual/Remote Certify feature:

- Checks the AutoVerify™ and system circuits to ensure proper operation.
- Checks the integrity of the wiring connections.
- Verifies that the sensing element is working properly.

The "**Manual Certify**" test is initiated with the press of the Manual Certify Button located on the sensing element / circuit side of the housing.

The "**Remote Certify**" test is initiated by creating a momentary short between contacts 7 and 8 located on the power supply side of the housing. This can be done with a push button or relay closure.

After initializing the Certify test, the green LED flashes for 5 seconds and the red LED will illuminate. The current moves to the alarm condition for 2 seconds. If the red LED does not turn on, and the current does not move to the alarm condition, the Certify has detected a fault. ***Consult Section 4: Troubleshooting.***

2.6.6 AutoVerify™

"AutoVerify" is a self-testing function that continuously checks the system for proper operation when the unit is in the High Level Failsafe (**HLFS**) mode and in normal condition.

The Safety IntelliPoint switch is shipped with AutoVerify Enabled and tamper sealed.

AutoVerify Can Not be Disabled on the Safety IntelliPoint.

If a fault is detected during the AutoVerify cycle, both LEDs will flash and the relays will de-energize.

2.6.7 AutoVerify™ Criteria

- 1.. In order for the Safety IntelliPoint to correctly detect a disconnected sensor, the active sensor length (active length = insertion length – cote shield length) must be greater than 24 inches (610 mm).
2. Consult Factory for specialty sensors that may be available for shorter length requirements.

2.6.8 Periodic Testing Requirement

The intent of periodic testing is to ensure the SIS continues to function according to design requirements. Periodic testing intervals should be calculated during the SIF design verification. This time interval must be made part of the maintenance procedure for this process.

2.6.9 Re-Calibration

Do not push the "ReCal" Button without first ensuring the IntelliPoint is properly installed and is below the sensing element.

If reset is unsuccessful a red LED will flash. The system is now ready for installation.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Nonvolatile Memory

The IntelliPoint has nonvolatile memory, allowing the unit to re-start after power outages without recalibrating.



When unit is powered for the first time the internal microprocessor records and stores the “Air” value. This is the uncovered value of the sensor mounted in the vessel. The unit will also store the last covered value and the last uncovered value.

Whenever the unit is powered it uses these values as a reference point to determine its current condition (normal or alarm).

The nonvolatile memory will retain the recorded values even if power is lost for months. When the unit regains power, the microprocessor compares the stored values to the current measured value. Then determines its current status.

The setpoint is stored in memory to indicate the last status of the switch. So, when the unit regains power the microprocessor reads the current value of the sensor and determines the status based on the stored values. It will only re-calibrate if the re-call button is pressed.

2.7 Output and LED Status



There are three status LEDs located on the sensing element/circuit board side of the housing. One is used to indicate that the unit has power. The remaining two LEDs are used to indicate the condition of **RELAY #1** and **RELAY #2**. For an illustration, See Figure 2-5.

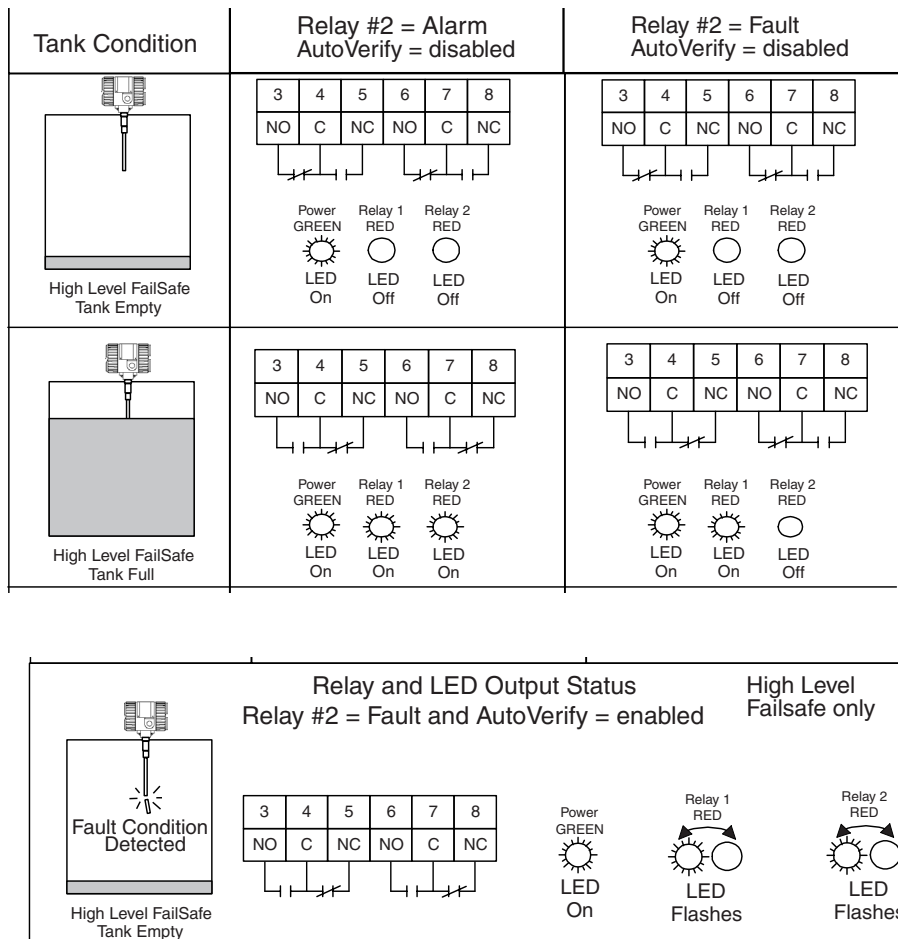


Figure 2-5
Output and LED Status

2.8 Sensing Element Connection

Sensing element connects to the rear side of the circuit board and is factory-installed.



The sensing element is sealed to the housing and cannot be removed without permanent damage.

For IntelliPoint RF instruments that are mounted remotely from the sensing element, an additional housing with terminals is provided to connect the cable from the sensing element. This housing is factory wired to the Intellipoint circuit board. **See Figure 2-7.** Connect Green (Ground) wire to green screw, Red (Shield) wire to red screw, and Blue (Center) wire to blue screw.


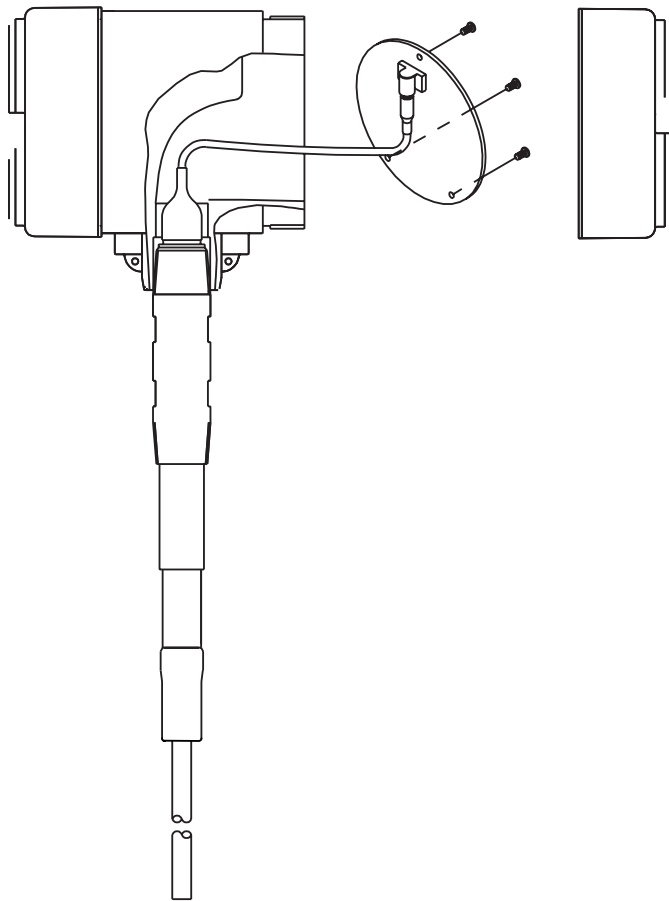


Figure 2-6
Sensing Element Connection (Integral Mounting)

2.8 Sensing Element Connection (Continued)





See Section 6.5 for Spark Protection, Mounting and Wiring




Housing and Bracket are shown rotated 90° for clarity.

G=Ground
S=Shield
C=Center

3 TERMINAL PROBE (TYP)

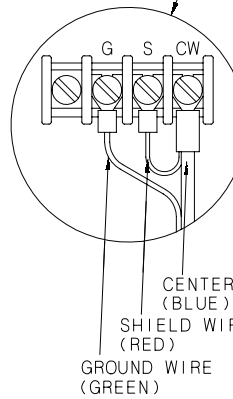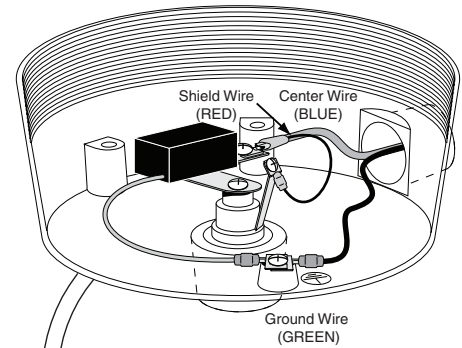

2 TERMINAL PROBE (TYP)

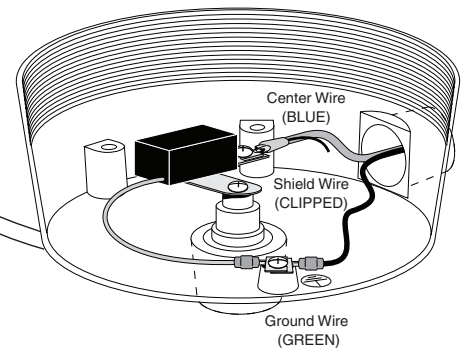

SHIELD WIRE MUST BE CLIPPED BY USER
CLIPPED SHIELD WIRE MUST NOT TOUCH CONDULET HOUSING



After the system has been installed, a proof test must be performed (See Section 4.2).



A full system proof test must be performed when:
 - Any system component is changed or replaced by the user.
 - Any system component or setting is modified by the user.

Figure 2-7
Sensing Element Connection (Remote Mounting)

2.9 Calibration



The IntelliPoint™ model RNT (Standard Sensitivity) and RHT (High Sensitivity) feature Auto-Cal calibration. Auto-Calibration is suitable for liquid and slurry applications.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

2.9.1 Using the IntelliPoint with Auto-Calibration

After the IntelliPoint is installed in the vessel with material below the sensing element, simply apply power. The IntelliPoint electronic unit will auto calibrate.



Caution – The material being measured must be below the sensing element when power is applied (Sensing element uncovered).

Calibration is complete.

If power has been applied to the IntelliPoint prior to installation (on a test bench) or, if the IntelliPoint is moved from one vessel to another, RECAL is necessary for the unit to capture the new air value.

After the IntelliPoint has been installed with the measured material below the sensing element, press and hold the "ReCal" button (shown in *Figure 2-4*) for five (5) seconds. After five seconds, the two LED's flash for sixty seconds before reset occurs.

2.9.2 IntelliPoint Calibration Mode Change

The IntelliPoint was shipped in a calibration mode that was determined to meet the needs of the application for which it was originally sold. If, for some reason, the IntelliPoint is used on a different application, or for other reasons it is determined that a different calibration mode should be used, use the following procedure to make a calibration mode change.

2.9.2 IntelliPoint Calibration Mode Change (Continued)

Each IntelliPoint has 4 different Calibration Modes that are available, dependant on the model purchased.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Available IntelliPoint calibration modes:

Standard Sensitivity systems (RL, RN, RT, RV model series prefix):

Mode 1: Auto-Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 2: Fixed Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.

Mode 3: Auto-Cal 10 pF.

This mode provides a 10 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 4: Fixed Cal 10 pF.

This mode provides a 10 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

High Sensitivity systems (RH, RP model series prefix):

Mode 1: Auto-Cal 0.5 pF.

This mode provides a 0.5 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 2: Fixed Cal 0.5 pF.

This mode provides a 0.5 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.

2.9.2 IntelliPoint Calibration Mode Change (Continued)

Mode 3: Auto-Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 4: Fixed Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Calibration Mode changes



Mode Selection change must be performed with the sensing element in air (Material below sensing element).

1. On the RF circuit board (**Figure 2-8**), temporarily remove the shunt jumper from the “Time Delay Selection Jumper” and place it on pins 1 & 2 of JP5. The green LED will go out, and the red LED’s will begin to flash. The number of flashes indicates which mode the unit is in: 1, 2, 3, or 4.
2. To change modes, press and hold the ReCal button (next to JP 5). The unit will cycle through the modes: first it will flash one time – then pause, this indicates mode #1. It will then flash twice then pause, indicating mode #2, then mode #3, etc. It will scroll through all 4 modes then start over again at mode #1. Release the button when it reaches the desired mode. The LED’s will now flash the number of times indicating which mode has been selected.
3. Remove the shunt from pins 1 & 2 of JP5 and replace it on the “Time Delay Selection Jumper” pins from which it was removed. The unit will remain in the new selected calibration mode. Put the lid back on the housing securely.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

2.9.2 IntelliPoint Calibration Mode Change (Continued)

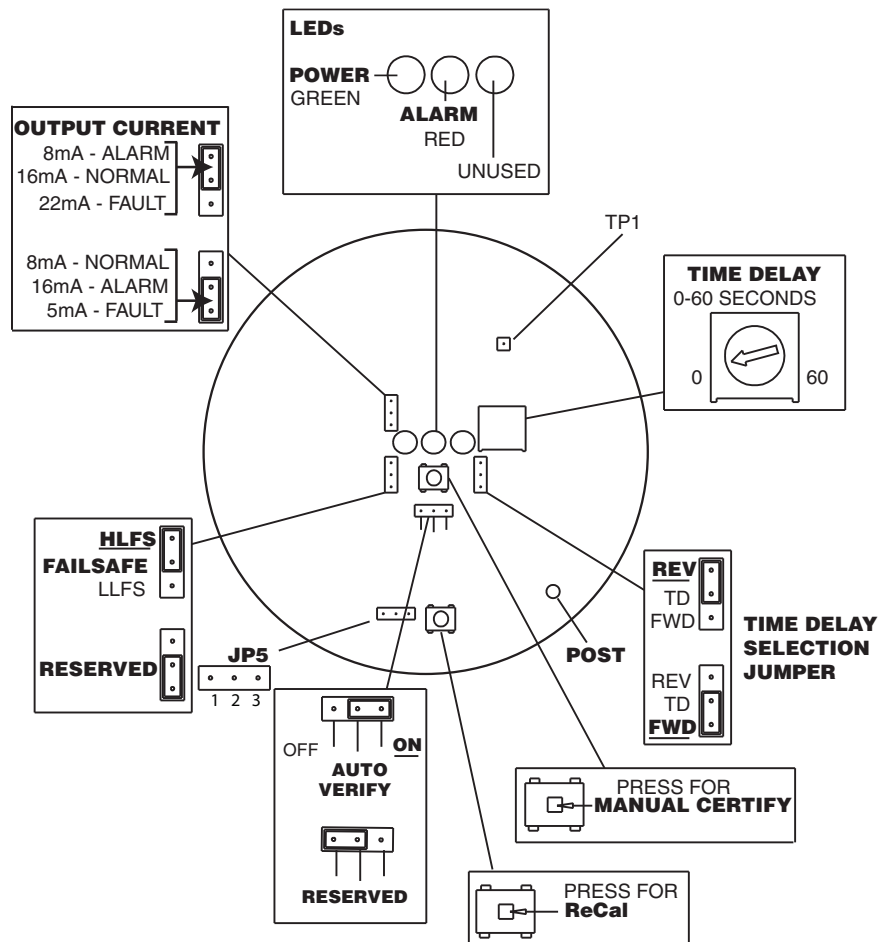


Figure 2-8
Circuit Board

Section 3: Spare Parts List

O-ring 250-1-75

Housing ¼-Inch NPT Conduit Entry 260-2-540

Housing M20 Conduit Entry 260-2-542

Input/ Output Module..... 385-48-6

Input/ Output Module, Gold Relay 385-48-18

Circuit Board

 RLL - 2pf Fixed Calibration 385-48-003-FL2

 RHL - Auto Calibration (0.5pf)..... 385-48-19-HL1

 RNL - Auto Calibration (2pf)..... 385-48-19-003-NL1

 RPL - 0.5pf Fixed Calibration 385-48-19-PL2

 RTL - Auto Calibration (10pf) 385-48-3-QL3

 RVL - 10pf Fixed Calibration 385-48-3-VL4

Integral Sensing Element Cable (PEEK Probes) 380-9000-97

Integral Sensing Element Cable (All Other Probes)..... 380-9000-99

Section 4: Troubleshooting



WARNING:

If The IntelliPoint instrument is located in a hazardous environment, do not open enclosure cover or make/break any electrical connections without first disconnecting electrical power at the source. Ensure that wiring, electrical fittings and conduit connections conform to electrical codes for the specific location and hazard level.

4.1 RF Point Level Troubleshooting Guide

Symptom	Possible Cause	Solution	See Section
Switch is in alarm and will not clear	Sensor is coated by a conductive material and the Cote-Shield™ element does not extend far enough into the vessel	Need a sensor with a longer Cote-Shield element. Rule of thumb is nozzle length + expected wall coating + 2 inches.	Section 2.2, 4.5
	Fail Safe switch is set to the wrong setting	Check to make sure the fail safe switch is in the correct position	Section 2.6.3
	Active section of sensor is touching an internal structure or material is bridging active to ground.	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A Section 2.2, 4.5
	Connection cable or harness between unit and sensor is damaged	Check connection cable for shorts, opens, or damage and proper termination	Section 4.7, 4.6
	Flexible sensor is swaying and active is touching vessel or structure	Add 1 or 2 seconds of reverse acting time delay.	Section 2.6.2
Switch stays in alarm for extended period after level falls below sensor	Material bridging from active to tank structure	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A Section 2.2, 4.5
	Time delay may be active	Make sure time delay pot is full counterclockwise.	Section 2.6.2
Switch does not respond to material	There may not be enough active to detect an insulating material	Change to high sensitivity or adding active length to sensor	Consult Factory Section 4.9, App. A
	Switch was calibrated with sensor covered by material	Make sure material level is below sensor and re-calibrate	Section 2.6.7
	Granular material – Active section is not getting enough coverage due to angle of repose	Relocate sensor to get more coverage or lengthen active. Changing to high sensitivity may also help.	Appendix A
	Connection cable or harness between unit and sensor is damaged	Check connection cable for shorts, opens, or damage and proper termination	Section 4.6, 4.7
Switch delays in responding to material	Reverse acting time delay may be active	Check time delay settings to make sure they are correct	Section 2.6.2
LED's are Flashing	Flashing LED's indicate one of three things. Over Range / Under Range / fault	Consult instruction manual to determine which of the three symptoms are experienced.	Section 4.3, 4.4, 2.7
Over Range indicates that the standing capacitance of the sensing element in the vessel is too large to allow calibration	A long sensing element may generate too much standing capacitance to calibrate	Additional capacitance must be added to the calibration range (padding)	Section 4.9 Consult Factory
	The sensor could be touching an internal tank structure	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A
	Switch was calibrated with sensor covered by material	Make sure material level is below sensor and re-calibrate	Section 2.6.7
	Improper wiring connection (Remote Switches)	Check remote cable connections to confirm they are correct.	Section 2.8
Under Range indicates that the electronic unit is not seeing enough capacitance.	Sensing Element is Disconnected	Verify sensing element cable connections. Test cable continuity.	Section 4.6, 4.7
	Unit is damaged	Consult factory	Section 4.9
Fault Indicates the Auto-Verify feature has detected a problem.	Sensing Element is Damaged	Check Sensing Element for Damaged	Section 2.6.6
	Center wire to shield short	Check cable & sensor	Section 4.5, 4.6, 4.7
	Connecting Cable is Damaged	Check connection cable for damage, shorts, and proper termination	Section 4.6, 4.7
	Electronic Unit is damaged	Consult factory	Section 4.9
Green Power LED is out	Electronic unit is not getting power	Check power source to make sure proper power is supplied and connections are correct	Section 2.4
	Electronic Unit is damaged	Consult factory	Section 4.9

4.2 Testing Electronic Unit



This test is only a test of the electronic unit for troubleshooting purposes, and does not serve as a Verify or Certify test of the complete system.




Proof test must be performed to certify proper operation for SIL performance. Reference Appendix B in the EXIDA Failure Modes, Effects and Diagnostic Analysis located on the Drexelbrook.com website under support/documentation.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Use the following steps to test the electronic unit:



1. Be sure the environment is safe before removing the lid from the housing.
2. If possible to access the sensing element with the material below the sensor, or remove the IntelliPoint from the vessel, use your finger to touch TP1 (Shown in Figure 2-4) while holding any bare metal portion of the instrument housing with the other hand. The system should go to its high level state.
3. Again with no material touching the sensing element, touch the tip of the sensing element with your finger, while holding any bare metal portion of the instrument housing with the other hand. The system should go to its high level state.
4. If the IntelliPoint changes to the high level state while touching test point TP 1, but not when touching the tip of the sensor, in most cases, the interconnecting cable is faulty. ***See Section 4.6: Testing Integral Cable, or Section 4.7 Testing Remote Cable.***
5. If The IntelliPoint is stuck in one state:
 - A. Remove power.
 - B. Disconnect coax cable that joins sensing element to electronic unit.
 - C. Apply power.
 - D. Repeat steps 3 and 4.
 - E. If The IntelliPoint changes state with sensing element disconnected, in most cases, sensing element is faulty. ***See Section 4.5: Testing Sensing Element.***
6. If there was no action in any of steps 2, 3, or 4:
 - A. Remove and then reapply power.
 - B. Press **ReCal** Button (***Shown in Figure 2-4.***)
 - C. Observe that green LED flashes for about 60 seconds.
 - D. Green LED should be lit after 60 seconds.
 - E. Touch test point (***Shown in Figure 2-4***) with your finger.
 - F. Alarm & Loop Current should change state. If so, circuit board is working properly.
 - G. Reinstall instrument and press **ReCal** Button.
7. If The IntelliPoint fails all of above tests, in most cases instrument is faulty. Use a replacement Input/Output Module (**IOM**) or circuit board to determine fault. ***Consult factory.***



4.3 Over Range

If the Red LED is flashing quickly (4 times/second), IntelliPoint has detected that uncovered sensing element capacitance exceeds limits of transmitter. Consult factory for pad capacitor values and instructions.

4.4 Under Range

If the Red LED is flashing slowly (once per second), IntelliPoint has detected that pad capacitor value is too large or a center wire to Cote Shield short. Consult factory for pad capacitor values.

4.5 Testing the Relay Circuits

Use the following steps to check out the relay circuits:

- A. Relay circuits consist of a single-pole double-throw relay contacts brought out to terminal strips for external switching. See **Figure 4-1**.
- B. Relay operation may generally be heard as an audible click when background noise is not too high. Connect ohmmeter to relay contacts to determine if they are switching.
- C. Move the fail safe jumper to the opposite position. The red LED will change and relay contacts should also change. If the contacts do not change, the relay is not functioning properly.

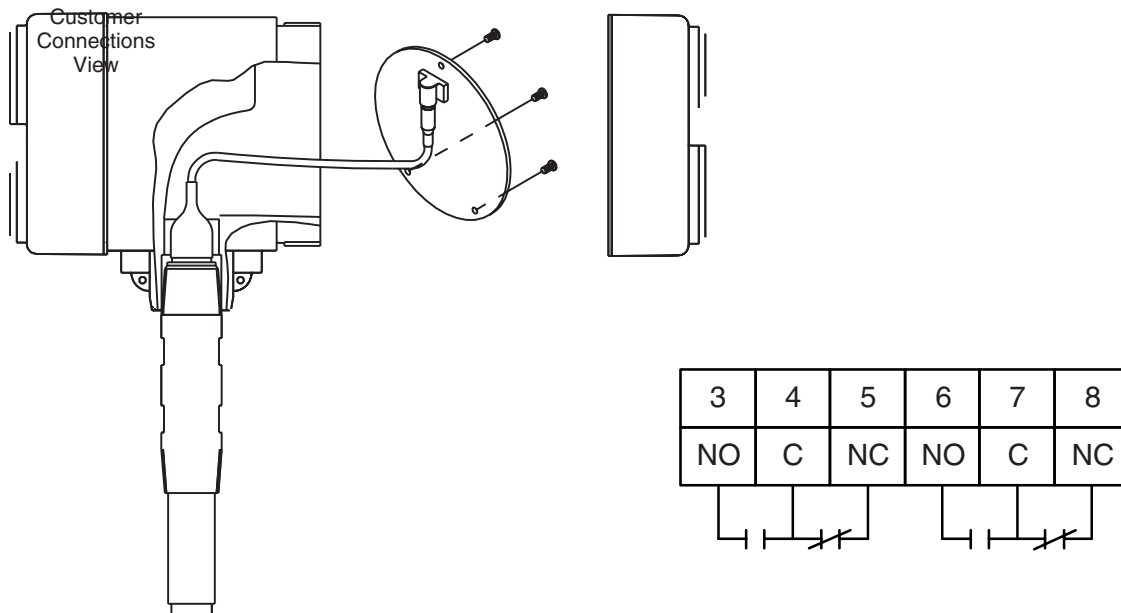


Figure 4-1
Relay Circuit Operation

4.6 Testing The Sensing Element

Integral electronics, *Ref figure 4-1:*

Remove Sensing Element Circuit Board and disconnect cable from circuit board

Remote electronics, *Ref figure 4-2*

Disconnect remote cable at the sensing element.

1. With the sensing element in the vessel, verify level is below the sensing element
2. Use an analog ohmmeter¹ that is set to the R x 1K ohm scale, measure the resistances between each pair of sensing element connections. *Ref Figure 4-1 & 4-2.* Record values in Table 4.1
 - a. If the process material is conductive, it is normal to measure some resistance between sensing element connections. The lowest permissible resistance values are:

Center Wire to Ground	1000 ohms.
Center Wire to Shield	600 ohms.
Cote Shield to Ground	300 ohms.
 - b. If all measurements are open circuit the sensing element has passed the test. If lower resistance was measured continue with testing.
3. Clean sensing element and repeat resistance measurements with the sensing element external to the vessel.
 - a. A clean sensing element should measure an open circuit on all resistance tests.
 - b. If the resistance values increase to an open circuit the resistance was installation or coating related. The most common causes are:
 - i. Cote Shield element does not extend sufficiently into the vessel. Verify the CoteShield element extends at least 2" into the vessel and past wall build-up.
 - ii. Extremely conductive coating on the sensing element. This may require changing the sensing element or electronics. Contact the factory for recommendations.
 - iii. Sensing element is touching vessel. A resistance reading of less than 10 ohms to ground (sensing element housing or tank) is usually due to a metal-to-metal short circuit. Verify that the sensing element is not touching any vessel structure.

4.5 Testing The Sensing Element (Continued)

- c. If the sensing element still shows resistance between terminals of less than 10K ohms, it is possible that moisture is present internal to the sensing element. It may be possible to dry the sensing element until the resistance increases to a value in excess of 10K ohms. However this is an indication the integrity of the sensing element has been compromised. Contact the factory for recommendations.

¹A digital ohmmeter will often produce a resistance measurement that is higher than the actual value.

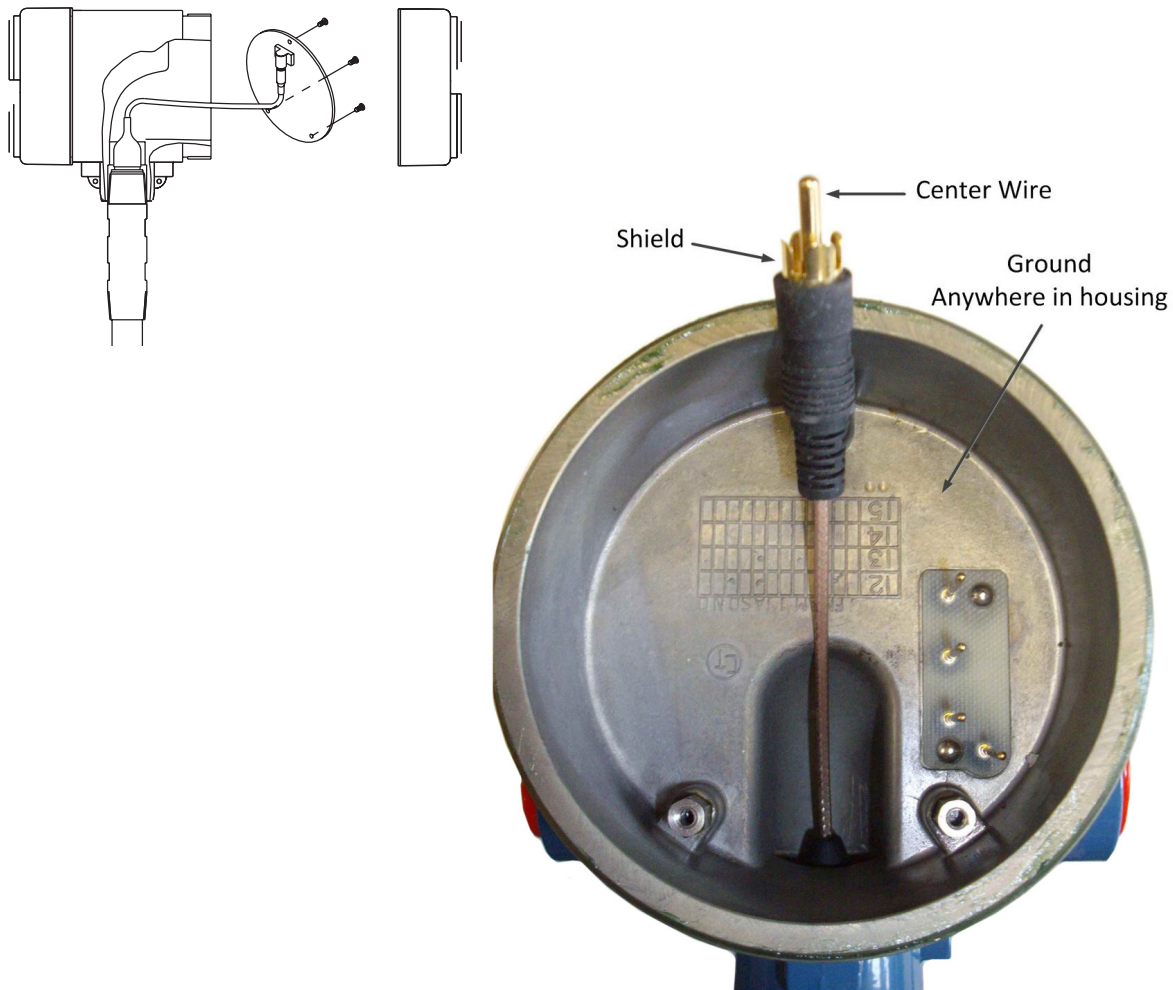
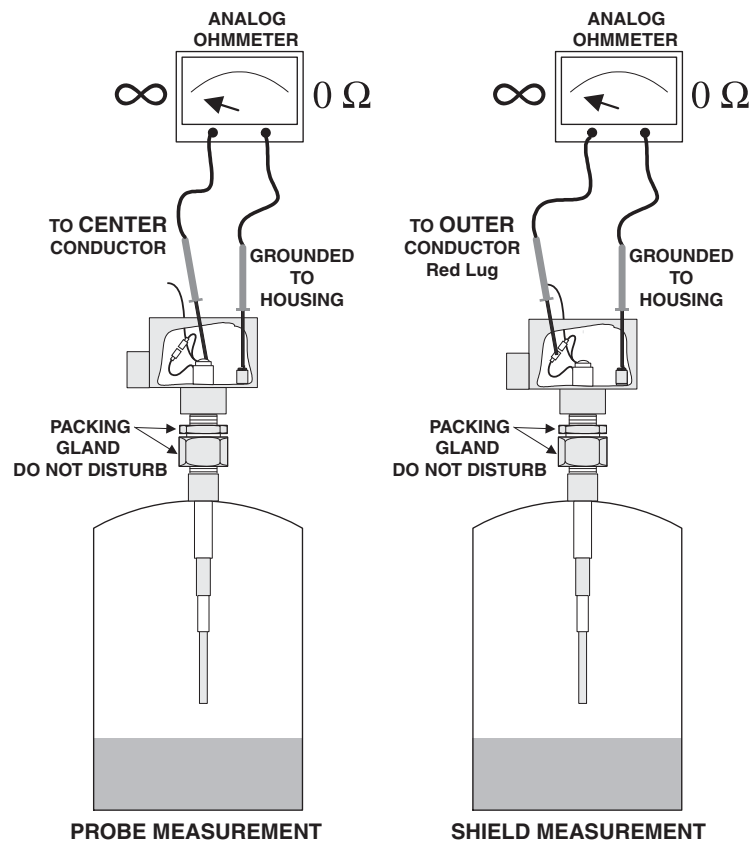


Figure 4-1
Checking the Sensing Element

4.5 Testing The Sensing Element (Continued)



*Figure 4-2
 Checking the Sensing Element
 Center = Probe
 Outer = Shield
 Housing = Ground*

Sensing Element in Vessel		
Center Conductor to Housing	_____	Ohms
Center Conductor to Cote Shield	_____	Ohms
Cote Shield to Housing	_____	Ohms
Sensing Element Cleaned		
Center Conductor to Housing	_____	Ohms
Center Conductor to Cote Shield	_____	Ohms
Cote Shield to Housing	_____	Ohms

Table 4-1

4.6 Testing the Integral Cable

1. Disconnect integral cable from electronic.
2. Check for continuity.
 - a. Using an ohmmeter measure the resistances.
 - i. From the center wire connection on the RCA plug to the sensing element active section (center wire)
 - ii. From the shield connection on the RCA plug to the sensing element shield.
 - iii. If the resistance is greater than 5Ω the cable has failed.
3. Check for shorts.
 - a. The integral cable is tested as part of sensing element test, section 4.5.

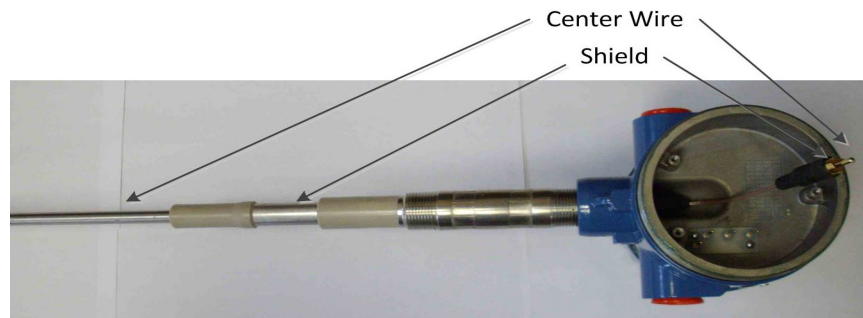


Figure 4-2
Testing Integral Cable

4.7 Testing the Remote Cable

1. Disconnect remote cable from electronic unit and sensing element.
2. Using an ohmmeter measure the resistances as shown in Figure 4-3
 - a. Check for shorts.
 - i. Connect ohmmeter to cable center wire and ground wire. Measure resistance as shown.
 - ii. Move ohmmeter leads and repeat for all measurements shown.
 - iii. If the resistance is less than 100 k-ohms cable has failed
 - b. Check for continuity.
 - i. Short center wire to ground wire and measure resistance as shown. Should be close to 0 ohms
 - ii. Short center wire to shield and repeat.
 - iii. If the resistance is greater than 10 ohms cable has failed

4.7 Testing the Remote Cable (Continued)

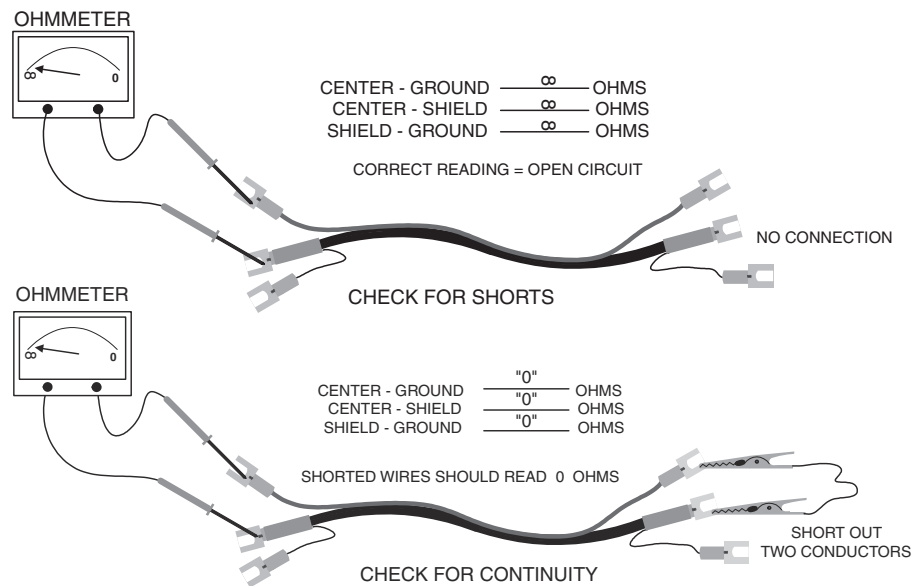


Figure 4-3
Testing Remote Cable

4.8 Testing the Power Supply

Power supply can be tested separately as follows:

1. Remove power from electronic unit.
2. Remove three screws holding circuit board into housing.
3. Disconnect sensing element connection. **See to Section 2.8 Sensing Element Connection.**
4. Reapply power.
5. Using a DC voltmeter, measure voltage from -5 to Common and +5 to Common. Correct readings are -5 to -6 and +5 to +6 Vdc. **See Figure 4-4**

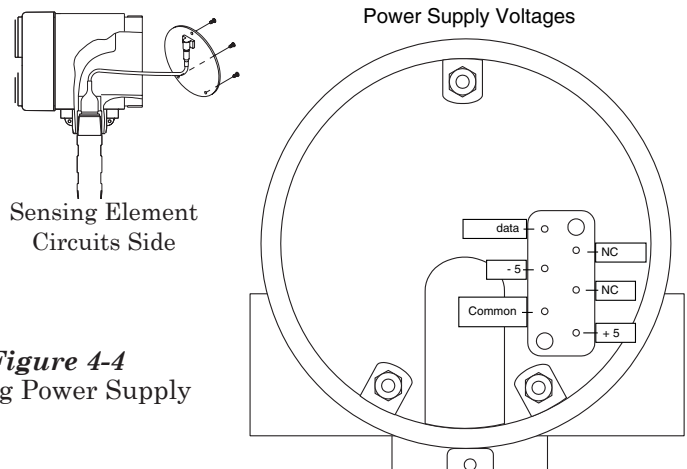


Figure 4-4
Testing Power Supply

4.9 Factory Assistance

AMETEK Drexelbrook can answer any questions about The Intellipoint series instrument. Call Customer Service at +1 215 674-1234.

If you require assistance and attempts to locate the problem have failed:

Contact your local Drexelbrook representative,



Telephone the Service department: +1 215 674-1234

FAX: Service Department + 215-443-5117

E-Mail: drexelbrook.service@ametek.com

Please provide the following information:

- Instrument Model Number
- Sensing Element Model Number and Length
- Original Purchase Order Number
- Material being measured
- Temperature
- Pressure
- Agitation
- Brief description of the problem
- Checkout procedures that have failed

4.10 Field Service

Trained Field Service Engineers are available on a time-plus-expense basis to assist in start-ups, diagnosing difficult application problems, or in-plant training of personnel. Contact the service department for further details.

4.11 Customer Training

Periodically, AMETEK Drexelbrook instrument training seminars for customers are held at the factory. These sessions are guided by Drexelbrook engineers and specialists, and provide detailed information on all aspects of level measurement, including theory and practice of instrument operation. For more information call AMETEK Drexelbrook, Customer Service at 215-674-1234.

4.12 Equipment Return

In order to provide the best service, any equipment being returned for repair or credit must be pre-approved by the factory.

In many applications, sensing elements are exposed to hazardous materials.

- **OSHA mandates** that our employees be informed and protected from hazardous chemicals.
- **Material Safety Data Sheets (MSDS)** listing the hazardous materials to which the sensing element has been exposed **MUST** accompany any repair.
- It is your responsibility to fully disclose all chemicals and **decontaminate** the sensing element.



To obtain a return authorization (RA#), contact the Service department at + 215-674-1234.

- Please provide the following information:
- Model Number of Return Equipment
- Serial Number
- Original Purchase Order Number
- Process Materials to which the equipment has been exposed.
- MSDS sheets for any hazardous materials
- Billing Address
- Shipping Address
- Purchase Order Number for Repairs
- Please include a purchase order even if the repair is under warranty. If repair is covered under warranty, you will not be charged.

Ship equipment freight prepaid to:

AMETEK-DREXELBROOK.
205 KEITH VALLEY ROAD
HORSHAM, PA 19044-1499
COD shipments will not be accepted

Section 5

Section 5: Specifications

5.1 Specifications

Technology:	RF/ Capacitance
Calibration:	None
Modes of Operation:	High Level Fail Safe
Repeatability:	2mm (0.08 inch) Conductive Liquids
Response Time:	Less than 1 Second
Time Delay:	0 to 60 Seconds Forward & Reverse Acting
Ambient Electronics:	-30 to 70°C (-22 to 158°F) ATEX -30 to 58°C (-22 to 136°F) IECEX -40 to 70°C (-40 to 158°F) FM/FMc
Storage Temperature:	-40 to 85°C (-40 to 185°F)
Indicators:	LEDs: Green=Power, Red= Relay 1, Red= Relay 2
Self-Check:	Continuous AutoVerify and Manual Certify
Power Supply (Universal Supply):	85 to 250 VAC 21 to 100 VDC Auto-Detecting w/o Jumper Changes DC to 400 Hz
Power Consumption:	2 Watts Maximum
Relay Contacts:	(2) SPDT
Max Contact Load:	5A/30 VDC/ 5A/250 VAC - Environmentally Sealed
Min Contact Load (DC):	100 mA/12 VDC 0 to 200 mA / 12 VDC Optional
Housing (Electronics):	Dual Compartment, Powder-Coated Aluminum with Two Cable Entries
Cable Entry:	M20 x 1.5 ATEX/IECEX, ¾-Inch NPT FM/FMc
Ingress Protection:	IP66 NEMA 4X

5.1 Approvals



The IntelliPoint RF Point Level System Transmitter has been evaluated as Explosion-proof for use in Class I, Division 1, Groups A, B, C, and D, Dust-Ignition proof for use in Class II and III, Division 1, Groups E, F, and G; Non-incendive for use in Class I, Division 2, Groups A, B, C, and D; Suitable for use in Class II and III, Division 2, Groups F and G Hazardous (Classified) Indoor and Outdoor (Type 4, 4X, IP66) Locations with Intrinsically Safe connections to Class I, II, and III, Division 1, Groups A, B, C, D, E, F, and G Hazardous (Classified) locations in accordance with control drawing 420-0004-144-CD for the RxLx and SxRxL Series and Control Drawing 420-0004-173-CD for the RxTx and SxRxT Series; Intrinsically Safe for use in Class I, II, and III, Division 1, Groups A, B, C, D, E, F, and G hazardous (Classified) locations in accordance with entity requirements and control drawing 420-0004-173-CD.

ATEX (FM14ATEX0049X)

Integral	II 1 G Ex ia IIC T5... T2 -30°C ≤ TAMB ≤ +70°C; IP66	
	II 1 D Ex ia IIIC T90°C -30°C ≤ TAMB ≤ +70°C; IP66	
	Temperature Class Process Temperature	
	T5 100°C	
	T4 135°C	
	T3 200°C	
	T2 230°C	

Remote	II 1 G Ex ia IIC T5... T2 -30°C ≤ TAMB ≤ +70°C; IP66
	II 1 D Ex ia IIIC T90°C -30°C ≤ TAMB ≤ +70°C; IP66

IECEX (FTZU 18.0007X)

System	Ex db ia [ia Ga] IIC T5 Gb/Ga	
	Ex tb ia [ia Da] IIIC T90°C Db/Da	
	-30°C ≤ Ta ≤ 58°C	
Sensor	Ex ia IIC T5 Ga	
	Ex ia IIIC T90°C Da	
	-30°C ≤ Ta ≤ 58°C	

Reference control drawing 420-0004-563-CD for entity and installation requirements

Special Condition for Safe Use

- 1. THE EQUIPMENT SHALL NOT BE APPLIED IN AN EXPLOSIVE DUST ATMOSPHERE WHERE HIGH ELECTROSTATIC CHARGING PROCESSES ARE PRESENT THAT COULD RESULT IN PROPAGATING BRUSH DISCHARGES.***
- 2. CONSULT THE MANUFACTURER IF DIMENSIONAL INFORMATION ON THE FLAMEPROOF JOINTS IS NECESSARY.***
- 3. AMBIENT TEMPERATURE RANGE:***
-30°C TO +58°C FOR RXLX/SXRXTX INTELLIPOINT RF LEVEL SYSTEM
-30°C TO +70°C FOR RXTX/SXRXTX INTELLIPOINT RF TWO-WIRE POINT LEVEL SYSTEM

Section 6

Section 6: Control Drawings

6.1 FM / FMc Control Drawings

NO. 420-0004-144-CD SH1 OF 14

HAZARDOUS (CLASSIFIED) AREA

NON-HAZARDOUS AREA

INPUT VOLTAGE
21-100 VDC
85-250 VAC
DC-400 Hz, 2W
TERMINALS 1-2

RELAY CONNECTIONS
30VDC OR 250 VAC
(MAXIMUM)
TERMINALS 3-8

EQUIPMENT MUST NOT USE OR GENERATE MORE THAN 250 VAC.

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (INTEGRAL PROBE)

HAZARDOUS (CLASSIFIED) AREA

NON-HAZARDOUS AREA

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

CONDUIT SEAL

CONDUIT

SENSING ELEMENT

FLANGE OR THREADED MOUNTING

18" MAX (457 mm)

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8

MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 12

NOTES: 1.1 SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE

1. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
5. USE COPPER WIRING ONLY.
6. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	16	5-19-109	SGA	6-4-19	COPYRIGHT	2019
PO #	15	8-18-102	SGA	8-13-18	AMETEK	DREXELBROOK
ENG	14	10-17-105	SGA	11-28-17	SCALE	NONE
USER	13	10-14-117	SGA	10-28-14	ALL DIMENSIONS IN INCHES (MM)	
	12	10-13-105	SGA	10-28-13	DR.	JHM 6-4-19
ISS.	EDD	DSR	NO.	APP'D	DATE	CK.
DE #						

AMETEK®
DREXELBROOK


205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES CLASS 1, DIVISION 1, GROUP B (INTEGRAL)

420-0004-144-CD SH1 OF 14 ISS.

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD SHT 2 OF 14

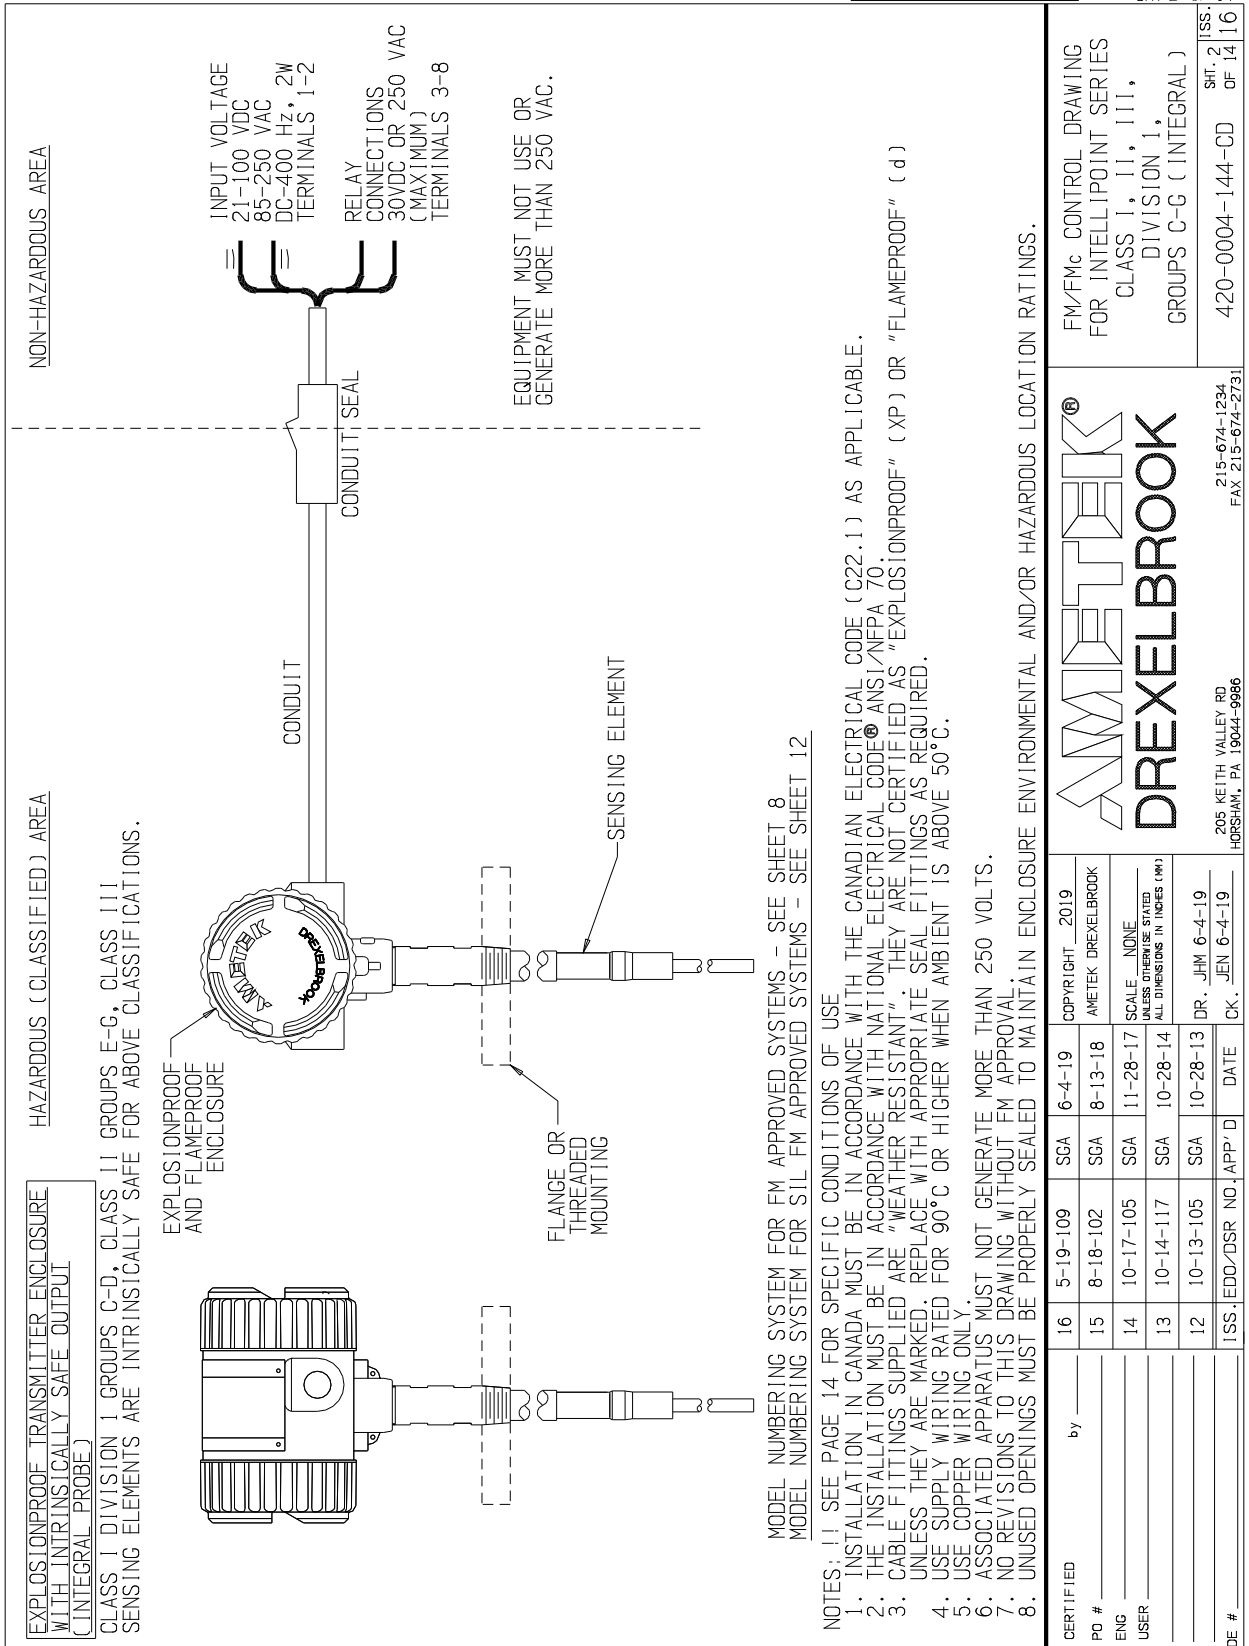


MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8
MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 12

- NOTES: 1. SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE
2. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
3. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
4. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
5. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
6. USE COPPER WIRING ONLY.
7. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
8. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
9. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	16	5-19-109	SGA	6-4-19	COPYRIGHT	2019		FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES CLASS I, II, III, DIVISION 1, GROUPS C-G (INTEGRAL)
PO #	15	8-18-102	SGA	8-13-18	AMETEK	DREXELBROOK		
ENG	14	10-17-105	SGA	11-28-17	SCALE	NONE		
USER	13	10-14-117	SGA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)			
DE #	12	10-13-105	SGA	10-28-13	DR.	JHM 6-4-19		
ISS.	2	420-0004-144-CD	OF	14	215-674-1234		215-674-1234	
					205 KEITH VALLEY RD		215-674-2731	
					HORSHAM, PA 19044-9986			

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD SHT 3 OF 14

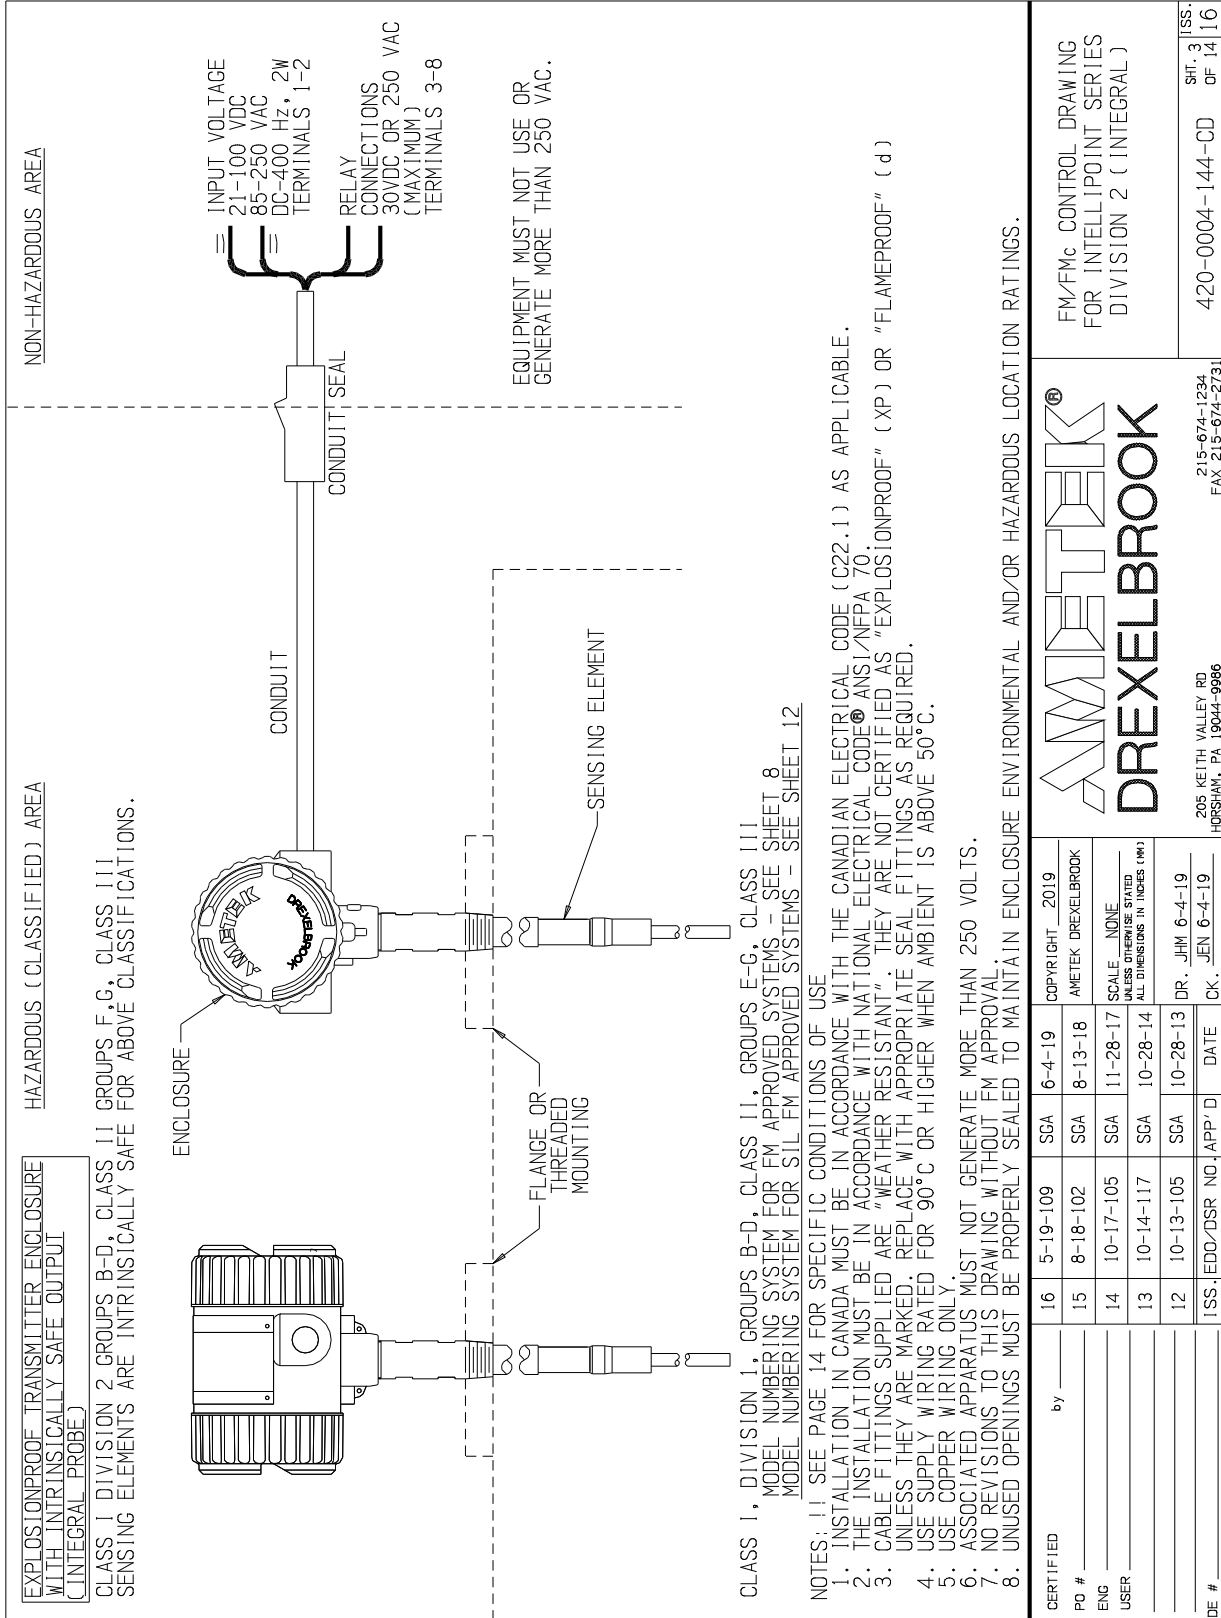

CLASS 1, DIVISION 1, GROUPS B-D, CLASS II, GROUPS E-G, CLASS III MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 12

NOTES: 1. SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE


1. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
5. USE COPPER WIRING ONLY.
6. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	16	5-19-109	SGA	6-4-19	COPYRIGHT	2019		FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES DIVISION 2 (INTEGRAL)
PO #	15	8-18-102	SGA	8-13-18	AMETEK DREXELBROOK			
ENG	14	10-17-105	SGA	11-28-17	SCALE NONE			
USER	13	10-14-117	SGA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IN)			
ISS.	12	10-13-105	SGA	10-28-13	DR.	JHM 6-4-19		
DE #					APP'D	DATE	CK.	JEN 6-4-19
205 KEITH VALLEY RD. HORSHAM, PA 19044-9986 215-674-1234 FAX 215-674-2731								420-0004-144-CD SHT. 3 OF 14 OF 16

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD


SHT 4 OF 14

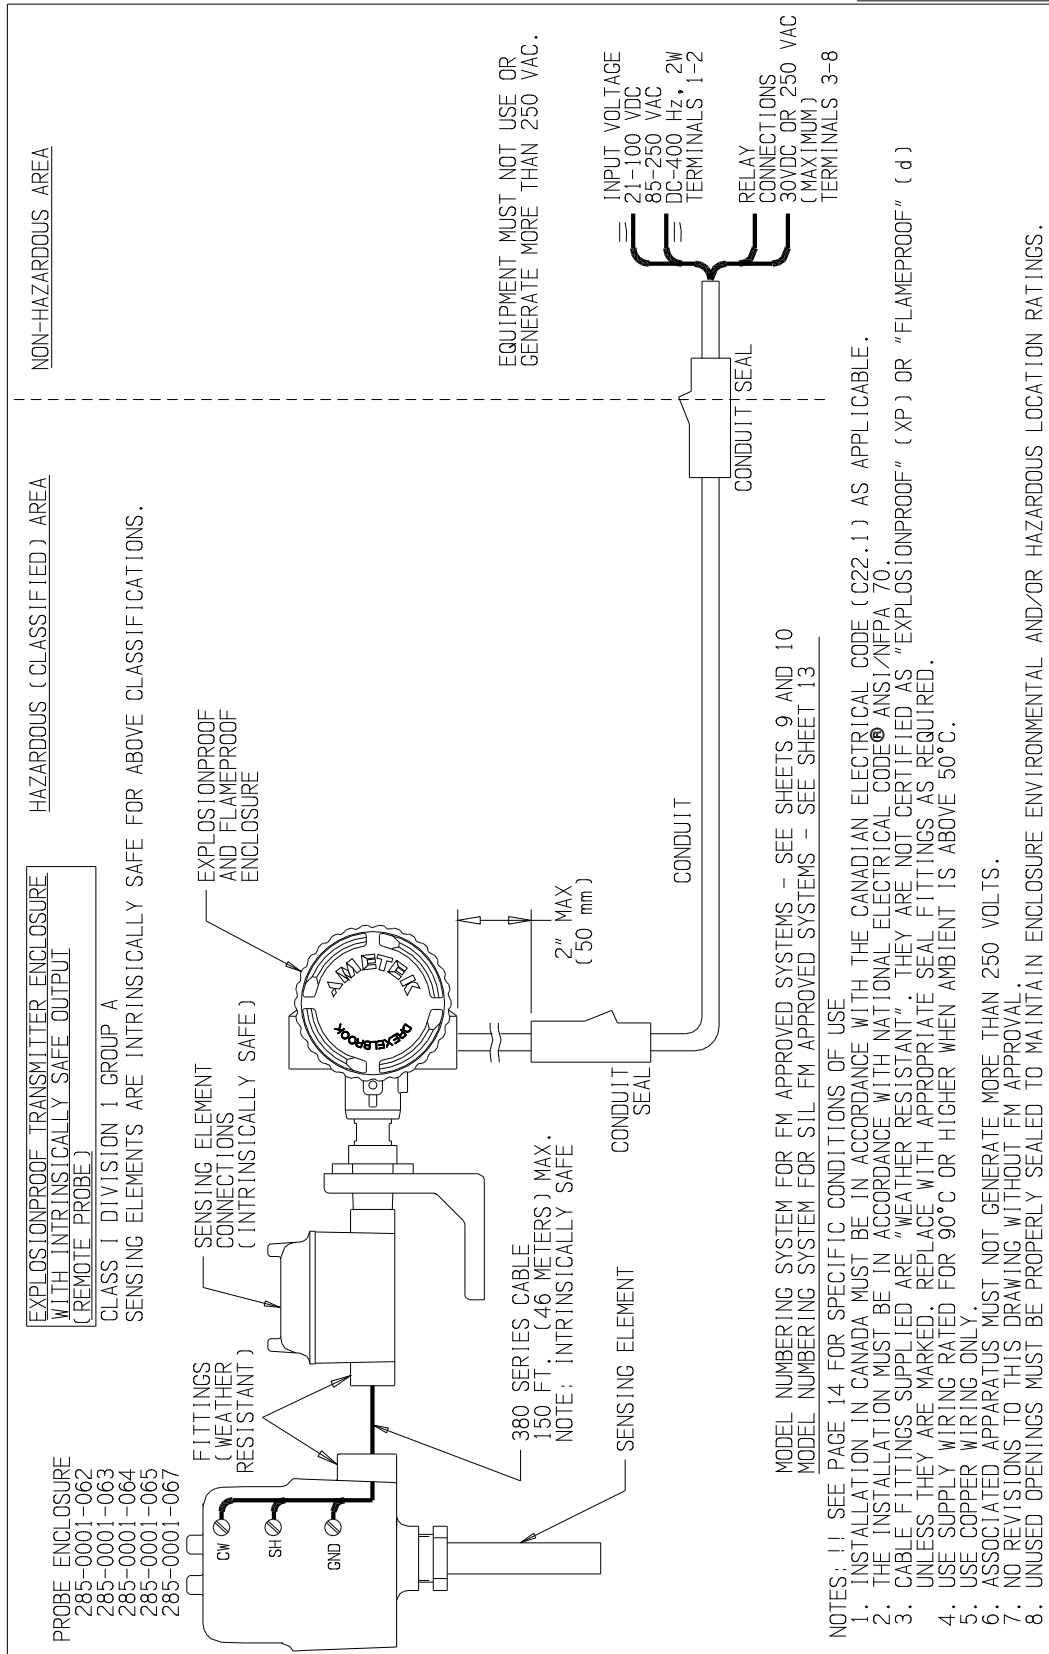

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEETS 9 AND 10
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 13

NOTES: !! SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE

1. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
5. USE COPPER WIRING ONLY.
6. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

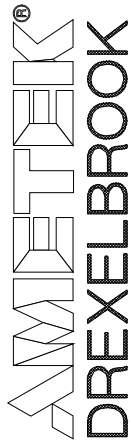

215-674-1234
 205 KEITH VALLEY RD
 HORSHAM, PA 19044-9886
 FAX 215-674-2731


CERTIFIED	16	5-19-109	SGA	6-4-19	COPYRIGHT 2019
PO #	15	8-18-102	SGA	8-13-18	AMETEK DREXELBROOK
ENG	14	10-17-105	SGA	11-28-17	SCALE NONE
USER	13	10-14-117	SGA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)
ISS. #	12	10-13-105	SGA	10-28-13	DR. JHM 6-4-19
DATE	CK. JEN	6-4-19			

FM/FMc CONTROL DRAWING FOR INTELLIPPOINT SERIES CLASS 1, DIVISION 1 GROUP A (REMOTE)

420-0004-144-CD
 SHT. 4 OF 14

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD SHT 5 OF 14

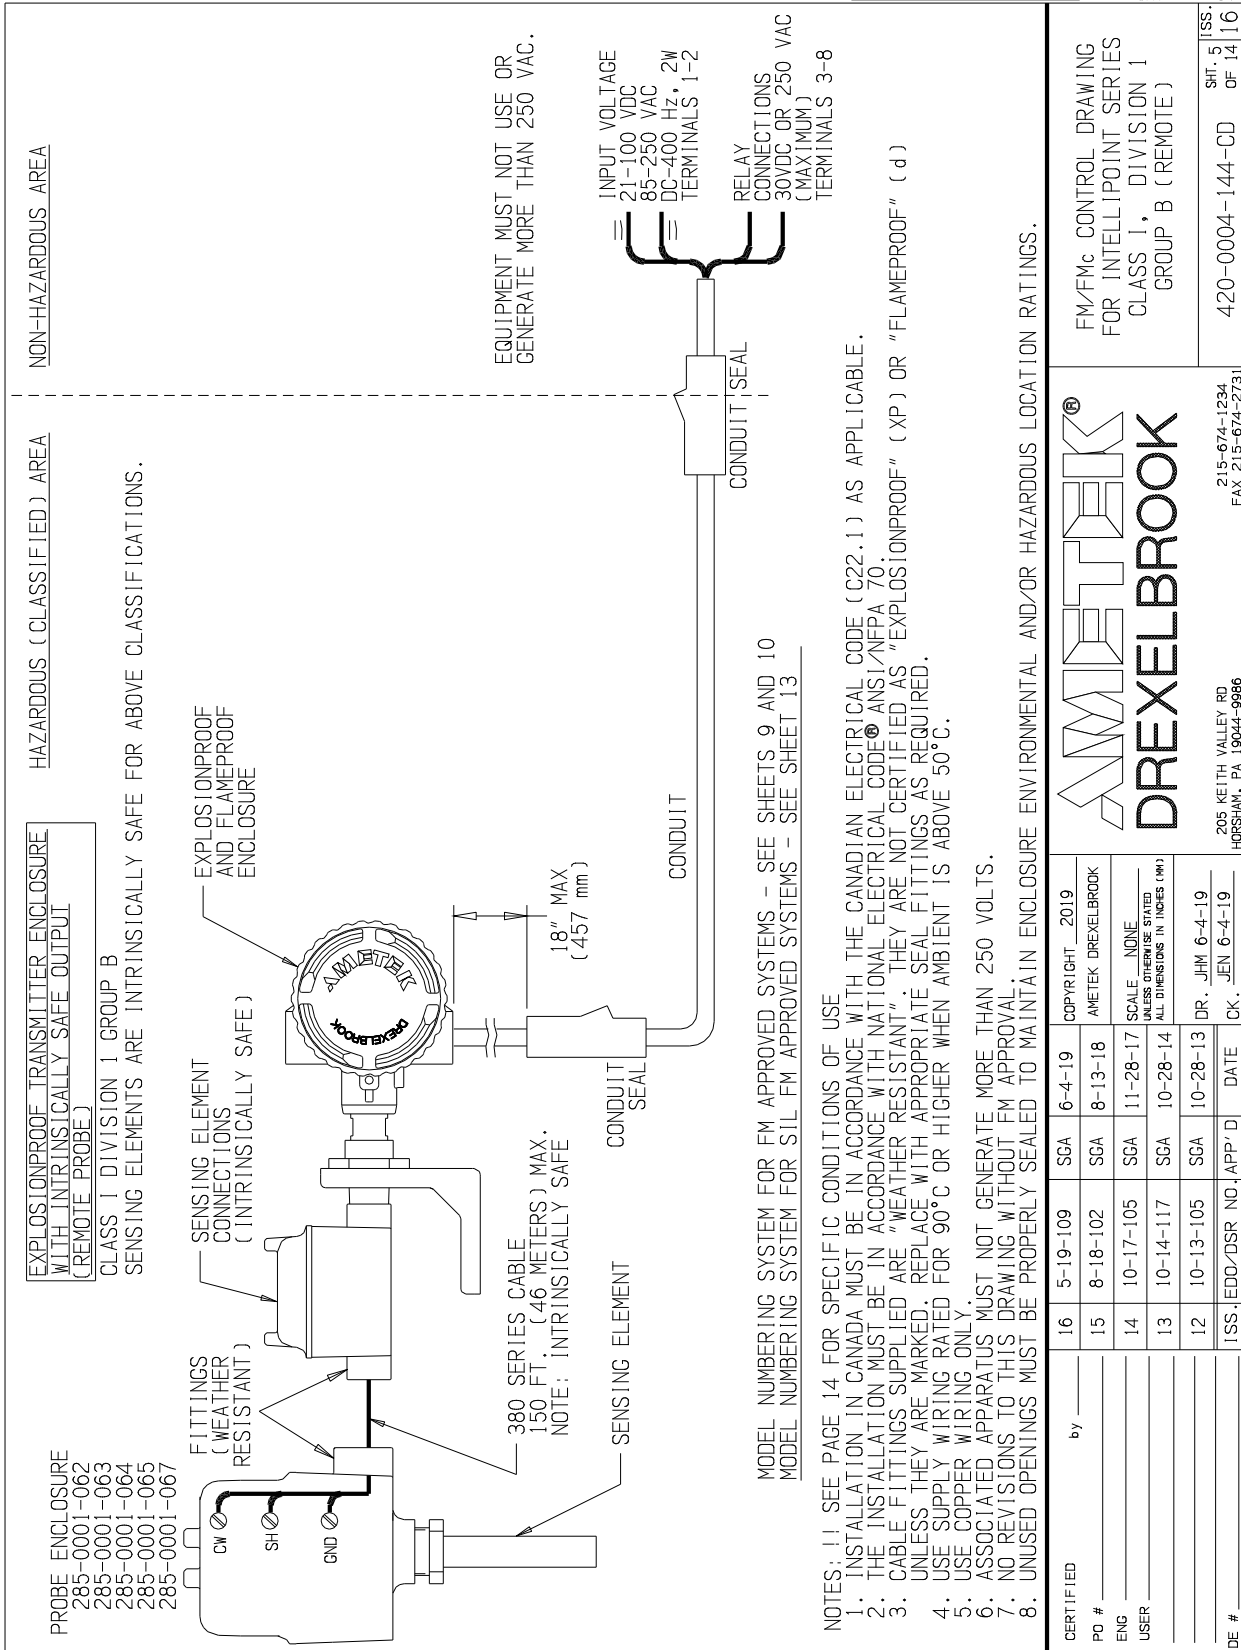

NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)

CLASS 1 DIVISION 1 GROUP B SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

- PROBE ENCLOSURE
- 285-0001-062
- 285-0001-063
- 285-0001-064
- 285-0001-065
- 285-0001-067

FITTINGS (WEATHER RESISTANT)

SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

EQUIPMENT MUST NOT USE OR GENERATE MORE THAN 250 VAC.

INPUT VOLTAGE
21-100 VDC
85-250 VAC
DC-400 Hz, 2W
TERMINALS 1-2

RELAY CONNECTIONS
30VDC OR 250 VAC (MAXIMUM)
TERMINALS 3-8

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEETS 9 AND 10
MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 13

NOTES: 1. SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE

2. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.

3. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).

4. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.

5. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.


6. USE COPPER WIRING ONLY.

7. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.

8. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.

9. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	16	5-19-109	SGA	6-4-19	COPYRIGHT - 2019
PO #		15	8-18-102	SGA	8-13-18	AMETEK DREXELBROOK
ENG		14	10-17-105	SGA	11-28-17	SCALE - NONE
USER		13	10-14-117	SGA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)
ISS.	EDD/DSR NO./APP/D	12	10-13-105	SGA	10-28-13	DR. JHM 6-4-19
DE #	DATE	CK.	JEN 6-4-19			

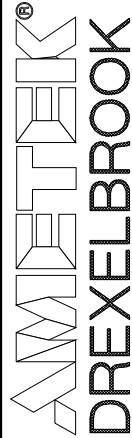

205 KEITH VALLEY RD
HORSHAM, PA. 19044-9886
215-674-1234
FAX 215-674-2731


FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES CLASS 1, DIVISION 1 GROUP B (REMOTE)

420-0004-144-CD SHT. 5 OF 14

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD

SHT 6 OF 14

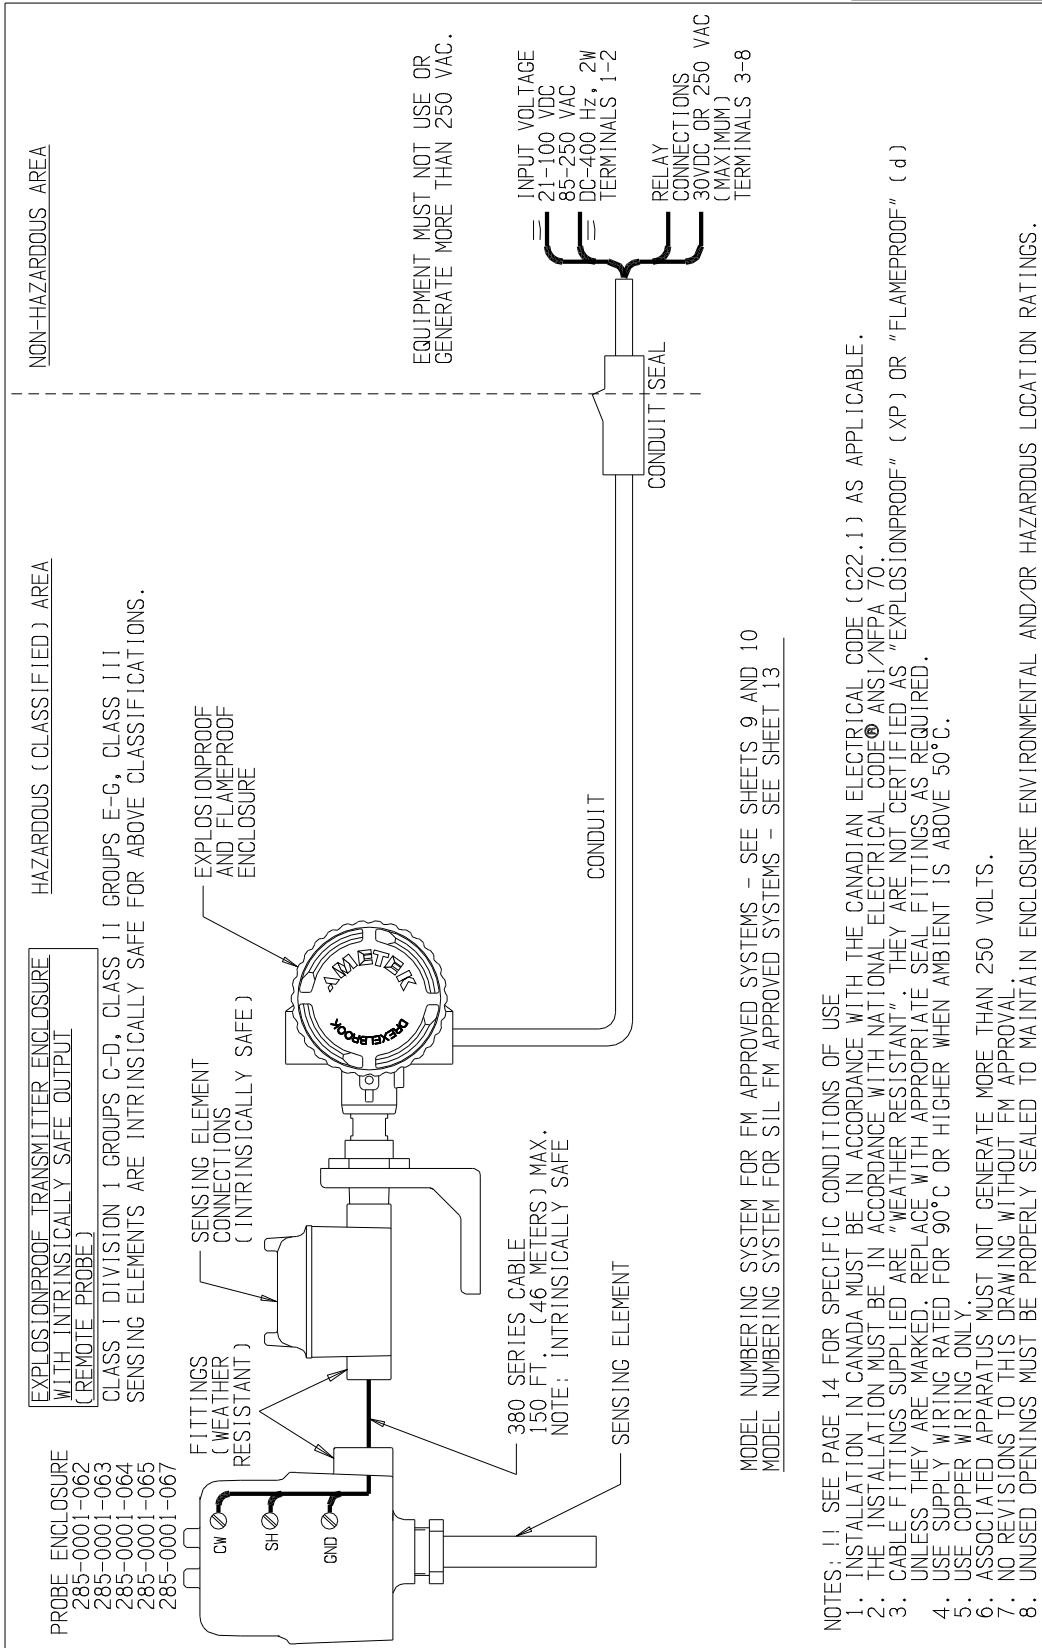

HAZARDOUS (CLASSIFIED) AREA

NON-HAZARDOUS AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)

CLASS I DIVISION 1 GROUPS C-D, CLASS II GROUPS E-G, CLASS III SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

- PROBE ENCLOSURE
- 285-0001-062
- 285-0001-063
- 285-0001-064
- 285-0001-065
- 285-0001-067

FITTINGS (WEATHER RESISTANT)

SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

380 SERIES CABLE 150 FT. (46 METERS) MAX. NOTE: INTRINSICALLY SAFE

SENSING ELEMENT

CONDUIT

CONDUIT (SEAL)

INPUT VOLTAGE 21-100 VDC 85-250 VAC DC-400 Hz, 2W TERMINALS 1-2

RELAY CONNECTIONS (MAXIMUM) TERMINALS 3-8

EQUIPMENT MUST NOT USE OR GENERATE MORE THAN 250 VAC.

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEETS 9 AND 10
MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 13

NOTES: !! SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE


1. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
5. USE COPPER WIRING ONLY.
6. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	16	5-19-109	SGA	6-4-19	COPYRIGHT	2019
PO #		15	8-18-102	SGA	8-13-18	AMETEK DREXELBROOK	
ENG		14	10-17-105	SGA	11-28-17	SCALE NONE	
USER		13	10-14-117	SGA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
DE #		12	10-13-105	SGA	10-28-13	DR.	JHM 6-4-19
						ISS.	JEN 6-4-19
						DATE	CK.

FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES CLASS I, II, III, DIVISION 1 GROUP C-G (REMOTE)	
205 KEITH VALLEY RD HORSHAM, PA 19044-9886	215-674-1234 FAX 215-674-2731
420-0004-144-CD	SHT. 6 OF 14

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-144-CD SHT 7 OF 14

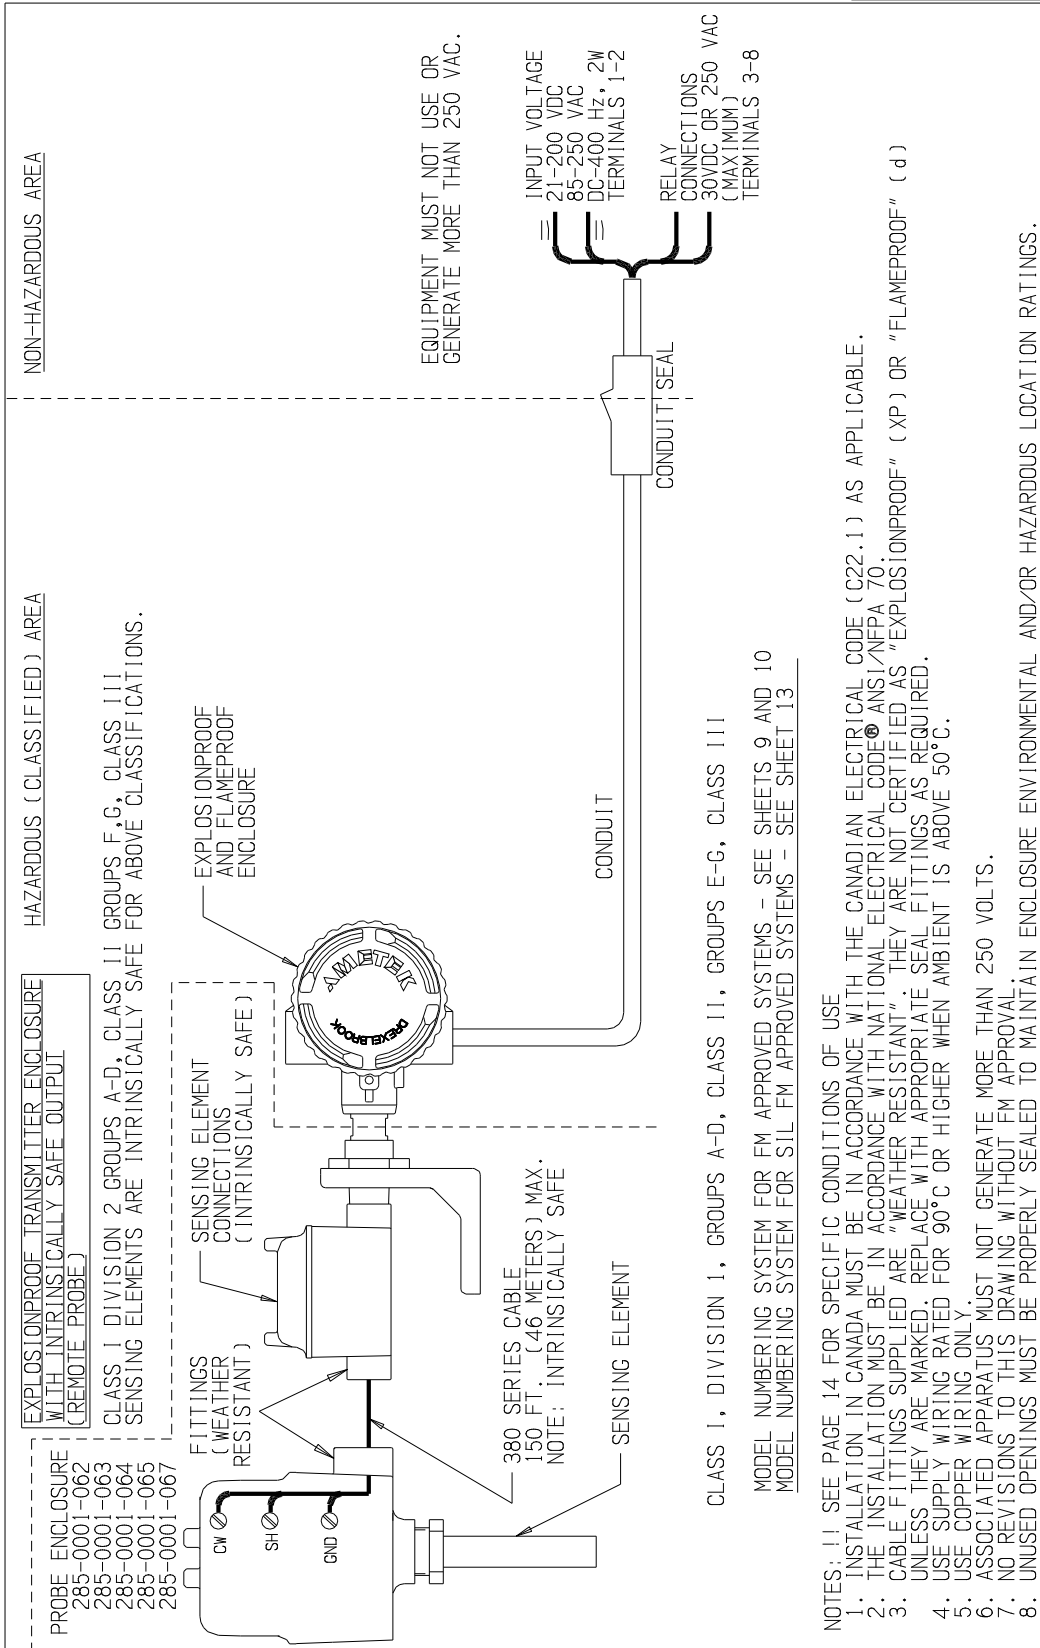

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)
 CLASS I DIVISION 2 GROUPS A-D, CLASS II GROUPS F, G, CLASS III SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

- PROBE ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)
- 285-0001-062
- 285-0001-063
- 285-0001-064
- 285-0001-065
- 285-0001-067

FITTINGS (WEATHER RESISTANT)
 SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)
 EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

380 SERIES CABLE 150 FT. (.46 METERS) MAX. NOTE: INTRINSICALLY SAFE

CONDUIT
 CONDUIT SEAL
 INPUT VOLTAGE 21-200 VDC 85-250 VAC DC-400 Hz, 2W TERMINALS 1-2
 RELAY CONNECTIONS 30VDC OR 250 VAC (MAXIMUM) TERMINALS 3-8

CLASS I, DIVISION 1, GROUPS A-D, CLASS II, GROUPS E-G, CLASS III
 MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEETS 9 AND 10
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 13

- NOTES: !! SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE
1. INSTALLATION IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE (C22.1) AS APPLICABLE.
 2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
 3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 5. USE COPPER WIRING ONLY.
 6. ASSOCIATED APPARATUS MUST NOT GENERATE MORE THAN 250 VOLTS.
 7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	16	5-19-109	SCA	6-4-19	COPYRIGHT	2019
PO #		15	8-18-102	SCA	8-13-18	AMETEK	DREXELBROOK
ENG		14	10-17-105	SCA	11-28-17	SCALE	NONE
USER		13	10-14-117	SCA	10-28-14	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
ISS.	EDD/DSR NO./APP'D	12	10-13-105	SCA	10-28-13	DR.	JHM 6-4-19
DE #	DATE	CK.	JEN 6-4-19				

205 KEITH VALLEY RD
 HORSHAM, PA. 19044-9886
 215-674-1234
 FAX 215-674-2731

AMETEK®
 DREXELBROOK

FM/FMc CONTROL DRAWING FOR INTELLIPOINT SERIES DIVISION 2 (REMOTE)

420-0004-144-CD SHT. 7 OF 14

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	
R	a	L	b	-	0	c	d	e	*	*	*	*
	a											a = MEASUREMENT OPTIONS:
												N = 2 pF AUTO-CAL
												M = MANUAL-CAL (STANDARD SENSITIVITY)
												H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
												G = MANUAL-CAL (HIGH SENSITIVITY)
												L = 2 pF FIXED
												T = 10 pF AUTO-CAL
												V = 10 pF FIXED
												P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b									b = OPTIONS
												3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
												7 = FM/FMc APPROVAL, DUAL SEAL
												B = FM/FMc APPROVAL, DUAL SEAL
						c						c = RELAYS
												1 = STANDARD RELAY
												2 = GOLD CONTACTS
							d	e				d, e = SENSING ELEMENTS: 00, 02-04, 06, 07, 09, 11-19,
								0	0			21, 22, 24, 25, 28, 72, 73, 86, 87, 90-93, NN, or ZZ.
									0			700-1202-021
									2			700-1202-024
									3			700-1202-028
									4			700-1202-042
									6			700-1202-032
									7			700-1202-020
									9			700-1202-034
						1	1					700-0201-005
							2					700-0201-005 (HAST C)
							3					700-0201-019
							4					700-0202-002
							5					700-0202-043
							6					700-0002-360
							7					700-0202-029
							8					700-0001-022
							9					700-0002-023
						2	1					700-0202-043 (HAST-C)
							2					700-0202-044
							4					700-0005-485
							5					700-0005-485 (HAST-C)
							8					700-1202-052
						6	7					700-3201-002 (16)
						7	2					700-0201-027
							3					700-0201-028
						8	6					700-0005-594
							7					700-0005-595
						9	0					700-0201-059
							1					700-1202-016
							2					700-1202-046
							3					700-1202-056
						N	N					RETROFIT KIT 285-0001-671
						Z	Z					SEE SHEET 11 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

FM/FMc APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 8 OF 14
 420-0004-144-CD ISS. 16

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	b	-	c	d	e	f	-	*	*	*	*
	a												a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b										b = OPTIONS
													3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
													7 = FM/FMc APPROVAL, DUAL SEAL
													B = FM/FMc APPROVAL, DUAL SEAL
					c								c = 1-9, A-K CABLE LENGTHS
						d							d = RELAYS
													1 = STANDARD RELAY
													2 = GOLD CONTACTS
							e	f					e, f = SENSING ELEMENTS: 00, 02-04, 06, 07, 09-22, 24-28, 31-40,
								f					50-53, 55, 60-62, 64, 66, 72, 73, 80-83, 85, 90-94, NN, or ZZ.
							0	0					700-1202-001
								2					700-1202-014
								3					700-1202-018
								4					700-1202-041
								6					700-1202-031
								7					700-1202-010
								9					700-1202-033
							1	0					700-0001-018
								1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
							2	0					700-0209-002
								1					700-0202-043 (HAST-C)
								2					700-0202-044
								4					700-0005-285
								5					700-0005-285 (HAST-C)

SENSING ELEMENT LIST
CONTINUED ON NEXT PAGE

FM/FMc APPROVED
REMOTE, LINE POWERED, INTELLIPOINT
MODEL NUMBERING SYSTEM
SHT 9 OF 14
420-0004-144-CD ISS. 15

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	b	-	c	d	e	f	-	*	*	*	*
													SENSING ELEMENTS: CONTINUED...
							2	6					700-0220-001
								7					700-0221-002
								8					700-1202-051
							3	1					700-0029-001
								2					700-0029-002
								3					700-0029-003
								4					700-0029-004
								5					700-0029-005
								6					700-0029-102
								7					700-0029-103
								8					700-0029-104
								9					700-0029-105
							4	0					700-0029-106
							5	0					700-0207-001
								1					700-0207-002
								2					700-0207-003
								3					700-0207-004
								5					700-0207-006
							6	0					700-0204-038
								1					700-0204-002
								2					700-0204-048
								4					700-0204-024
								6					700-0204-022
								7					700-3201-001 16
							7	2					700-0201-027
								3					700-0201-028
							8	0					700-4200-020
								1					700-4200-030
								2					700-4200-040
								3					700-4200-060
								5					700-9000-494
							9	0					700-0201-059
								1					700-1202-015
								2					700-1202-045
								3					700-1202-055
								4					700-0209-024
							N	N					RXXX-1XNN-NN-CD
							Z	Z					SEE SHEET 11 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

FM/FMc APPROVED
 REMOTE, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 10 OF 14
 420-0004-144-CD ISS. 16

6.1 FM / FMc Control Drawings (Continued)

MODEL NUMBERS OF APPROVED SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERATURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1µF.
3. MAXIMUM INSERTION LENGTH **RIGID SENSOR** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH **FLEXIBLE SENSOR** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

!! SEE PAGE 14 FOR SPECIFIC CONDITIONS OF USE

FM APPROVED
ADDITIONAL
SENSING ELEMENTS

SHT 11 OF 14
420-0004-144-CD ISS.16

6.1 FM / FMc Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	7	8	9	10	11	12	13	14		
S	a	R	b	L	c	-	0	d	e	f	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS:
															N = 2 pF AUTO-CAL
															H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
															L = 2 pF FIXED
															T = 10 pF AUTO-CAL
															V = 10 pF FIXED
															P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c										c = OPTIONS
															3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
															7 = FM/FMc APPROVAL, DUAL SEAL
															B = FM/FMc APPROVAL, DUAL SEAL
								d							d = RELAYS
															1 = STANDARD RELAY
															2 = GOLD CONTACTS
								e	f						e, f = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-19,
								0	0						21, 24, 25, 28, 72, 73, 86, 87, 90-93.
									0						700-1202-021
									2						700-1202-024
									4						700-1202-042
									6						700-1202-032
									7						700-1202-020
									9						700-1202-034
								1	1						700-0201-005
									2						700-0201-005 (HAST C)
									3						700-0201-019
									4						700-0202-002
									5						700-0202-043
									6						700-0002-360
									7						700-0202-029
									8						700-0001-022
									9						700-0002-023
								2	1						700-0202-043 (HAST-C)
									4						700-0005-485
									5						700-0005-485 (HAST-C)
									8						700-1202-052
								6	7						700-3201-002 16
								7	2						700-0201-027
									3						700-0201-028
								8	6						700-0005-594
									7						700-0005-595
								9	0						700-0201-059
									1						700-1202-016
									2						700-1202-046
									3						700-1202-056

SIL, FM/FMc APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 12 OF 14
 420-0004-144-CD ISS. 16

6.1 FM / FMc Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	
S	a	R	b	L	c	d	e	f	g	-	*	*	*	*
	a													a = 2 SIL LEVEL 2
			b											b = MEASUREMENT OPTIONS:
														N = 2 pF AUTO-CAL
														H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
														L = 2 pF FIXED
														T = 10 pF AUTO-CAL
														V = 10 pF FIXED
														P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c									c = OPTIONS
														3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
														7 = FM/FMc APPROVAL, DUAL SEAL
														B = FM/FMc APPROVAL, DUAL SEAL
						d								d = 1-9, A-K CABLE LENGTHS
							e							e = RELAYS
														1 = STANDARD RELAY
														2 = GOLD CONTACTS
								f	g					f, g = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-21, 24-28,
														60-62, 64, 66, 72, 73, 85, 90-94.
								0	0					700-1202-001
									2					700-1202-014
									4					700-1202-041
									6					700-1202-031
									7					700-1202-010
									9					700-1202-033
								1	1					700-0201-005
									2					700-0201-005 (HAST C)
									3					700-0201-019
									4					700-0202-002
									5					700-0202-043
									6					700-0002-360
									7					700-0202-029
									8					700-0001-022
									9					700-0002-023
								2	0					700-0209-002
									1					700-0202-043 (HAST-C)
									4					700-0005-285
									5					700-0005-285 (HAST-C)
									6					700-0220-001
									7					700-0221-002
									8					700-1202-051
								6	0					700-0204-038
									1					700-0204-002
									2					700-0204-048
									4					700-0204-024
									6					700-0204-022
									7					700-3201-001 ⁽¹⁶⁾
								7	2					700-0201-027
									3					700-0201-028
								8	5					700-9000-494
								9	0					700-0201-059
									1					700-1202-015
									2					700-1202-045
									3					700-1202-055
									4					700-0209-024

SIL, FM/FMc APPROVED
 REMOTE, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 13 OF 14
 420-0004-144-CD ISS. 16


6.1 FM / FMc Control Drawings (Continued)

SPECIFIC CONDITIONS OF USE

1. *“The equipment shall not be applied in an explosive dust atmosphere where high electrostatic charging processes are present that could result in propagating brush discharges. See IEC TS60079-32-1 for additional guidance.”*
2. *Consult the manufacturer if dimensional information on the flameproof joints is necessary.*

SPECIFIC CONDITIONS OF USE
SHT 14 OF 14
420-0004-144-CD ISS. 16

6.2 ATEX Control Drawings

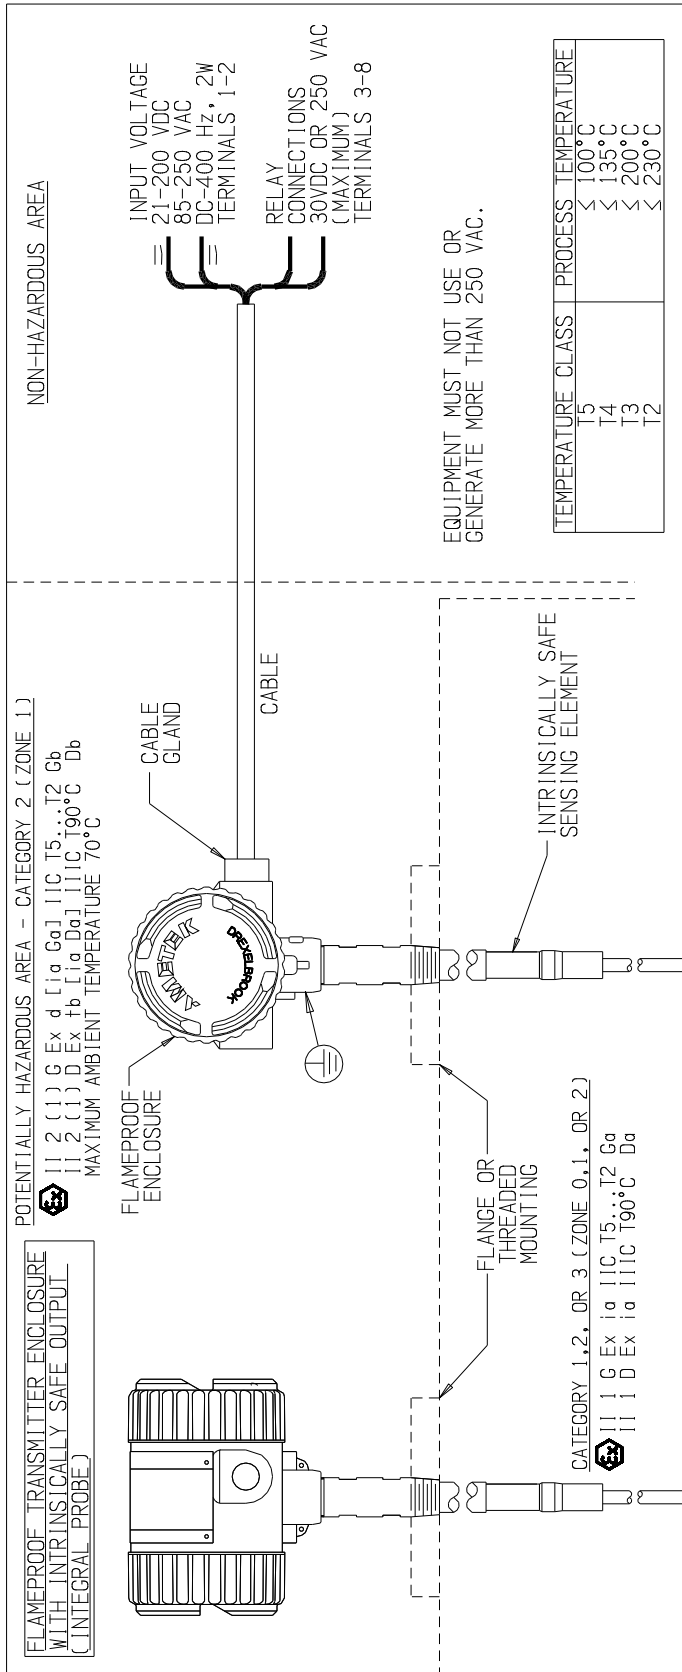

EQUIPMENT MUST NOT USE OR GENERATE MORE THAN 250 VAC.

TEMPERATURE CLASS	PROCESS TEMPERATURE
T5	≤ 100°C
T4	≤ 135°C
T3	≤ 200°C
T2	≤ 230°C


SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

MODEL NUMBERING SYSTEM FOR ATEX APPROVED SYSTEMS - SEE SHEET 3.
 MODEL NUMBERING SYSTEM FOR SIL ATEX APPROVED SYSTEMS - SEE SHEET 7.


- NOTES: 1. SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE
1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. THE PARTIALLY INSULATED PROBE SHALL BE INSTALLED IN SUCH A WAY THAT IGNITION DUE TO HAZARDOUS ELECTROSTATIC CHARGES CANNOT OCCUR.
 3. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 4. USE COPPER WIRING ONLY.
 5. ASSOCIATED APPARATUS MUST NOT USE OR GENERATE MORE THAN 250 VOLTS.
 6. NO REVISIONS TO THIS DOCUMENT WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED		9	8-18-102	SCA	8-13-18	COPYRIGHT 2018		ATEX CONTROL DRAWING FOR LINE POWERED INTELLIPOINT SERIES ZONE [0] 1 OR 2 (INTEGRAL)
PO #	by	8	10-17-105	SCA	11-28-17	AMETEK DREXELBROOK		
ENG		7	1-14-129	THP	11-4-14	SCALE NONE UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IN)		
USER		6	1-06-216	THP	2-22-07			
DE #		5	1-06-216	NOT RELEASED		DR. JHM 8-13-18		
		ISS. EDD/DSR NO.	APP'D	DATE	CK.	JEN 8-13-18	205 KEITH VALLEY RD HORSHAM, PA 19044-9986	420-0004-146-CD
						215-674-1234 FAX 215-674-2731		SHT. 1 OF 9

6.2 ATEX Control Drawings (Continued)

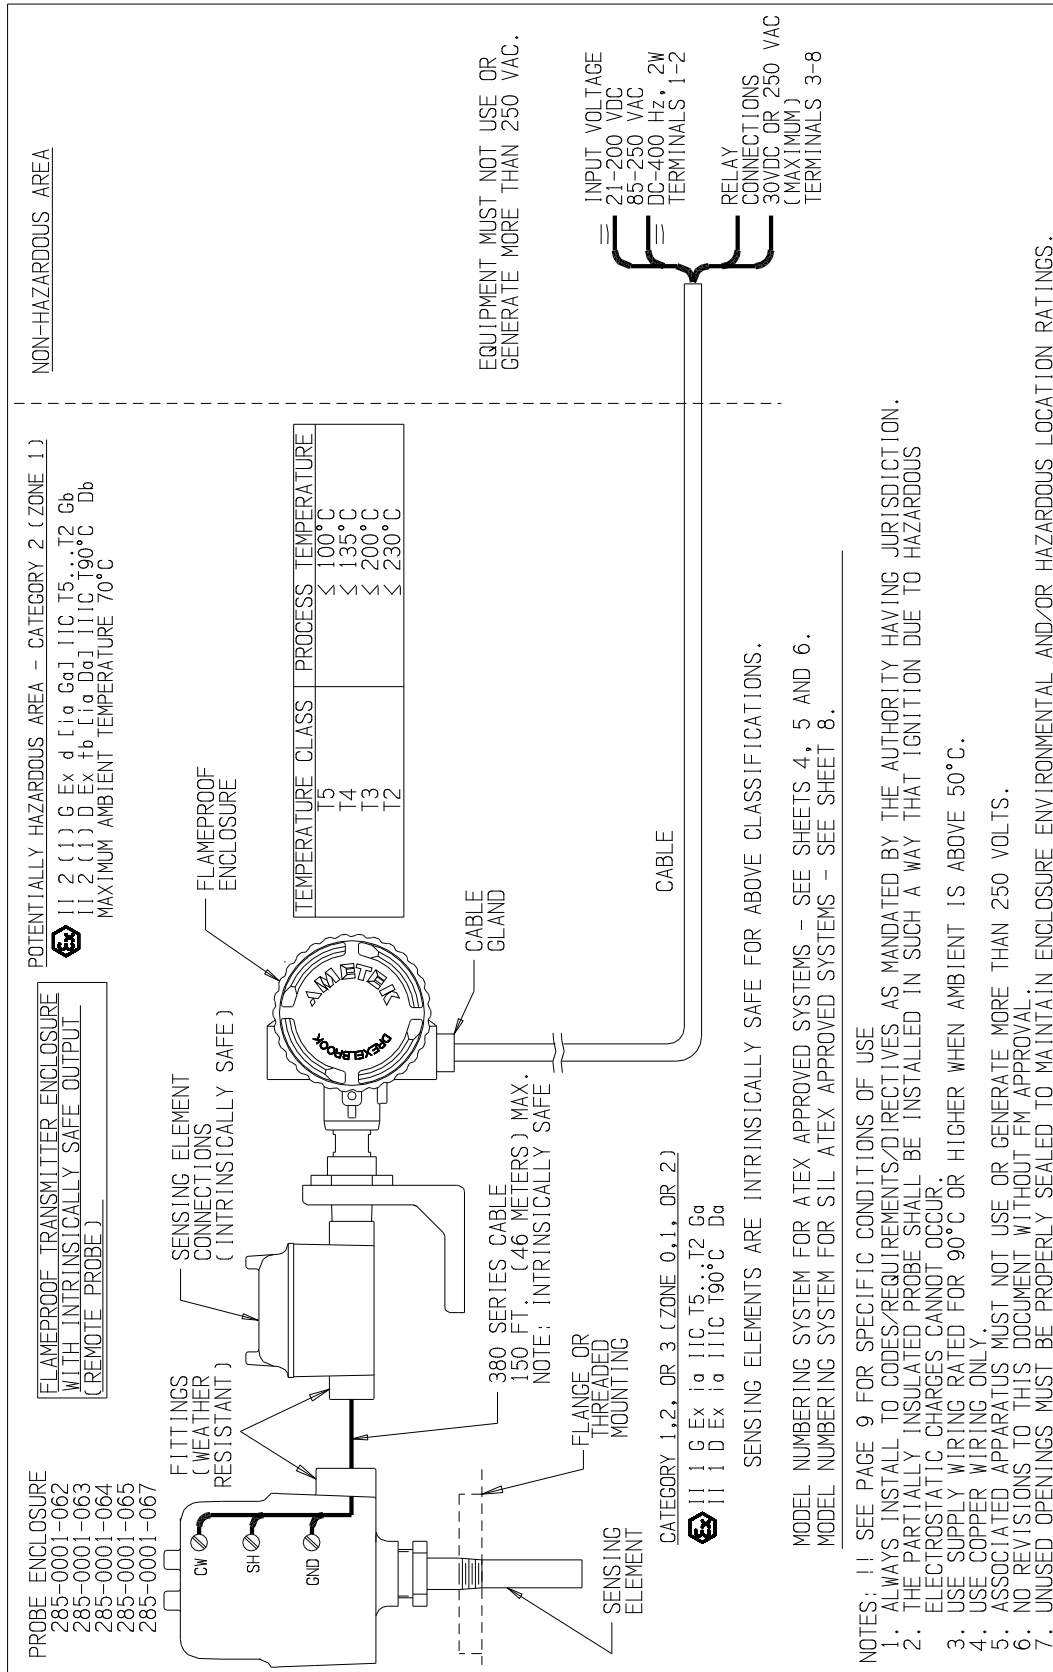

CERTIFIED		9	8-18-102	SGA	8-13-18	COPYRIGHT 2018	ATEX CONTROL DRAWING FOR LINE POWERED INTELLIPOINT SERIES ZONE [0] 1 OR 2 (REMOTE)	
PO #	by	8	10-17-105	SGA	11-28-17	AMETEK DREXELBROOK	420-0004-146-CD	
ENG USER		7	1-14-129	THP	11-4-14	SCALE NONE UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	SHT. 2 OF 9	
		6	1-06-216	THP	2-22-07		ISS.	
DE #		5	1-06-216	NOT RELEASED	DR. JHM 8-13-18		OF 9	
		ISS./EDD./DSR NO./APP'D		DATE		215-674-1234		
		CK.		JEN 8-13-18		205 KEITH VALLEY RD		
						HORSHAM, PA 19044-9986		
						FAX 215-674-2731		

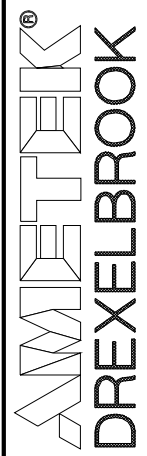

NOTES: 1. SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE
 1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. THE PARTIALLY INSULATED PROBE SHALL BE INSTALLED IN SUCH A WAY THAT IGNITION DUE TO HAZARDOUS ELECTROSTATIC CHARGES CANNOT OCCUR.
 3. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 4. USE COPPER WIRING ONLY.
 5. ASSOCIATED APPARATUS MUST NOT USE OR GENERATE MORE THAN 250 VOLTS.
 6. NO REVISIONS TO THIS DOCUMENT WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

6.2 ATEX Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	2	-	0	b	c	d	-	*	*	*	*
	a												
													a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			2										2 = ATEX APPROVAL, M20 HOUSING
						b							b = RELAYS
													1 = STANDARD RELAY
													2 = GOLD CONTACTS
							c	d					c, d = SENSING ELEMENTS: 00, 02-04, 07, 28, 91-93.
							0	0					700-1202-021 KEMA 10ATEX0009 U
								2					700-1202-024 KEMA 10ATEX0009 U
								3					700-1202-028 KEMA 10ATEX0009 U
								4					700-1202-042 KEMA 10ATEX0009 U
								7					700-1202-020 KEMA 10ATEX0009 U
							2	8					700-1202-052 KEMA 10ATEX0009 U
							9	1					700-1202-016 KEMA 10ATEX0009 U
								2					700-1202-046 KEMA 10ATEX0009 U
								3					700-1202-056 KEMA 10ATEX0009 U

ATEX APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 3 OF 9
 420-0004-146-CD ISS. 9

6.2 ATEX Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	2	-	b	c	d	e	-	*	*	*	*
	a												a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			2										2 = ATEX APPROVAL, M20 HOUSING
					b								b = 1-9, A-K CABLE LENGTHS
						c							c = RELAYS
													1 = STANDARD RELAY
													2 = GOLD CONTACTS
							d	e					d, e = SENSING ELEMENTS: 00, 02-04, 06, 07, 09-22, 24-28,
													31-40, 50-53, 55, 60-62, 64, 66, 72, 73, 80-83, 85, 90-94, or ZZ.
							0	0					700-1202-001 KEMA 10ATEX0009 U
								2					700-1202-014 KEMA 10ATEX0009 U
								3					700-1202-018 KEMA 10ATEX0009 U
								4					700-1202-041 KEMA 10ATEX0009 U
								6					700-1202-031
								7					700-1202-010 KEMA 10ATEX0009 U
								9					700-1202-033
							1	0					700-0001-018
								1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
							2	0					700-0209-002
								1					700-0202-043 (HAST-C)
								2					700-0202-044
								4					700-0005-285
								5					700-0005-285 (HAST-C)
								6					700-0220-001
								7					700-0221-002
								8					700-1202-051 KEMA 10ATEX0009 U

SENSING ELEMENT LIST
CONTINUED ON NEXT PAGE

ATEX APPROVED
REMOTE, LINE POWERED, INTELLIPOINT
MODEL NUMBERING SYSTEM
SHT 4 OF 9
420-0004-146-CD ISS. 9

6.2 ATEX Control Drawings (Continued)

												COLUMNS 9 AND UP, DO NOT AFFECT SAFETY									
1	2	3	4	-	5	6	7	8	-	9	10	11	12								
R	a	L	2	-	b	c	d	e	-	*	*	*	*								
														SENSING ELEMENTS: CONTINUED...							
								3	1					700-0029-001							
									2					700-0029-002							
									3					700-0029-003							
									4					700-0029-004							
									5					700-0029-005							
									6					700-0029-102							
									7					700-0029-103							
									8					700-0029-104							
									9					700-0029-105							
							4	0						700-0029-106							
							5	0						700-0207-001							
								1						700-0207-002							
								2						700-0207-003							
								3						700-0207-004							
								5						700-0207-006							
							6	0						700-0204-038							
								1						700-0204-002							
								2						700-0204-048							
								4						700-0204-024							
								6						700-0204-022							
								7	2					700-0201-027							
								3						700-0201-028							
								8	0					700-4200-020							
								1						700-4200-030							
								2						700-4200-040							
								3						700-4200-060							
								5						700-9000-494							
								9	0					700-0201-059							
								1						700-1202-015							KEMA 10ATEX0009 U
								2						700-1202-045							KEMA 10ATEX0009 U
								3						700-1202-055							KEMA 10ATEX0009 U
								4						700-0209-024							
							Z	Z						OTHER SENSING ELEMENTS							
ATEX APPROVED REMOTE, LINE POWERED, INTELLIPOINT MODEL NUMBERING SYSTEM SHT 5 OF 9 420-0004-146-CD ISS. 9																					

6.2 ATEX Control Drawings (Continued)

MODEL NUMBERS OF APPROVED INTRINSICALLY SAFE SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERATURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1 μ F.
3. MAXIMUM INSERTION LENGTH **RIGID SENSOR** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH **FLEXIBLE SENSOR** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

!! SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE

ATEX APPROVED
ADDITIONAL INTRINSICALLY
SAFE SENSING ELEMENTS

SHT 6 OF 9
420-0004-146-CD ISS.9

6.2 ATEX Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	7	8	9	10	-	11	12	13	14	
S	a	R	b	L	2	-	0	c	d	e	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS:
															N = 2 pF AUTO-CAL
															H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
															L = 2 pF FIXED
															T = 10 pF AUTO-CAL
															V = 10 pF FIXED
															P = 0.5 pF FIXED (HIGH SENSITIVITY)
					2										2 = ATEX APPROVAL, M20 HOUSING
								c							c = RELAYS
															1 = STANDARD RELAY
															2 = GOLD CONTACTS
									d	e					d, e = SENSING ELEMENTS: 00, 02, 04, 07, 28, 91-93.
									0	0					700-1202-021 KEMA 10ATEX0009 U
										2					700-1202-024 KEMA 10ATEX0009 U
										4					700-1202-042 KEMA 10ATEX0009 U
										7					700-1202-020 KEMA 10ATEX0009 U
								2	8						700-1202-052 KEMA 10ATEX0009 U
								9	1						700-1202-016 KEMA 10ATEX0009 U
									2						700-1202-046 KEMA 10ATEX0009 U
									3						700-1202-056 KEMA 10ATEX0009 U

SIL, ATEX APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 7 OF 9
 420-0004-146-CD ISS. 9

6.2 ATEX Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	
S	a	R	b	L	2	c	d	e	f	*	*	*	*	
	a												a = 2 SIL LEVEL 2	
			b										b = MEASUREMENT OPTIONS:	
													N = 2 pF AUTO-CAL	
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)	
													L = 2 pF FIXED	
													T = 10 pF AUTO-CAL	
													V = 10 pF FIXED	
													P = 0.5 pF FIXED (HIGH SENSITIVITY)	
					2								2 = ATEX APPROVAL, M20 HOUSING	
						c							d = 1-9, A-K CABLE LENGTHS	
							d						e = RELAYS	
													1 = STANDARD RELAY	
													2 = GOLD CONTACTS	
								e	f				e, f = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-21, 24-28,	
													60-62, 64, 66, 72, 73, 85, 90-94.	
								0	0				700-1202-001 KEMA 10ATEX0009 U	
									2				700-1202-014 KEMA 10ATEX0009 U	
									4				700-1202-041 KEMA 10ATEX0009 U	
									6				700-1202-031	
									7				700-1202-010 KEMA 10ATEX0009 U	
									9				700-1202-033	
								1	1				700-0201-005	
									2				700-0201-005 (HAST C)	
									3				700-0201-019	
									4				700-0202-002	
									5				700-0202-043	
									6				700-0002-360	
									7				700-0202-029	
									8				700-0001-022	
									9				700-0002-023	
								2	0				700-0209-002	
									1				700-0202-043 (HAST-C)	
									4				700-0005-285	
									5				700-0005-285 (HAST-C)	
									6				700-0220-001	
									7				700-0221-002	
									8				700-1202-051 KEMA 10ATEX0009 U	
								6	0				700-0204-038	
									1				700-0204-002	
									2				700-0204-048	
									4				700-0204-024	
									6				700-0204-022	
								7	2				700-0201-027	
									3				700-0201-028	
								8	5				700-9000-494	
								9	0				700-0201-059	
									1				700-1202-015 KEMA 10ATEX0009 U	
									2				700-1202-045 KEMA 10ATEX0009 U	
									3				700-1202-055 KEMA 10ATEX0009 U	
									4				700-0209-024	

SIL, ATEX APPROVED
 REMOTE, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 8 OF 9
 420-0004-146-CD ISS. 9

6.2 ATEX Control Drawings (Continued)

SPECIFIC CONDITIONS OF USE

- 1. The equipment shall not be applied in an explosive dust atmosphere where high electrostatic charging processes are present that could result in propagating brush discharges.
See CLC/TR 60079-32-1 for additional guidance.*
- 2. Consult the manufacturer if dimensional information on the flameproof joints is necessary.*

SPECIFIC CONDITIONS OF USE
SHT 9 OF 9
420-0004-146-CD ISS. 9

6.3 CE Mark Declaration of Conformity



205 Keith Valley Road, Horsham, PA 19044
 Telephone: 215-674-1234 Fax: 215-674-2731
 www.ametek.com www.drexelbrook.com



420-0004-176		Sht. of	APP'D BY
ISSUE	EDO NO.	1 1	SGA DATE
6	9-18-102	SGA	9-13-18
7	10-18-106	SGA	11-2-18

Declaration of Conformity

**AMETEK DREXELBROOK
 205 KEITH VALLEY ROAD
 HORSHAM, PENNSYLVANIA
 USA, 19044**

We declare under our sole responsibility that the product **IntelliPoint Point Level Measurement Systems Model Number RXLX Series** which this declaration relates is in conformity with the following standards and entitled to carry the CE Mark:

Product Type: Measurement, Control Equipment and Laboratory Use

Following the provisions of 2014/30/EU Directive,

Conforms to the requirements of:

EN 61326-1-:2013	Clause 7.2 Emissions Class A and Class B
EN 61326-1-:2013	Table 2 Immunity Group 1, Class B Industrial Area

Following the provisions of 2014/34/EU ATEX Directive, Harmonized Standards

Conforms to the requirements of:

EN 60079-0:2012+A11:2013, EN 60079-1:2014, EN 60079-11:2012, EN 60079-26:2015, EN 60079-31:2013, EN 60529+A1:2000+A2:2013


QAN Notified Body Number 2460

EC-Type Examination Certificate Number FM14ATEX0049
 FM Approvals Ltd. 1 Windsor Dials, Windsor, Berkshire, UK SL4 1RS

Steven G. Arnold
 Quality Assurance & Product Safety Manager

Issue Date:

6.4 IECEx Control Drawings

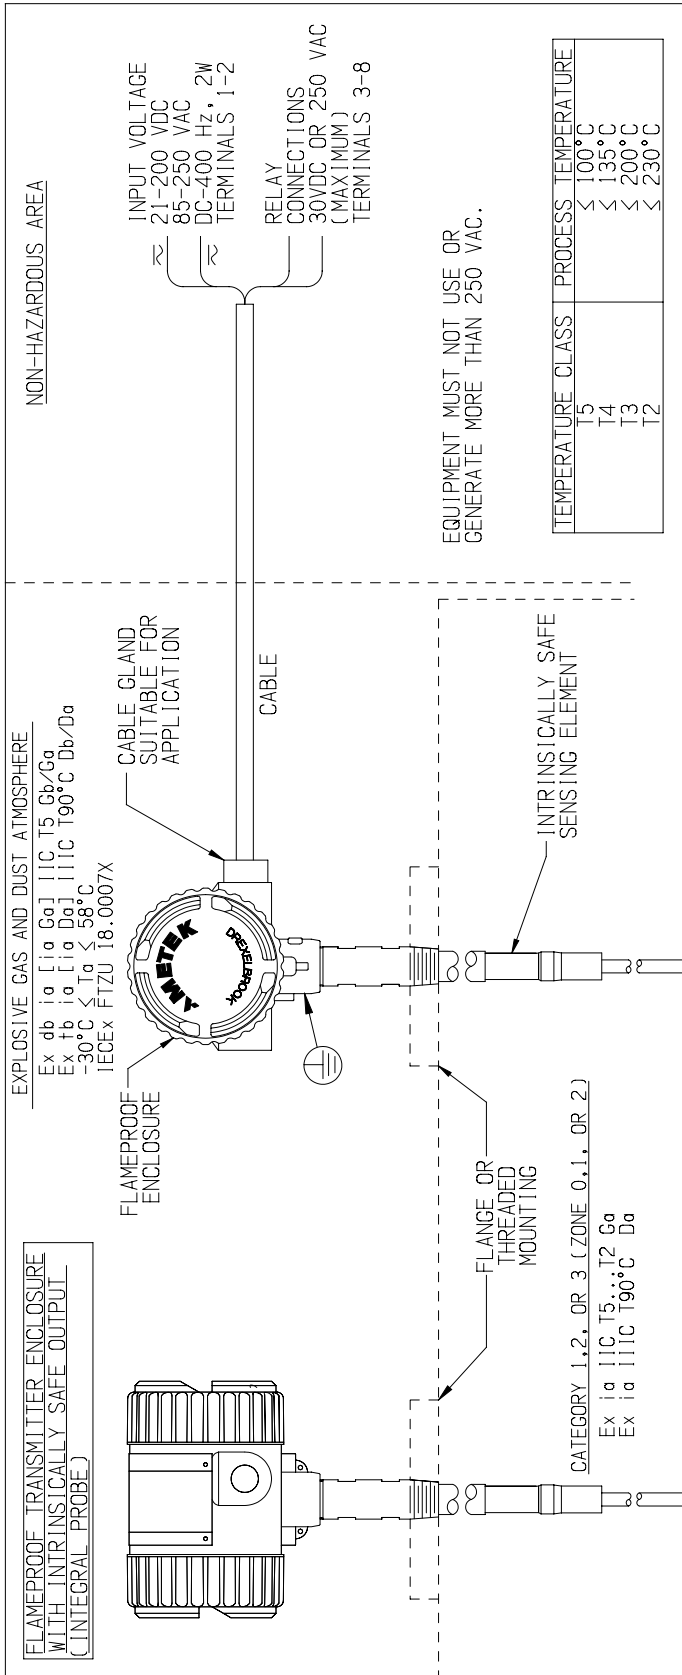


SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.


MODEL NUMBERING SYSTEM FOR IECEx APPROVED SYSTEMS - SEE SHEET 3.
 MODEL NUMBERING SYSTEM FOR SIL IECEx APPROVED SYSTEMS - SEE SHEET 7.

- NOTES: **⚠** SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE.
1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 3. USE COPPER WIRING ONLY.
 4. NO REVISIONS TO THIS DOCUMENT WITHOUT NOTIFIED BODY APPROVAL.
 5. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by _____	COPYRIGHT 2018	AMETEK DREXELBROOK
PO #		SCALE	NONE
ENG		UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
USER		DR.	JEN 8-27-18
DE #		ISS. EDD/DSR NO. 1, APP'D	DATE
		1	7-18-110 SGA 8-27-18
		ISS.	420-0004-563-CD
		SHT. 1	OF 9
		205 KEITH VALLEY RD HORSHAM, PA 19044-9886	
		215-674-1234 FAX 215-674-2731	
		IECEx CONTROL DRAWING FOR LINE POWERED INTELLIPOINT SERIES ZONE 01 1 OR 2 (INTEGRAL)	

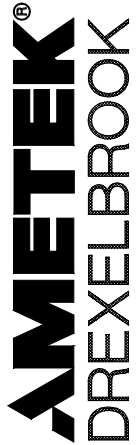

6.4 IECEx Control Drawings (Continued)

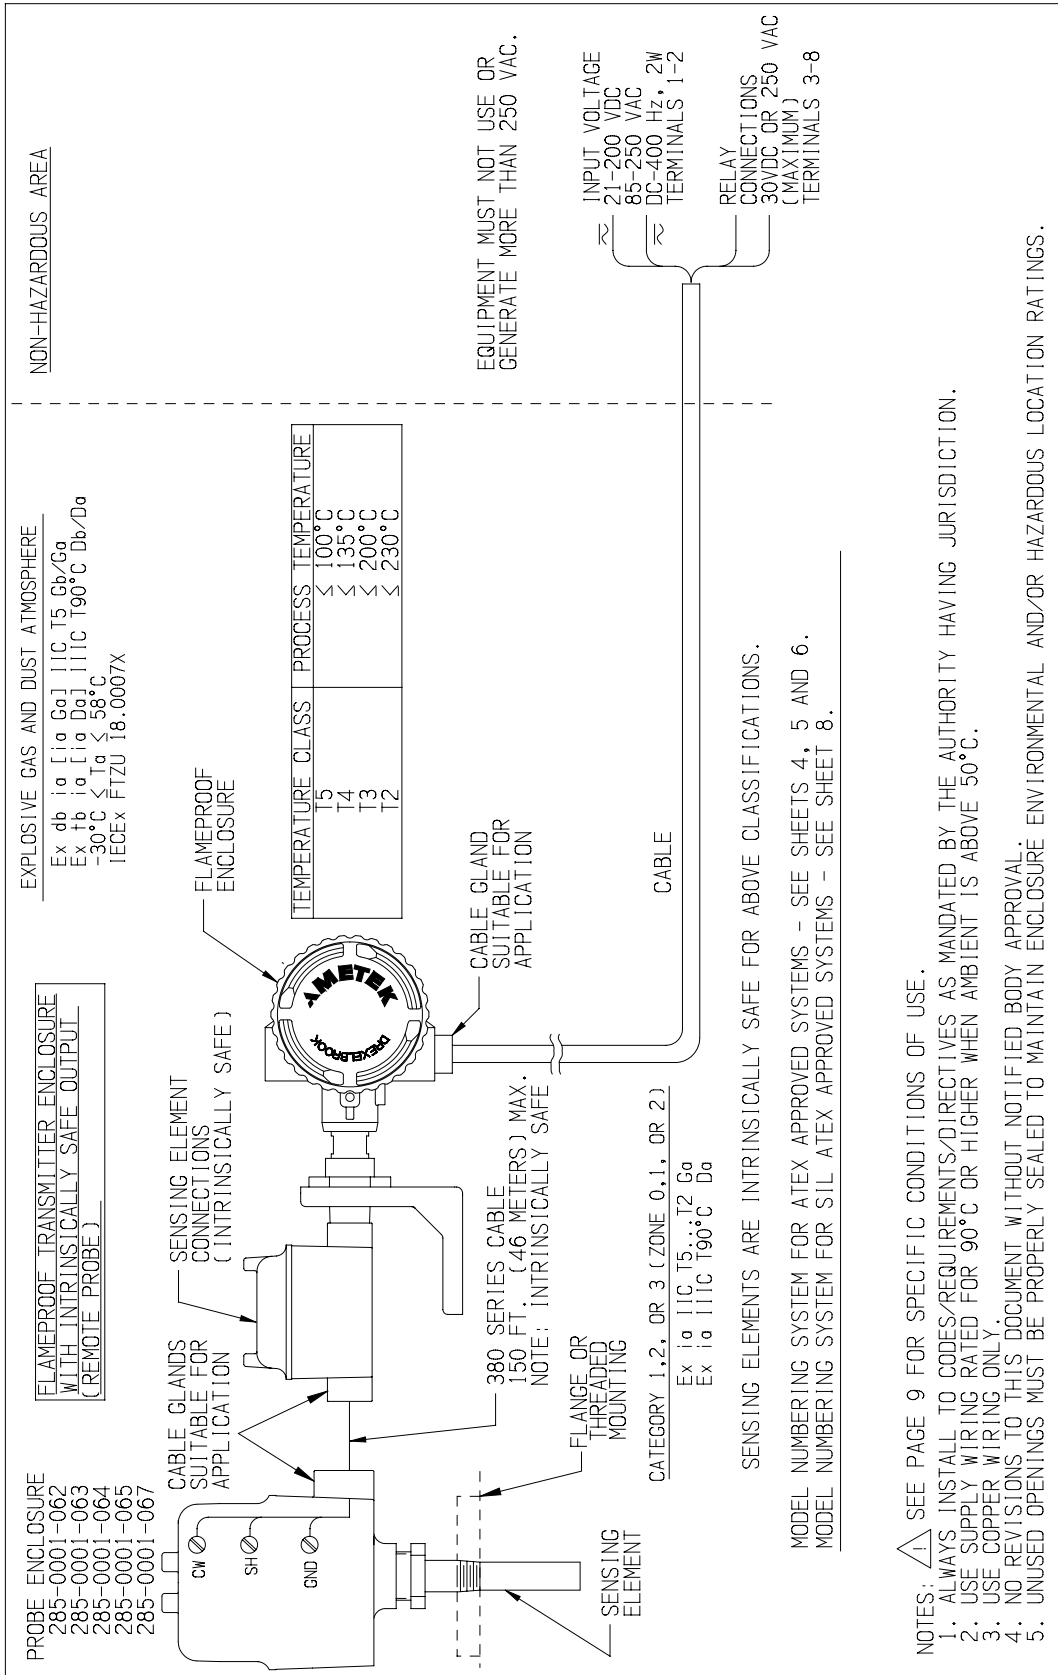

NOTES: **1** SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE.
 1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 3. USE COPPER WIRING ONLY.
 4. NO REVISIONS TO THIS DOCUMENT WITHOUT NOTIFIED BODY APPROVAL.
 5. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	COPYRIGHT 2018	AMETEK DREXELBROOK
PO #		SCALE NONE	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)
ENG		1	7-18-110 SGA 8-27-18
USER		DR.	JEN 8-27-18
ISS. EDD/DSR NO.1, APP'D	DATE	CK.	TDH 8-27-18
DE #		ISS.	420-0004-563-CD
		SHT.	2
		OF	9
		1	

IECEx CONTROL DRAWING FOR LINE POWERED INTELLIPOINT SERIES ZONE [0] 1 OR 2 (REMOTE)

215-674-1234
 205 KEITH VALLEY RD
 HORSHAM, PA 19044-9886
 FAX 215-674-2731

AMETEK®
DREXELBROOK

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	b	-	0	c	d	e	-	*	*	*	*
	a												a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b										b = OPTIONS
													2 = IECEx APPROVAL, M20 HOUSING
						c							c = RELAYS
													1 = STANDARD RELAY
													2 = GOLD CONTACTS
							d						d = 0, 2, 9, SENSING ELEMENTS
								e					e = 0-4, 7, 8 SENSING ELEMENTS
							0	0					700-1202-021
								2					700-1202-024
								3					700-1202-028
								4					700-1202-042
								7					700-1202-020
							2	8					700-1202-052
							9	1					700-1202-016
								2					700-1202-046
								3					700-1202-056

IECEx APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 3 OF 9
 420-0004-563-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	b	-	c	d	e	f	-	*	*	*	*
	a												
													a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b										b = OPTIONS
													2 = IECEx APPROVAL, M20 HOUSING
				c									c = 1-9, A-K CABLE LENGTHS
					d								d = RELAYS
													1 = STANDARD RELAY
													2 = GOLD CONTACTS
							e						e = 0-9, Z SENSING ELEMENTS
								f					f = 0-9, Z SENSING ELEMENTS
							0	0					700-1202-001
								2					700-1202-014
								3					700-1202-018
								4					700-1202-041
								6					700-1202-031
								7					700-1202-010
								9					700-1202-033
						1	0						700-0001-018
							1						700-0201-005
							2						700-0201-005 (HAST C)
							3						700-0201-019
							4						700-0202-002
							5						700-0202-043
							6						700-0002-360
							7						700-0202-029
							8						700-0001-022
							9						700-0002-023
						2	0						700-0209-002
							1						700-0202-043 (HAST-C)
							2						700-0202-044
							4						700-0005-285
							5						700-0005-285 (HAST-C)
							6						700-0220-001
							7						700-0221-002
							8						700-1202-051
SENSING ELEMENT LIST CONTINUED ON NEXT PAGE								IECEx APPROVED REMOTE, LINE POWERED, INTELLIPOINT MODEL NUMBERING SYSTEM SHT 4 OF 9 420-0004-563-CD ISS. 1					

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	L	b	-	c	d	e	f	-	*	*	*	*
							3	1					
								2					
								3					
								4					
								5					
								6					
								7					
								8					
								9					
							4	0					
							5	0					
								1					
								2					
								3					
								5					
							6	0					
								1					
								2					
								4					
								6					
							7	2					
								3					
								8					
								1					
								2					
								3					
								5					
							9	0					
								1					
								2					
								3					
								4					
							Z	Z					

OTHER SENSING ELEMENTS

IECEx APPROVED
 REMOTE, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 5 OF 9
 420-0004-563-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

MODEL NUMBERS OF APPROVED INTRINSICALLY SAFE SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERATURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1µF.
3. MAXIMUM INSERTION LENGTH **RIGID SENSOR** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH **FLEXIBLE SENSOR** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

IECEx APPROVED
ADDITIONAL INTRINSICALLY
SAFE SENSING ELEMENTS

SHT 6 OF 9
420-0004-563-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY						
1	2	3	4	5	6	-	7	8	9	10	-	11	12	13	14	
S	a	R	b	L	c	-	0	d	e	f	-	*	*	*	*	
	a															a = 2 SIL LEVEL 2
			b													b = MEASUREMENT OPTIONS:
																N = 2 pF AUTO-CAL
																H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
																L = 2 pF FIXED
																T = 10 pF AUTO-CAL
																V = 10 pF FIXED
																P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c											c = OPTIONS
																2 = IECEx APPROVAL, M20 HOUSING
								d								d = RELAYS
																1 = STANDARD RELAY
																2 = GOLD CONTACTS
									e							e = 0, 2, 9, SENSING ELEMENTS
									f							f = 0-4, 7, 8 SENSING ELEMENTS
								0	0							700-1202-021
									2							700-1202-024
									4							700-1202-042
									7							700-1202-020
								2	8							700-1202-052
								9	1							700-1202-016
									2							700-1202-046
									3							700-1202-056

SIL, IECEx APPROVED
 INTEGRAL, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 7 OF 9
 420-0004-563-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	-	7	8	9	10	-	11	12	13	14
S	a	R	b	L	c	-	d	e	f	g	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS:
															N = 2 pF AUTO-CAL
															H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
															L = 2 pF FIXED
															T = 10 pF AUTO-CAL
															V = 10 pF FIXED
															P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c										c = OPTIONS
															2 = IECEx APPROVAL, M20 HOUSING
							d								d = 1-9, A-K CABLE LENGTHS
								e							e = RELAYS
															1 = STANDARD RELAY
															2 = GOLD CONTACTS
									f						f = 0, 1, 2, 6, 7, 8, 9 SENSING ELEMENTS
										g					g = 0-9 SENSING ELEMENTS
									0	0					700-1202-001
										2					700-1202-014
										4					700-1202-041
										6					700-1202-031
										7					700-1202-010
										9					700-1202-033
									1	1					700-0201-005
										2					700-0201-005 (HAST C)
										3					700-0201-019
										4					700-0202-002
										5					700-0202-043
										6					700-0002-360
										7					700-0202-029
										8					700-0001-022
										9					700-0002-023
									2	0					700-0209-002
										1					700-0202-043 (HAST-C)
										4					700-0005-285
										5					700-0005-285 (HAST-C)
										6					700-0220-001
										7					700-0221-002
										8					700-1202-051
									6	0					700-0204-038
										1					700-0204-002
										2					700-0204-048
										4					700-0204-024
										6					700-0204-022
									7	2					700-0201-027
										3					700-0201-028
									8	5					700-9000-494
									9	0					700-0201-059
										1					700-1202-015
										2					700-1202-045
										3					700-1202-055
										4					700-0209-024

SIL, IECEx APPROVED
 REMOTE, LINE POWERED, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 8 OF 9
 420-0004-563-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

SPECIFIC CONDITIONS OF USE:

- 1 THE EQUIPMENT SHALL NOT BE APPLIED IN AN EXPLOSIVE DUST ATMOSPHERE WHERE HIGH ELECTROSTATIC CHARGING PROCESSES ARE PRESENT THAT COULD RESULT IN PROPAGATING BRUSH DISCHARGES.
- 2 CONSULT THE MANUFACTURER IF DIMENSIONAL INFORMATION ON THE FLAMEPROOF JOINTS IS NECESSARY.
- 3 AMBIENT TEMPERATURE RANGE:
-30°C TO +58°C FOR RXLX/SXRXTX INTELLIPOINT RF LEVEL SYSTEM
-30°C TO +70°C FOR RXTX/SXRXTX INTELLIPOINT RF TWO-WIRE POINT LEVEL SYSTEM

IECEx APPROVED
LINE POWERED, INTELLIPOINT
SPECIFIC CONDITIONS OF USE

SHT 9 OF 9
420-0004-563-CD ISS. 1

6.5 Mounting and Wiring for Spark Protector Drawings

NO. 377-0001-019

SHT 1 OF 2

TYPICAL INSTALLATION OF SPARK PROTECTORS

FIGURE -A- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO FLEXIBLE 2-TERMINAL ELEMENTS: 700-0005-XXX.

FIGURE -B- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO RIGID 2-TERMINAL SENSING ELEMENTS 700-0001-XXX & 700-0002-XXX.

FIGURE -C- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO RIGID 3-TERMINAL SENSING ELEMENTS: 700-0200-XXX & 700-0202-017.

FIGURE -D- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE ON FLEXIBLE 3-TERMINAL SENSING ELEMENT 700-0205-XXX.

FOR HI. TEMP APPLICATIONS REFER TO 377-0001-016-CD.

APPROVED DRAWING... CHANGES TO THIS DRAWING REQUIRE AGENCY APPROVAL PER 440-0015-003
 FM CSA KEMA
 _____ 420-0004-017

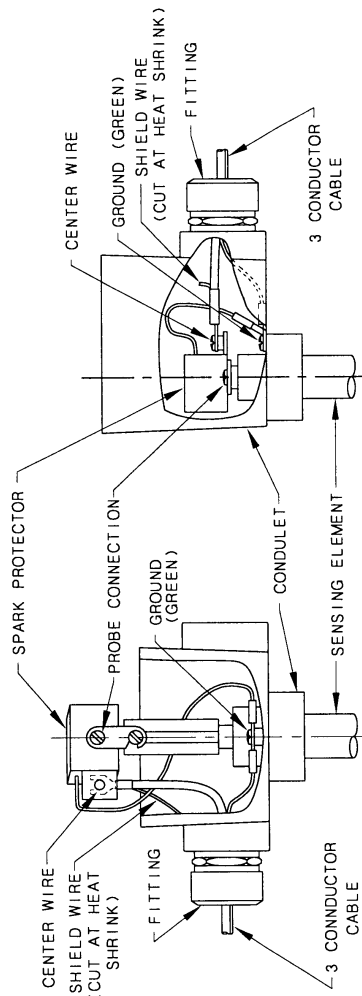


FIGURE -A-

FIGURE -B-

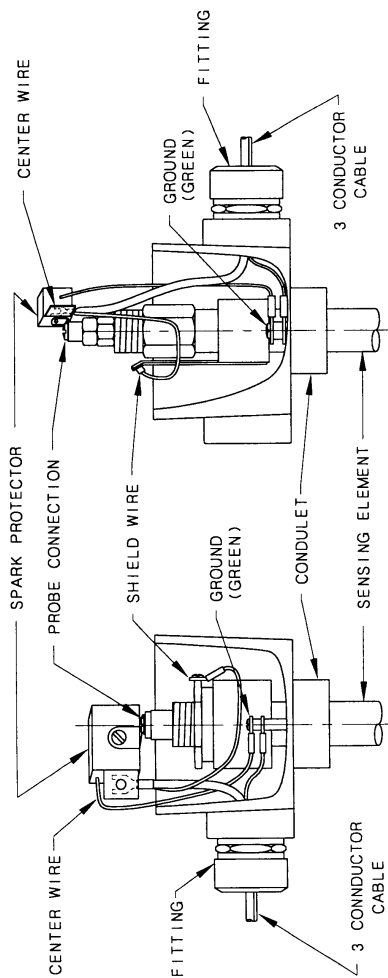


FIGURE -D-

FIGURE -C-

CERTIFIED	by _____	DATE	ISS. EDO/DSR NO.	APP'D
PO #	2-04-336	5-25-93	8-31-92	
ENG	JET	5-25-93	8-31-92	
USER				
DE #				

AMETEK®
DREXELBROOK

205 KEITH VALLEY RD
 HORSHAM, PA. 19044-9886

215-674-1234
 FAX 215-674-2731

COPYRIGHT 2004
 AMETEK DREXELBROOK

SCALE NONE
 UNLESS OTHERWISE STATED
 ALL DIMENSIONS IN INCHES (IN)

DR. CDW
 CK. JJ 2-3-04

377-0001-019 HEAVY DUTY SPARK PROTECTOR CUSTOMER CONNECTION MOUNTING & WIRING

377-0001-019-CD

SHT. 1 OF 2

6.5 Mounting and Wiring for Spark Protector (Continued)

NO. 377-0001-019

SHT 2 OF 2

TYPICAL INSTALLATION OF SPARK PROTECTORS

FIGURE -E- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE IN PARALLEL WITH REMOTE VERIFY SWITCH.

FOR HI .TEMP APPLICATIONS REFER TO 377-0001-016-CD.


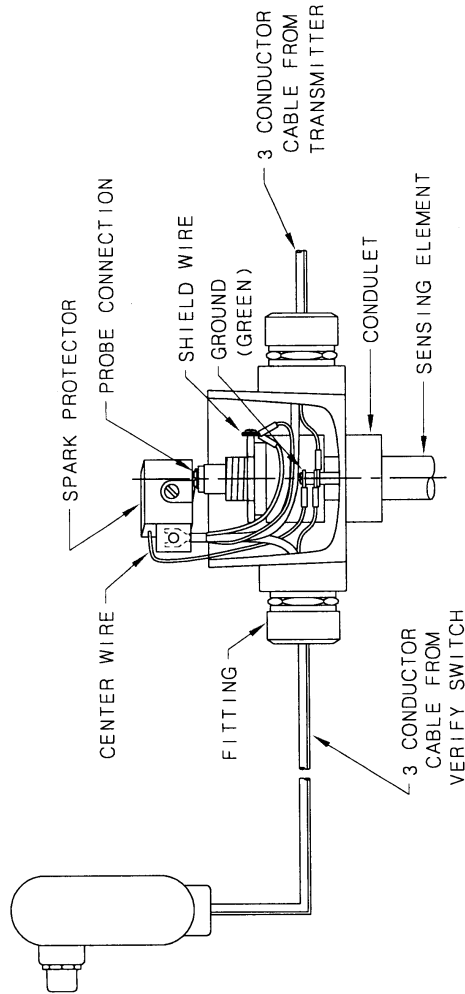


FIGURE -E-

CERTIFIED		by _____		COPYRIGHT 2004		377-0001-019 HEAVY DUTY SPARK PROTECTOR CUSTOMER CONNECTION MOUNTING & WIRING	
PO #	2-04-336	DATE	8-31-92	DR.	CDW	ISS. OF 2	
ENG	JET	DATE	5-25-93	DR.	CDW	SHT. 2 OF 2	
USER	MPG	DATE	8-31-92	DR.	CDW	ISS. OF 5	
ISS. #	8-92-83	APP'D	MPG	DATE	8-31-92	377-0001-019-CD	
DE #		APP'D	MPG	DATE	8-31-92	SHT. 2 OF 2	
				CK. JTS 3.3.c/		215-674-1234	
				HORSHAM, PA 19044-9986		FAX 215-674-2731	
				205 KEITH VALLEY RD		METEKS	
				HORSHAM, PA 19044-9986		DREXELBROOK	

6.5 Mounting and Wiring for Spark Protector (Continued)

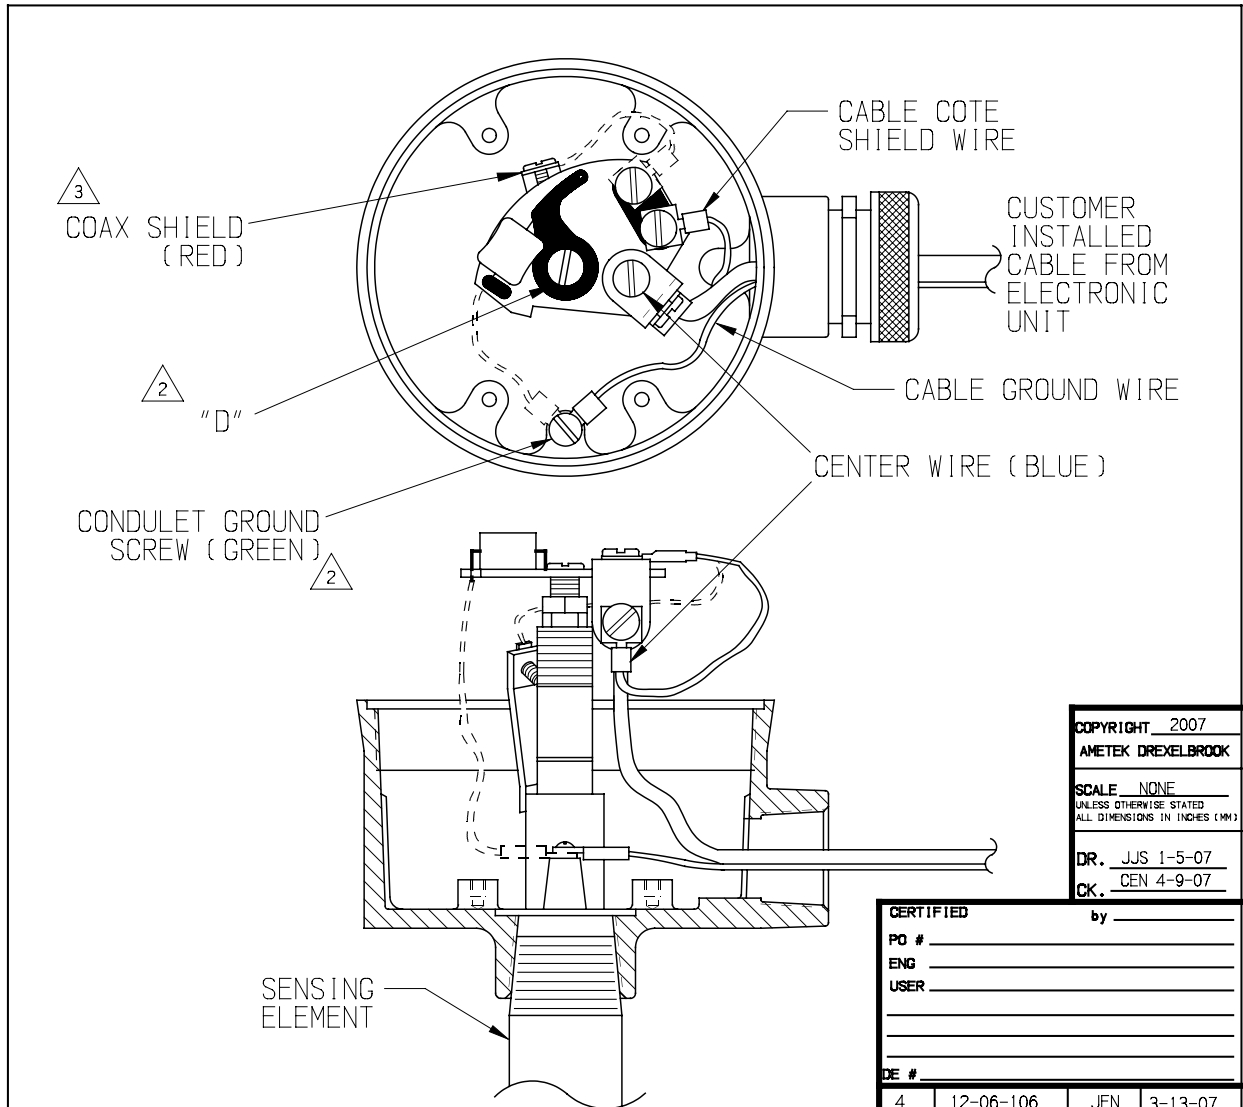

NOTES:

1. SPARK PROTECTOR IS SHOWN ON A 303-0029-10X PROBE. IT CAN BE INSTALLED ON OTHER COTE SHIELD PROBES IN THE SAME MANNER.
2. SPARK PROTECTOR IS MOUNTED IN CONDULET WITH LAND SIDE UP. CENTER ROD OF SENSING ELEMENT CONNECTION IS THROUGH HOLE "D". RING LUG IS ATTACHED TO GROUND SCREW (GREEN) BY D.E.
3. D.E. INSTALLED JUMPER WIRE 353-0002-047 TO JUMPER SHIELD OF PROBE TO SPARK PROTECTOR. RING LUG END GOES TO THE PROBE, SPADE LUG END GOES TO SPARK PROTECTOR PCB.
4. TEMPERATURE RANGE: -55°C TO +125°C.
5. ALL DASHED WIRES ARE FACTORY INSTALLED.

COPYRIGHT 2007
 AMETEK DREXELBROOK
 SCALE NONE
 UNLESS OTHERWISE STATED
 ALL DIMENSIONS IN INCHES (MM)
 DR. JJS 1-5-07
 CK. CEN 4-9-07

CERTIFIED by _____
 PO # _____
 ENG _____
 USER _____
 DE # _____

4	12-06-106	JEN	3-13-07
3	1-01-304	JET	5-18-01
2	6-99-246	DL	8-16-99
1	4-99-303	JET	6-10-99
A	1-80-221	---	2-21-80

ISS.	EDO/DSR NO.	APP'D	DATE
------	-------------	-------	------

AMETEK®
DREXELBROOK
 205 KEITH VALLEY RD HORSHAM, PA 19044-9986 215-674-1234 FAX 215-674-2731

MOUNTING AND WIRING FOR
 SPARK PROTECTOR
 377-0001-016

377-0001-016-CD SH. 1 OF 4 ISS. 1 OF 4

377-0001-016-CD SH. 1 OF 4

6.6 Adding a Padded Capacitor

ADDING A PADDED CAPACITOR:
 THE TUNING RANGE OF EACH POINT LEVEL SWITCH IS LIMITED. LONG INSERTION LENGTH SENSING ELEMENTS OR SENSING ELEMENTS MOUNTED IN PIPES OR NEAR METAL OBJECTS MAY GENERATE ENOUGH STANDING CAPACITANCE TO EXCEED THE TUNING RANGE OF THE SWITCH.

THE ADDITION OF AN EXTERNAL PADDING CAPACITOR WILL INCREASE THE TUNING RANGE OF THE UNIT. TUNING RANGES AND EXAMPLES OF INCREASES CAN BE FOUND FOR EACH TYPE OF POINT LEVEL ELECTRONIC SWITCH ON SHEET THREE.

WHEN A PADDING CAPACITOR IS REQUIRED, AN NPO CAPACITOR SHOULD BE ADDED TO THE PADDING TERMINALS AS INDICATED ON SHEET 2. ADDITIONAL PADS CAN BE ADDED IN PARALLEL UNIT A SATISFACTORY TUNING RANGE IS REACHED. IF A TUNING RANGE CANNOT BE REACHED, OR, IF PADDING IS IN EXCESS OF THE MAXIMUM RECOMMENDED TUNING RANGE AS INDICATED IN THE TABLE ON SHEET 3, PLEASE CONTACT THE FACTORY SERVICE DEPARTMENT.

NOTE: ON SOME TRANSMITTERS, THE PAD CAPACITOR IS SOLDERED TO TURRETS. OTHER TRANSMITTERS ATTACH THE LEADS UNDER SCREWS.

NO. 330-0009-022-CD

SHEET 1 OF 3

CERTIFIED		by _____		ISS. EDD/DSR NO. APP/D		DATE		DR. JLS 9-20-13		205 KEITH VALLEY RD HORSBANK, PA 19044-9986		330-0009-022-CD		SHT. 1 OF 3		ISS. OF 3			
PO #	3	9-13-101	WS	7-6-05	8-9-01	9-23-13	7-6-05	8-9-01	9-23-13	AMETEK® DREXELBROOK		PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES		215-674-1284 FAX 215-674-2731		330-0009-022-CD		SHT. 1 OF 3	
ENG	2	6-05-243	WS	7-6-05	8-9-01	9-23-13	7-6-05	8-9-01	9-23-13	COPYRIGHT 2013 AMETEK DREXELBROOK		PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES		215-674-1284 FAX 215-674-2731		330-0009-022-CD		SHT. 1 OF 3	
USER	1	7-01-303	JET	8-9-01	8-9-01	9-23-13	7-6-05	8-9-01	9-23-13	SCALE NONE UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)		PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES		215-674-1284 FAX 215-674-2731		330-0009-022-CD		SHT. 1 OF 3	
DE #	ISS.	EDD/DSR NO.	APP/D	DATE	DR.	JLS	9-20-13	9-23-13	9-23-13	AMETEK DREXELBROOK		PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES		215-674-1284 FAX 215-674-2731		330-0009-022-CD		SHT. 1 OF 3	

6.6 Adding a Padded Capacitor (Continued)

ThePoint (TM)

INTELLIPOINT (TM)

LCS (TM) & LCT (TM)

NO. 330-0009-022-CD

SHT 2 OF 3

PAD CAPACITOR KIT
FOR POINT LEVEL SWITCHES

330-0009-022-CD SHT. 2 OF 3

AMETEK®
DREXELBROOK

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

CERTIFIED by _____

PO # _____

ENG 9-13-101

USER 6-05-243

ISS. EDD/DSR NO. APP'D DATE

COPYRIGHT, 2013
AMETEK DREXELBROOK

SCALE NONE

DATE 9-23-13

WS 7-6-05

JET 8-9-01

DR. JUS 9-20-13


CK. *[Signature]*

6.6 Adding a Padded Capacitor (Continued)

No. 330-0009-022-CD

SH. 3 OF 3

PRODUCT	SENSITIVITY	MODEL NUMBERS	UN-PADDED TUNING RANGE	PADDING RATIO	PADDING EXAMPLE	MAX RECOMMENDED TUNING RANGE
THE POINT™ LINE POWERED	HIGH	PHL, PPL, PGL	0 TO 25pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 35pF	50 TO 75pF
THE POINT™ LINE POWERED	STANDARD	PNL, PLL, PTL, PVL, PML	0 TO 60pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 70pF	120 TO 180pF
THE POINT™ TWO WIRE	HIGH	PHT, PPT, PGT	0 TO 25pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 35pF	50 TO 75pF
THE POINT™ TWO WIRE	STANDARD	PNT, PLT, PTT, PVT, PMT	0 TO 60pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 70pF	120 TO 180pF
INTELLIPOINT™ LINE POWERED AND TWO WIRE	HIGH	RHL, RPL, RGL, RHT, RPT, RGT	0 TO 25pF	4.33:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 43pF TO 69pF	50 TO 75pF
INTELLIPOINT™ LINE POWERED AND TWO WIRE	STANDARD	RNL, RLL, RTL, RVL, RML, RNT, RLT, RTT, RVT, RMT	0 TO 100pF	4.33:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 43pF TO 143pF	200 TO 300pF
LCS	HIGH	406-6020, 406-6022	0 TO 8pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 18pF	16 TO 24pF
LCS	STANDARD	406-6000, 406-6002	0 TO 90pF	3:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 30pF TO 120pF	180 TO 270pF
LCT	HIGH	406-6220, 406-6222	0 TO 8pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 18pF	16 TO 24pF
LCT	STANDARD	406-6200, 406-6202	0 TO 90pF	3:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 30pF TO 120pF	180 TO 270pF



215-674-1234
FAX 215-674-2731

205 WETHIL VALLEY RD
ROCKSPRING, PA 19044-9886

PAD CAPACITOR KIT
FOR POINT LEVEL SWITCHES

330-0009-022-CD

SH. 3 OF 3

CERTIFIED by _____

PO # _____

ENG _____

USER _____

DE # _____

COPYRIGHT 2013
AMETEK DREXELBROOK

SCALE NONE
UNLESS OTHERWISE STATED
ALL DIMENSIONS IN INCHES (MM)

DR. JJS 9-20-13
CK. JET 9-22-13

ISS. EDD/DSR NO. APP'D DATE


3 9-13-101 JWM 9-23-13

2 6-05-243 WS 7-6-05

1 7-01-303 JET 8-9-01

6.7 Dual Seal Assembly for 700 Series Sensing Elements


407500000101 DUAL SEAL ASSEMBLY FOR 700 SERIES SENSING ELEMENTS

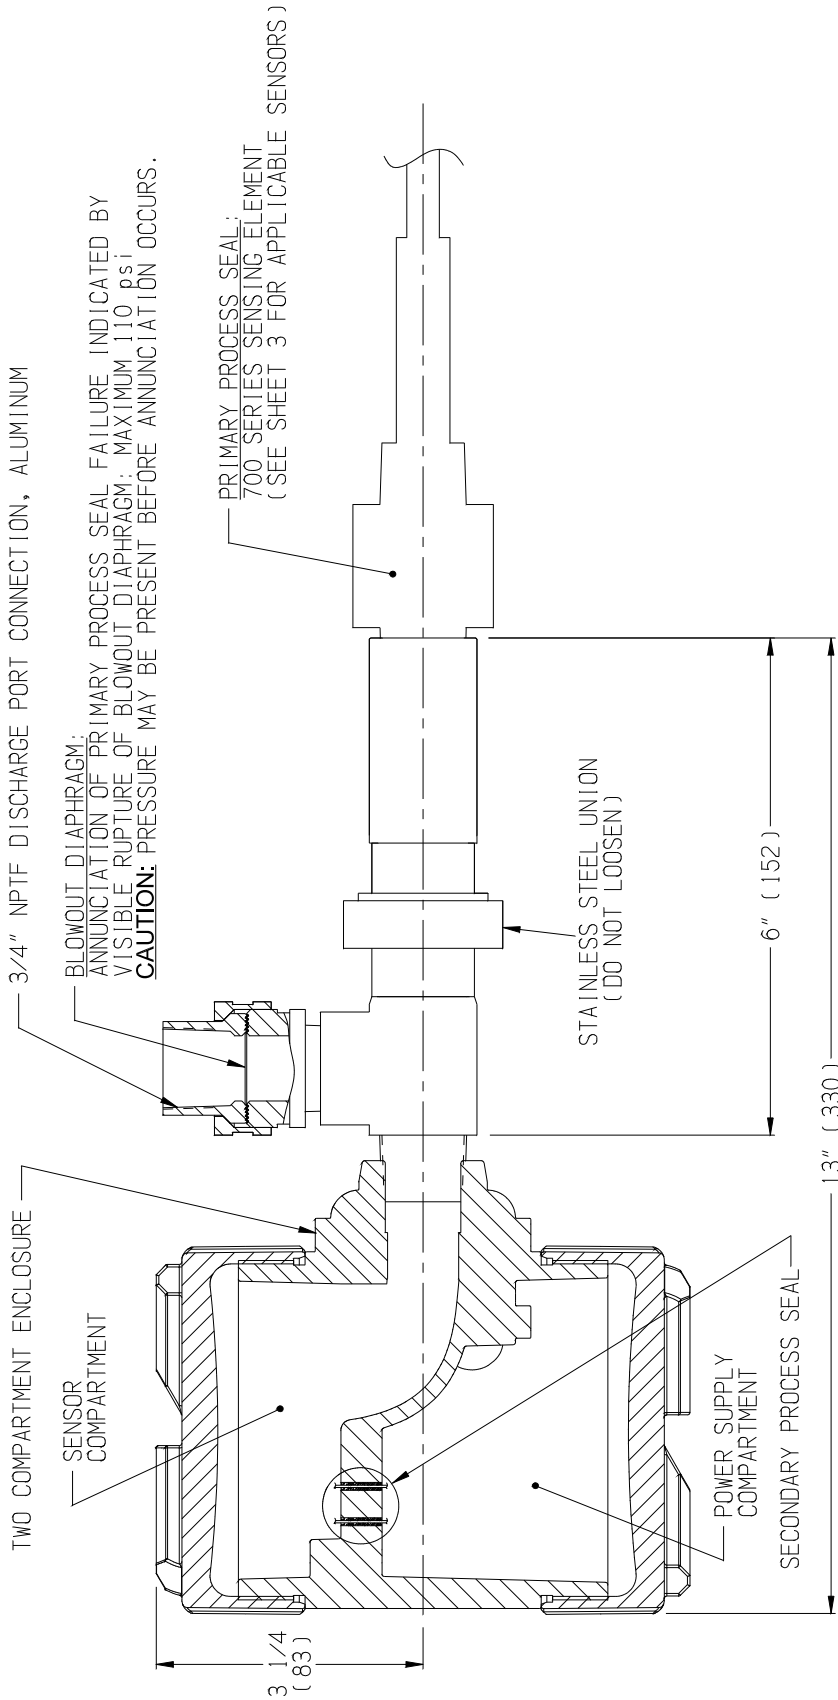

NOTES:

1. ANSI / ISA 12.27.01-2003 FM CERTIFIED "DUAL SEAL" WHEN USED WITH AMETEK DREXELBROOK 700 SERIES SENSING ELEMENTS
2. SEE SHEET 3 FOR 700 SERIES PRIMARY SEAL PROCESS WETTED MATERIALS.
3. REFER TO SENSING ELEMENT TAG FOR PROCESS TEMPERATURE AND PRESSURE RATINGS.

APPROVED	by _____	DATE	DR.	ISS. / EDO / DSR NO. / APP. / D	DATE	CHK.	DR.	ISS. / EDO / DSR NO. / APP. / D	DATE
DESIGNED									
CHECKED									
SCALE	SCALE NONE								
UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)									
COPYRIGHT	AMETEK DREXELBROOK								
DATE	3-11-15								
DR.	JEN								
CHK.	TDH								
ISS. / EDO / DSR NO. / APP. / D	2-15-111								
DATE	3-11-15								
CHK.	TDH								
DR.	JEN								
ISS. / EDO / DSR NO. / APP. / D	1-12-114								
DATE	1-20-12								
CHK.	TDH								
DR.	JEN								
ISS. / EDO / DSR NO. / APP. / D	4-08-106								
DATE	9-10-08								
CHK.	TDH								
DR.	JEN								
ISS. / EDO / DSR NO. / APP. / D	3-11-15								
DATE	3-11-15								
CHK.	TDH								
DR.	JEN								
ISS. / EDO / DSR NO. / APP. / D	285-0003-0XX-CD								
DATE	215-674-1234								
CHK.	TDH								
DR.	JEN								
ISS. / EDO / DSR NO. / APP. / D	285-0003-0XX-CD								
DATE	215-674-1234								
CHK.	TDH								
DR.	JEN								

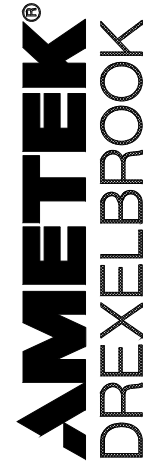


205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

CONTROL DRAWING,
DUAL SEAL ASSEMBLY
FOR USE WITH
700 SERIES SENSING ELEMENTS

285-0003-0XX-CD
SHT. 1
OF 3

6.7 Dual Seal Assembly (Continued)


285-0003-02X DUAL SEAL CONFIGURATION FOR SINGLE COMPARTMENT ENCLOSURE

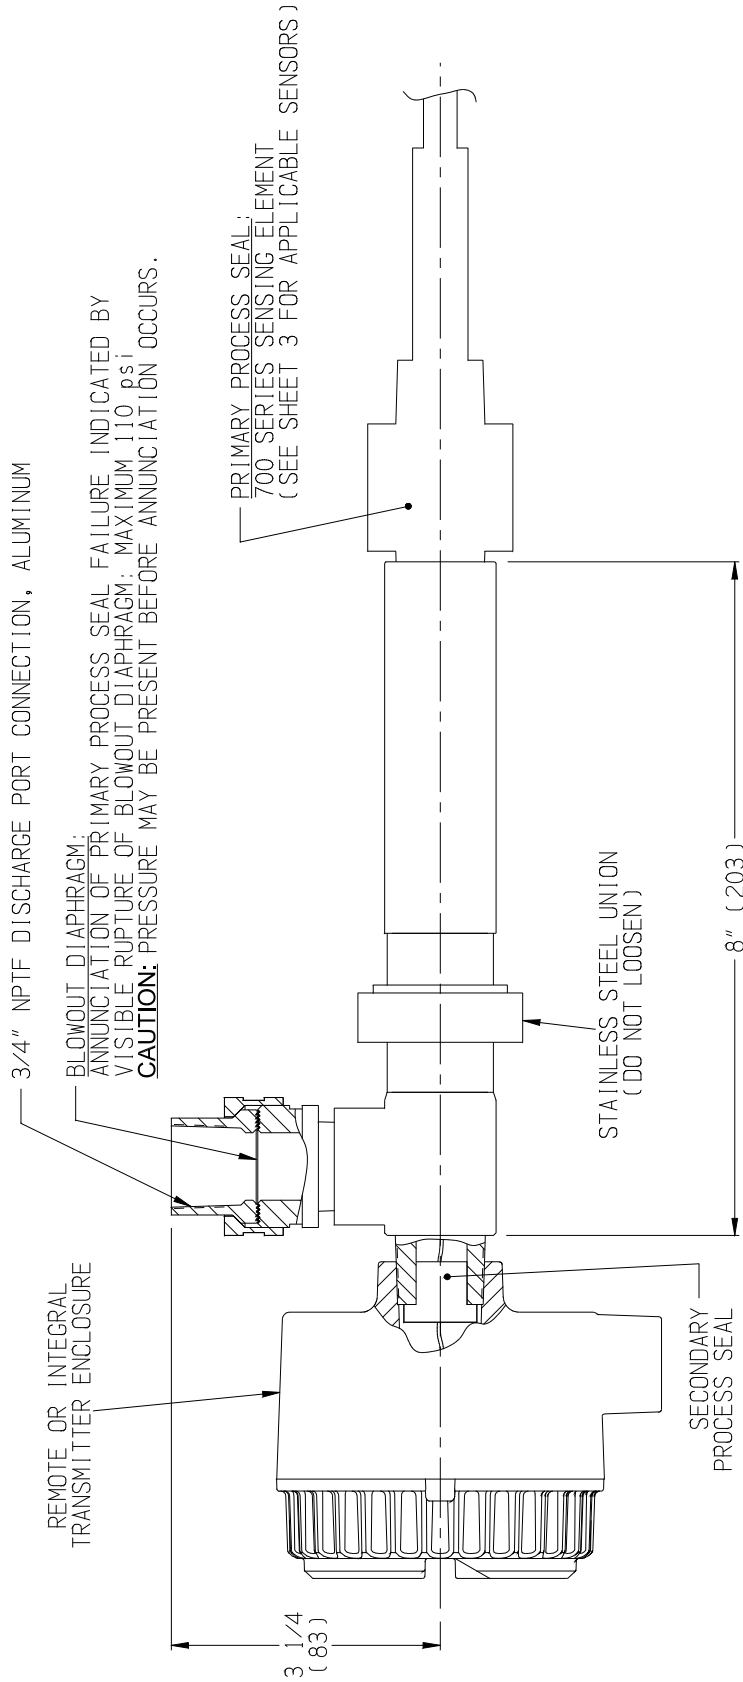

NOTES:

1. ANSI / ISA 12.27.01-2003 FM CERTIFIED "DUAL SEAL" WHEN USED WITH AMETEK DREXELBROOK 700 SERIES SENSING ELEMENTS
2. SEE SHEET 3 FOR 700 SERIES PRIMARY SEAL PROCESS WETTED MATERIALS.
3. REFER TO SENSING ELEMENT TAG FOR PROCESS TEMPERATURE AND PRESSURE RATINGS.

ERTIFIED	by _____	COPYRIGHT - 2015	CONTROL DRAWING, DUAL SEAL ASSEMBLY FOR USE WITH 700 SERIES SENSING ELEMENTS		
0 # _____		AMETEK DREXELBROOK	SHT. 2 OF 3		
NG _____		SCALE NONE			
SER _____		UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)			
		ISS. EDC/DSR NO. APP. D DATE			
# _____			285-0003-0XX-CD		

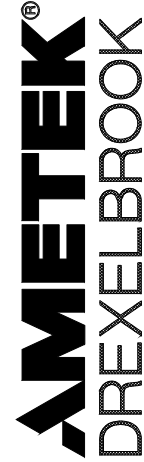

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

6.7 Dual Seal Assembly (Continued)

No. 285-0003-OXX-CD


SHT 3 OF 3

SENSING ELEMENTS AVAILABLE

SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS	SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS	SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS
700-0001-022	TFE/316SS	700-0002-054	FEP/TFE/316SS	700-0202-053	TFE/316SS
700-0001-024	TFE/316SS	700-0002-057	PVDF/TFE/316SS	700-0202-054	TFE/316SS
700-0001-026	TFE/316SS	700-0002-064	PVDF/TFE/316SS	700-0202-056	TFE/316SS
700-0001-034	TFE/CS	700-0002-224	TFE/316SS	700-1202-001	PEEK/316SS
700-0001-040	POLYETHYLENE/316SS	700-0002-321	FEP/TFE/316SS	700-1202-010	PEEK/316SS
700-0001-044	PFA/316SS	700-0002-360	PFA/TFE/316SS	700-1202-014	PEEK/316SS
700-0001-054	TFE/316SS	700-0005-054	PFA/TFE/316SS	700-1202-015	PEEK/316SS
700-0001-064	TFE/316SS	700-0201-005	TFE/316SS	700-1202-018	PEEK/316SS
700-0001-074	TFE/316SS	700-0201-025	TFE/316SS	700-1202-031	PEEK/316SS
700-0001-344	PFA/316SS	700-0201-026	TFE/316SS	700-1202-033	PEEK/316SS
700-0002-023	TFE/316SS	700-0201-027	TFE/316SS	700-1202-041	PEEK/316SS
700-0002-024	TFE/316SS	700-0201-028	TFE/316SS	700-1202-045	PEEK/316SS
700-0002-027	FEP/TFE/316SS	700-0201-035	TFE/316SS	700-1202-051	PEEK/316SS
700-0002-028	TFE/316SS	700-0201-051	TFE/316SS	700-1202-055	PEEK/316SS
700-0002-033	TFE/316SS	700-0201-052	TFE/316SS	700-1202-061	PEEK/316SS
700-0002-037	PVDF/TFE/316SS	700-0201-058	TFE/316SS	700-1202-081	PEEK/316SS
700-0002-040	UHMW PE/SILICONE/316SS	700-0201-059	TFE/316SS	700-9100-403	PEEK/316SS
700-0002-044	PVDF/TFE/316SS	700-0202-002	TFE/316SS	700-9100-404	PEEK/316SS
				700-1230-XX-XX-XXX	PEEK/CS/316SS



CERTIFIED PO # _____ ENG _____ USER _____ DE # _____	_____	_____	_____	_____	_____	_____	_____	
	_____	_____	_____	_____	_____	_____	_____	
	_____	_____	_____	_____	_____	_____	_____	
by _____							COPYRIGHT © 2015 AMETEK DREXELBROOK	
3 2-15-111 THP 3-11-15							SCALE NONE	
2 1-12-114 JEN 1-20-12							UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
1 4-08-106 TDH 9-10-08							DR. JEN 3-11-15	
ISS. EDO/DSR NO. APP'D DATE							CK. TDH 3-11-15	
CONTROL DRAWING DUAL SEAL ASSEMBLY FOR USE WITH 700 SERIES SENSING ELEMENTS						285-0003-OXX-CD SHT. 3 OF 3		

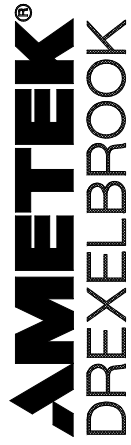

215-674-1234
 FAX 215-674-2731
 305 KELTH VALLEY RD.
 HORSHAM, PA 19044-9886

Appendix: A

Appendix A: Shortening or Lengthening the Sensing Element



CAUTION:


*The insulation length of either **Flush Sensing Elements** or **Insulated Sensing Elements** can **NOT** be changed. **Cable Sensing Elements** can only be shortened. Instructions are included with each unit.*

The Need

Sometimes your application calls for probe lengths other than the standard 18-inch or longer insertion lengths supplied. Shortening the sensing element is quite simple and can be done in the field. Lengthening the sensing element, however, is more difficult because the metal rod, typically 304 SS or 316 SS, must be welded.

NOTE:

*Cote-Shield element must **NEVER** be modified.*

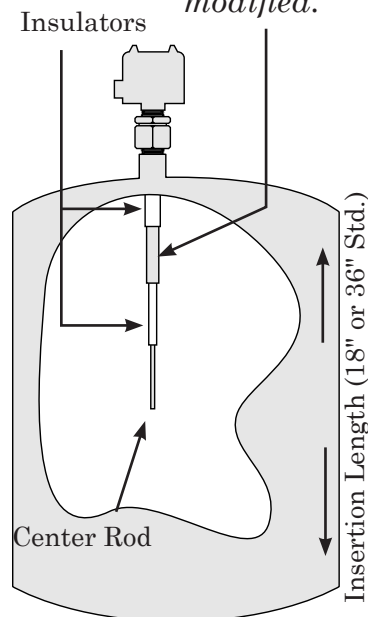

Before making any Adjustments:

- 1) Read the following instructions thoroughly.
- 2) Remove power.
- 3) Disconnect the electronics.
- 4) Protect electronics from any static discharge.
- 5) Protect electronics from any heat.

Shortening

The bare metal center rod of the sensing element can be shortened with a hacksaw. Be careful not to cut either of the two insulators. See Figure on this page.

In applications using conductive or water-based materials, shortening is not a problem. Leave a minimum bare metal center rod length of two (2) inches.

For dry granular materials, such as powder, sand, corn, clinker, etc., you must leave a minimum bare metal center rod length of eight (8) inches. Consult the factory before shortening beyond this point.

Lengthening

To lengthen the sensing element, an extension rod can be welded onto the end of the bare metal center rod. Make sure that the extension rod is the same metal as the sensing element.

An alternate option is to add a pipe coupling and a section of metal pipe after threading the tip of the sensing element. In this case, the metal pipe need not be identical to the metal of the sensing element.



Any changes to probe length after calibration requires re calibration to ensure proper operation.

CE Installation Supplement

Purpose: To provide additional information that is required to be in compliance with the CE mark of conformity and 2014/30/EU Directive.

- Definitions:**
1. I/O Sensor/Measurement/Control Port -- Any port which provides level measurement, control, and/or DC power.
 2. I/O AC Power -- Any port which provides AC main power to the instrument.
 3. Housing -- Any enclosure where the sensor and transmitter can be located.
 4. Non-metallic applications -- any application where the sensor is not surrounded by a metallic surface.

Installation Specifics:

1. I/O Sensor/Measurement/Control Ports

- Wiring must be twisted pair and run in conduit or an equivalent shielded environment (i.e. shielded braid, cable, etc.).
- The shield terminations must be grounded at the source and destination ports.
- Wiring must be run separate from AC main power and/or any signal exceeding 75 volts DC or 50 volts AC.

2. I/O AC Power Port

- Wiring must be run either in conduit or an equivalent shielded environment (i.e. shielded braid, cable, etc.).
- The shield terminations must be grounded at the source and destination ports.

CE Installation Supplement (Continued)

3. Remote Installations

- Sensor port must be connected to the transmitter port by one of the following means:
 - 401-16 Probe Filter
 - Coaxial cable run in conduit.
 - Triaxial cable.

4. Housings

- All installations require the sensor and transmitter to be located in a closed shielded/metal housing (i.e. typically explosion-proof or weatherproof housings meet this requirement)

5. Sensor Type/Mounting

- In all non-metallic applications the sensor must have a full concentric shield (i.e. needs to be considered when ordering).
- The sensor/sensor conduit must be grounded locally either to a metal support structure or an equivalent earth ground.

Comments:

- Any deviation from these installation requirements should be reviewed with factory, prior to implementation
- These instructions are essential to insure conformity with specified EC directives.

Appendix: B

EXIDA Management Summary



Proof test must be performed to certify proper operation for SIL performance. Reference Appendix B in the EXIDA Failure Modes, Effects and Diagnostic Analysis located on the Drexelbrook.com website under support/documentation.



Management Summary

This report summarizes the results of the hardware assessment in the form of a Failure Modes, Effects, and Diagnostic Analysis (FMEDA) of the IntelliPoint RF Series Point Level Switch, hardware and software revision per Section 2.5.1. A Failure Modes, Effects, and Diagnostic Analysis is one of the steps to be taken to achieve functional safety certification per IEC 61508 of a device. From the FMEDA, failure rates are determined. The FMEDA that is described in this report concerns only the hardware of the IntelliPoint. For full functional safety certification purposes all requirements of IEC 61508 must be considered.

The Ametek Drexelbrook IntelliPoint detects the presence of material in a vessel by sensing the change in capacitance when the material contacts the IntelliPoint sensing element. The IntelliPoint is designed to ignore the effect of buildup or material coating on the sensing element.

Table 1 gives an overview of the different versions that were considered in the FMEDA of the IntelliPoint.

Table 1 Version Overview

Loop	IntelliPoint with 4-20mA loop power and output – model SxRNTx-x0xx-xxxx
Relay	IntelliPoint with 18-200VDC or 85-250VAC power and dual relay output – model SxRNLx-x1xx-xxxx or SxRNLx-x2xx-xxxx

The IntelliPoint is classified as a Type B¹ element according to IEC 61508, having a hardware fault tolerance of 0.

The failure rate data used for this analysis meets the *exida* criteria for Route 2_H (see Section 5.2). Therefore, the IntelliPoint meets the hardware architectural constraints for up to SIL 2 at HFT=0 (or SIL 3 @ HFT=1) when the listed failure rates are used.

Based on the assumptions listed in 4.3, the failure rates for the IntelliPoint are listed in section 4.5.

These failure rates are valid for the useful lifetime of the product, see Appendix A.

The failure rates listed in this report are based on over 250 billion unit operating hours of process industry field failure data. The failure rate predictions reflect realistic failures and include site specific failures due to human events for the specified Site Safety Index (SSI), see section 4.2.2.

A user of the IntelliPoint can utilize these failure rates in a probabilistic model of a safety instrumented function (SIF) to determine suitability in part for safety instrumented system (SIS) usage in a particular safety integrity level (SIL).

EXIDA Report Results

4.5 Results

Using reliability data extracted from the *exida* Electrical and Mechanical Component Reliability Handbook the following failure rates resulted from the IntelliPoint FMEDA.

Table 3 Failure rates IntelliPoint (Loop)

Failure Category	Failure Rate (FIT)	
Fail Safe Undetected	28	
Fail Dangerous Detected	399	
Fail Detected (detected by internal diagnostics)	250	
Fail High (detected by logic solver)	77	
Fail Low (detected by logic solver)	72	
Fail Dangerous Undetected	103	
No Effect	312	
Annunciation Undetected	38	

Table 4 Failure rates IntelliPoint (Relay)

Failure Category	Failure Rate (FIT)
Fail Safe Detected	92
Fail Safe Undetected	189
Fail Dangerous Detected	175
Fail Dangerous Undetected	142
No Effect	252
Annunciation Detected	51
Annunciation Undetected	48

Table 5 Failure rates according to IEC 61508 in FIT

Device	λ_{SD}	λ_{SU}^3	λ_{DD}	λ_{DU}
IntelliPoint (Loop)	0	28	399	103
IntelliPoint (Relay)	92	189	226	142

Table 9 Proof Test Coverage – IntelliPoint

Device	λ_{DUPT} (FIT)	Proof Test Coverage
IntelliPoint (Loop), without process material	45	57%
IntelliPoint (Relay), without process material	38	73%
IntelliPoint (Loop), using process material	20	81%
IntelliPoint (Relay), using process material	18	87%

AMETEK, Inc.

TERMS AND CONDITIONS OF SALE

THE FOLLOWING TERMS/CONDITIONS, TOGETHER WITH ANY OTHER TERMS/CONDITIONS SPECIFICALLY AGREED TO IN WRITING BY SELLER, SHALL APPLY TO ALL ORDERS ("Order(s)") FROM, AND SALES OF PRODUCTS ("Products") OR SERVICES ("Services") TO BUYER. ANY ACCEPTANCE OF ANY ORDER OF BUYER IS CONDITIONED UPON THESE TERMS/CONDITIONS. ANY ADDITIONAL OR DIFFERENT TERMS/CONDITIONS PROPOSED BY BUYER IN ANY DOCUMENT ARE OBJECTED TO AND SHALL NOT BE BINDING UPON SELLER. No salesperson is authorized to bind Seller to any promise or understanding not expressed herein.

I. PRICES All prices are subject to change without notice in the event of any changes in cost of materials or labor, specifications, quantities, delivery schedules, customs duties, other factors beyond Seller's control, or in the event of delays caused by instructions of the Buyer, or failure of the Buyer to give Seller adequate information. Further, prices payable by the Buyer shall be subject to immediate increase, should the Seller as a result of governmental action or regulation including, without limitation, those contemplated by an investigation under Section 232 of the Trade Expansion Act of 1962 (19 U.S.C. §1862), incur additional duties, tariffs or restrictions on products sold hereunder, or on the raw materials that are used in making such products. In no event shall prices include any amounts imposed on the Buyer in connection with Buyer's purchases from Seller, such as taxes, including but not limited to Value Added Tax (VAT) or excise taxes, duties, tariffs, or any other costs assessed against the Buyer by a governmental authority.

II. DELIVERY Delivery dates are approximate and are dependent on prompt receipt by Seller of all necessary information. Seller may deliver all or any part of Products/ Services as early as 30 days in advance of agreed schedule. The point of delivery shall be "Ex-works" Seller's premises, unless otherwise specified by Seller. Upon delivery, title to Products and all risk of loss or damage thereto shall pass to Buyer. Where Buyer notifies Seller that it cannot take timely delivery of the Products, Seller may place such Products in storage, at the risk of Buyer, and Buyer shall reimburse Seller for all expenses incurred in connection with such storage. Buyer shall dispose of the packing materials for Products at its own expense, and shall defend, indemnify and hold harmless Seller from any legal obligations in connection with such packing waste.

III. PAYMENT A. The term of payment shall be net 30 days from date of Seller's invoice, unless otherwise specified. Payments shall be made by Buyer without any deduction or set-off. Unless otherwise agreed, payment shall be made in U.S. dollars. Seller may charge late payment fees at the rate of 1.5% per month, or the highest rate permitted by law, whichever is less, accruing daily.

B. If the financial condition of Buyer is unsatisfactory to Seller, Seller may require full or partial payment in advance, or satisfactory security, in the form of a letter of credit or otherwise. In the event of bankruptcy or insolvency of Buyer, Seller may immediately cancel any Order then outstanding.

C. Buyer grants Seller a purchase money security interest in Products located in the United States, or Services, as well as any proceeds, for the purpose of securing the obligations of Buyer hereunder. Buyer authorizes Seller to execute on Buyer's behalf and file such financing statements as Seller deems appropriate to perfect and notify Buyer's creditors of Seller's security interest.

IV. VARIATIONS IN QUANTITY; CHANGES. Buyer shall accept delivery of quantities greater or smaller than the quantity specified in Order(s), provided that any such variation shall not exceed 5% of the quantity originally specified, or 2 units, whichever is greater. Seller shall not be required to give notice of any such variations other than in the applicable shipping notice and invoice. Seller reserves the option to make changes to Products or Services which do not affect form, fit, or function, and shall deliver Products to the latest configuration part number at the time of delivery.

V. EXPORT CONTROLS; FCPA; ANTI-BOYCOTT

A. Buyer shall not make any disposition of the Products, by way of transshipment, re-export, diversion or otherwise, except as applicable U.S. export laws and regulations may expressly permit, and other than in and to the ultimate country of destination specified on Order(s) or declared as the country of ultimate destination on Seller's invoices or in the End Use Statement that Buyer supplies Seller. Seller shall not be named as shipper or exporter of record or U.S. principal party-in-interest

(USPPI) unless specifically agreed to in writing by Seller in which case, Buyer shall provide Seller with a copy of the documents filed by Buyer for Export clearance purposes. At Seller's request, Buyer shall supply end-use and end-user information to determine export license applicability. Failure of Buyer to comply with this section shall constitute a material default allowing Seller to cancel related Order(s) without liability.

B. Buyer warrants that it shall not violate or cause the Seller to violate the U.S. Foreign Corrupt Practices Act of 1977 (FCPA), as amended, the United Kingdom Bribery Act (UKBA) of 2010, as amended, or their respective implementing regulations in connection with Buyer's sale or distribution of the Products and/or Services, and that Buyer does not know or have reason to believe that any consultant, agent, representative or other person retained by Buyer in connection with the sale and/or distribution of Products/Services has violated, nor caused Seller to violate the FCPA and/or the UKBA. Where Buyer learns of or has reason to know of any violation of FCPA and/or UKBA in connection with the sale or distribution of Products/Services, Buyer shall immediately advise Seller.

C. Buyer further warrants that Buyer shall not violate or cause Seller to violate the U.S. Antiboycott Provisions of the U.S. Export Administration Regulations issued pursuant to the U.S. Export Administration Act of 1979, as amended, in connection with Buyer's purchase of Products/Services and that Buyer shall not request or require Seller to make statements or certifications against countries that are not subject to boycott by the U.S.

VI. WARRANTIES

A. Seller warrants that Products manufactured by Seller, when delivered, shall be free from defects in material/workmanship. Seller warrants that Services shall be performed in accordance with generally accepted industry practice. Seller's obligations under this warranty shall be limited exclusively to repairing or replacing, at Seller's option, any part of Products which, if properly installed, used and maintained, proved to have been defective in material or workmanship within 1 year from the date of shipment, or re-performing the Services. Seller warrants for a period of 1 year from the date of shipment that software or firmware, when used with Products, shall perform in accordance with Seller's published specifications. Seller makes no warranty, express or implied, that the operations of the software or firmware shall be uninterrupted or error-free, or that functions contained therein shall meet or satisfy the Buyer's intended use/requirements. Buyer shall notify Seller of any defect in the quality or condition of Products (including software/firmware) or Services within 7 days of the date of delivery or performance, unless the defect was not apparent on reasonable inspection, in which case, within 7 days after discovery of the defect. If Buyer does not provide such timely notification, it shall not be entitled to reject Products (including software/firmware) or Services, and Seller shall have no liability for such defect.

B. Seller's warranty obligations shall not apply to Products which (1) have been altered or repaired by someone other than Seller, or (2) have been subjected to misuse, neglect, or improper use or application, or (3) are normally consumed in operation, or (4) have a normal life inherently shorter than the warranty period stated therein.

C. No Products may be returned unless authorized in advance by Seller, and then only upon such conditions to which Seller may agree. Buyer must obtain a Return Material Authorization (RMA) number from Seller prior to any return shipment, and such RMA number must appear on the shipping label and packing slip. Buyer shall be responsible for returned Products until such time as Seller receives the same at its facility, and for all charges for packing, inspection, shipping, transportation or insurance associated with returned Products.

D. This section VI sets forth the exclusive remedies and obligations for claims based upon defects in or nonconformity of Products/Services, whether the claim is in contract, warranty, tort (including negligence of any degree or strict liability) or otherwise. **THE FOREGOING WARRANTIES ARE IN LIEU OF ALL OTHER WARRANTIES,**

WHETHER ORAL, WRITTEN, EXPRESS, IMPLIED OR STATUTORY. NO IMPLIED OR STATUTORY WARRANTIES OF MERCHANTABILITY OR FITNESS FOR PARTICULAR PURPOSE SHALL APPLY.

VII. PATENTS/INDEMNITY If Buyer receives a claim that Products, or part thereof manufactured by Seller infringes a patent, Buyer shall notify Seller promptly in writing and give Seller information, assistance and exclusive authority to evaluate, defend and settle such claim. Where Buyer has furnished specifications/designs for the manufacture of the allegedly- infringing Products, Buyer shall defend, indemnify and hold harmless Seller against third-party claims for infringement arising out of Seller's use of such specifications/designs.

VIII. LIMITATION OF LIABILITY

The total liability of Seller on any claim, whether in contract, tort (including negligence of any degree and strict liability) or otherwise arising out of, connected with, or resulting from the manufacture, sale, delivery, resale, repair, replacement or use of any Products/Services, shall not exceed the price allocable to the Products/Services or part thereof which gives rise to the claim. **IN NO EVENT, WHETHER AS A RESULT OF BREACH OF CONTRACT, WARRANTY, TORT, (INCLUDING NEGLIGENCE OF ANY DEGREE, STRICT LIABILITY OR PATENT INFRINGEMENT) OR OTHERWISE, SHALL SELLER, ITS AFFILIATES, SUBCONTRACTORS, OR SUPPLIERS BE LIABLE FOR ANY LOSS OF PROFIT OR REVENUES, LOSS OF USE OF THE PRODUCTS OR SERVICES, OR ANY ASSOCIATED EQUIPMENT, COST OF CAPITAL, COST OF SUBSTITUTE GOODS, FACILITIES, SERVICES OR REPLACEMENT POWER, DOWNTIME COSTS OR CLAIMS OF BUYER'S CUSTOMERS FOR DAMAGES OR FOR ANY SPECIAL, PROXIMATE, CONSEQUENTIAL, INCIDENTAL, INDIRECT OR EXEMPLARY DAMAGES.** If Buyer transfers title to, or leases Products sold hereunder to, or otherwise permits or suffers use by, any third party, Buyer shall obtain from such third party a provision affording Seller and its subcontractors/suppliers the protection of the preceding sentence. Any action against Seller must be brought within 18 months after cause of action accrues.

IX. EXCUSABLE DELAYS A. Seller shall not be liable for delays in delivery or failure to perform due directly or indirectly to causes beyond Seller's reasonable control including but not limited to: acts of God; war; terrorism; civil commotion; riots; embargoes; government regulations, orders, instructions or priorities; port congestion; acts of or failure to act on the part of Buyer or its agents/employees; fires; floods; sabotage; nuclear incidents; earthquakes; storms; epidemics; strikes; lockouts or other labor difficulties; shortages of or inability to timely obtain proper labor, materials, components, shipping space or transportation, fuel, supplies or power at current prices; or due to limitations imposed by the extent of availability of Seller's normal manufacturing facilities.

B. If a delay excused per the above extends for more than 90 days and the parties have not agreed upon a revised basis for continuing providing Products/Services at the end of the delay, including adjustment of the price, then either party (except where delay is caused by Buyer, in which event only Seller) upon thirty (30) days' notice may terminate the Order with respect to the unexecuted portion of the Products/Services, whereupon Buyer shall promptly pay Seller its reasonable termination charges upon submission of Seller's invoices thereof.

X. SOFTWARE/TECHNICAL/PROPRIETARY INFORMATION

A. Buyer shall not acquire any rights to any software which may be delivered with Products, except as granted in Seller's standard software license. Any software license granted in connection with Products shall be an interim license, which may be withdrawn, pending payment for Products in full.

B. The purchase of Products shall not include any right to supply of technical information such as drawings or specifications.

C. Proprietary information, including drawings, documents, technical data, reports, software, designs, inventions and other technical information supplied by Seller in connection herewith (hereinafter called "Data"), shall remain Seller's sole property and shall be held in confidence by Buyer. Data shall not be reproduced, used or disclosed to others by Buyer without

Seller's prior written consent. Upon completion of Order, Buyer shall promptly return all Data to Seller together with all copies or reprints thereof then in Buyer's possession or control, and Buyer shall thereafter make no future use, either directly or indirectly, of any Data or any information derived therefrom without Seller's prior written consent. The foregoing shall in no way obligate Seller to provide or supply Data.

XI. DIES, TOOLS, PATTERNS Seller's charges for dies, molds, patterns and the like represent the Buyer's proportionate cost thereof, it being expressly understood that they remain the property of Seller. Modifications made to dies, molds, patterns and the like in order to manufacture Products shall be at the discretion of Seller.

XII. GENERAL A. The rights and obligations of the Buyer and Seller hereunder shall be governed in all respects by the law of the Commonwealth of Pennsylvania, U.S.A. The exclusive forum for adjudication of any disputes shall be the federal or state courts of the Commonwealth of Pennsylvania, and Buyer/Seller hereby consent to personal jurisdiction and venue in such courts in any proceeding. The United Nations Convention on the International Sale of Goods shall not apply.

B. These Terms and Conditions of Sale together with any other terms specifically agreed to in writing by Seller constitute the entire agreement between Buyer and Seller and supersede any prior or contemporaneous representations, agreements, proposals, warranties, or understandings, oral or written, express or implied. No waiver, modification, amendment, rescission or other change to these Terms and Conditions of Sale shall be binding unless specifically agreed to in writing by an authorized representative of Seller.

C. The invalidity, of any part hereof shall not affect the validity of the remainder. The failure of Seller to assert any right at any time hereunder shall not prevent Seller's subsequent assertion of the same or different rights.

D. Buyer may not assign this contract without the prior written approval of the Seller.

XIII. PROHIBITION FOR HAZARDOUS USE

Products sold hereunder are not intended for application in, and shall not be used by Buyer in construction or application of a nuclear installation or in connection with use or handling of nuclear material or for any hazardous activity or critical application, where failure of a single component could cause substantial harm to persons or property, unless Products have been specifically approved for such activity or application. Seller disclaims all liability for loss or damage resulting from such unauthorized use and Buyer shall defend, hold harmless and indemnify Seller against any such liability, whether arising under breach of contract, warranty, tort (regardless of the degree of fault or negligence), strict liability or otherwise.

Where Seller approves the application of the Products in a nuclear facility, the Buyer shall, before such use or provision, arrange for insurance or governmental indemnity protecting the Seller against liability and hereby releases and agrees to indemnify the Seller and its suppliers for any nuclear damage, including loss of use, in any manner arising out of a nuclear incident, whether alleged to be due, in whole or in part to the negligence or otherwise of the Seller or its suppliers.

XIV. STATUTORY REQUIREMENTS

Seller reserves the right to make any changes in the general specifications of the Products which are required for the Products to conform to any statutory requirement.

XV. GOVERNMENT CONTRACTS

Only Federal Acquisition Regulation ("FAR") supplement clauses expressly accepted in writing by Seller shall be included or incorporated by reference herein. Seller shall not be bound by and makes no representation of compliance with any FAR or FAR supplement clauses that Seller shall not have expressly accepted in writing.

AMETEK[®]
DREXELBROOK
An ISO 9001 Certified Company

SXRXLXX1-LM Issue 04
EDO# 05-19-110

205 Keith Valley Road, Horsham, PA 19044
Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.info@ametek.com
Website: www.drexelbrook.com



Leader in
Level Measurement

Installation and Operating Instructions

SIL IntelliPoint RF™ SXRXT Series Two-Wire Point Level Safety Switch



Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.sales@ametek.com
Website: www.drexelbrook.com

AMETEK Drexelbrook makes no warranty of any kind with regard to the material contained in this manual, including, but not limited to, implied warranties or fitness for a particular purpose. Drexelbrook shall not be liable for errors contained herein or for incidental or consequential damages in connection with the performance or use of material.

© AMETEK Drexelbrook

SXRXTXX1-LM
Issue# 04

SIL IntelliPoint RF™ SXRXT Series Two-Wire Point Level Safety Switch



AMETEK®
DREXELBROOK
An ISO 9001 Certified Company

205 Keith Valley Road, Horsham, PA 19044
Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.info@ametek.com
Website: www.drexelbrook.com

Contents

Contents

Section 1: Introduction	
1.1	System Description 1
1.2	Technology 1
1.3	Model Number 2
1.4	SIL Sensing Element List 3
1.5	Dual Compartment Housing Detail 4
Section 2: Installation	
2.1	Unpacking 5
2.2	Mounting and Installation Guidelines 5
2.3	Input Wiring 8
2.4	Spark Protection 8
2.5	Circuit Board 9
2.6	Output & Status LEDs 13
2.7	Sensing Element Connection 14
2.8	Calibration 16
Section 3: Spare Parts List	20
Section 4: Troubleshooting	
4.1	RF Point Level Troubleshooting Guide 22
4.2	Testing Electronic Unit 23
4.3	Over Range 24
4.4	Under Range 24
4.5	Testing The Sensing Element 24
4.6	Testing the Integral Cable 27
4.7	Testing the Remote Cable 27
4.8	Testing the Power Supply 28
4.9	Factory Assistance 29
4.10	Field Service 29
4.11	Customer Training 29
4.12	Equipment Return 30
Section 5: Specifications	
5.1	Approvals 33
Section 6: Control Drawings	
6.1	FM / FMc Control Drawings 35
6.2	ATEX Control Drawings 51
6.3	CE Mark Declaration of Conformity 60
6.4	IECEx Control Drawings 61
6.5	Mounting and Wiring for Spark Protector Drawings 70
6.6	Adding a Padded Capacitor 73
6.7	Dual Seal Assembly for 700 Series Sensing Elements 76
Appendix A:	
Shortening or Lengthening the Sensing Element	A-1
CE Installation Supplement	A-2
CE Installation Supplement (Continued)	A-3
Appendix B: SIL Certification Information	
EXIDA Management Summary	B-1
EXIDA Report Results	B-2

Section 1

Section 1: Introduction

1.1 System Description

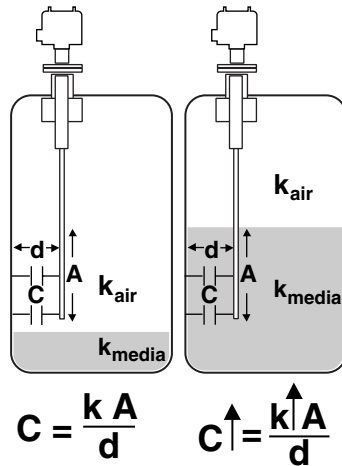


Figure 1-1

Simple Capacitance Probe
(Insulating Media Shown)

Installation is simple and easy on the AMETEK Drexelbrook **IntelliPoint™** Series products. Simply apply power and the IntelliPoint system is ready to detect the presence or absence of material. Since the IntelliPoint instrument does not require calibration or setpoint adjustments, it is capable of operating in non-dedicated tanks regardless of the material being measured.

Notice: Material to be Measured Must Be Below Sensor when Power is Applied.

The **AutoVerify™** self-testing function continuously monitors the entire system to ensure proper operation. **Manual Certify™** changes the outputs in order to test the loop current and ensure proper operation of the control systems.

1.2 Technology

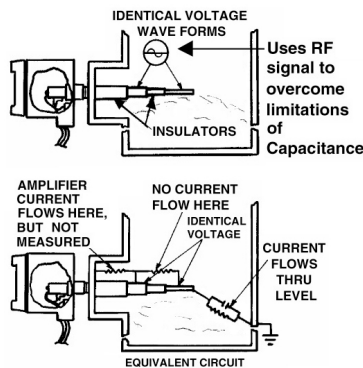


Figure 1-2

RF Admittance Probe
with Cote-Shield

In a simple capacitance probe-type sensing element, when the level rises and material covers the probe, the capacitance within the circuit between the probe and the media (conductive applications) or the probe and the vessel wall (insulating applications) increases. This is due to the dielectric constant (k) of the material, which causes a bridge mis-balance. The signal is demodulated (rectified), amplified, and the output is increased. There are drawbacks, however, especially when there is coating of the probe.

An RF Admittance level transmitter is the next generation. Although similar to the capacitance concept, The IntelliPoint employs a radio frequency signal and adds the Cote-Shield™ circuitry within the Electronics Unit.


This patented Cote-Shield™ circuitry is designed into the IntelliPoint series and enables the instrument to ignore the effect of buildup or material coating on the sensing element. The sensing element is mounted in the vessel and provides a change in RF admittance indicating presence or absence of material.

The Cote-Shield element of the sensor prevents the transmission of RF current through the coating on the sensing element. The only path to ground available for the RF current is through the material being measured.

The result is an accurate measurement regardless of the amount of coating on the probe, making it by far the most versatile technology, good for very wide range conditions from cryogenics to high temperature, from vacuum to 10,000psi pressure, and works with all types of materials.

1.3 Model Number

Safety IntelliPoint RF™

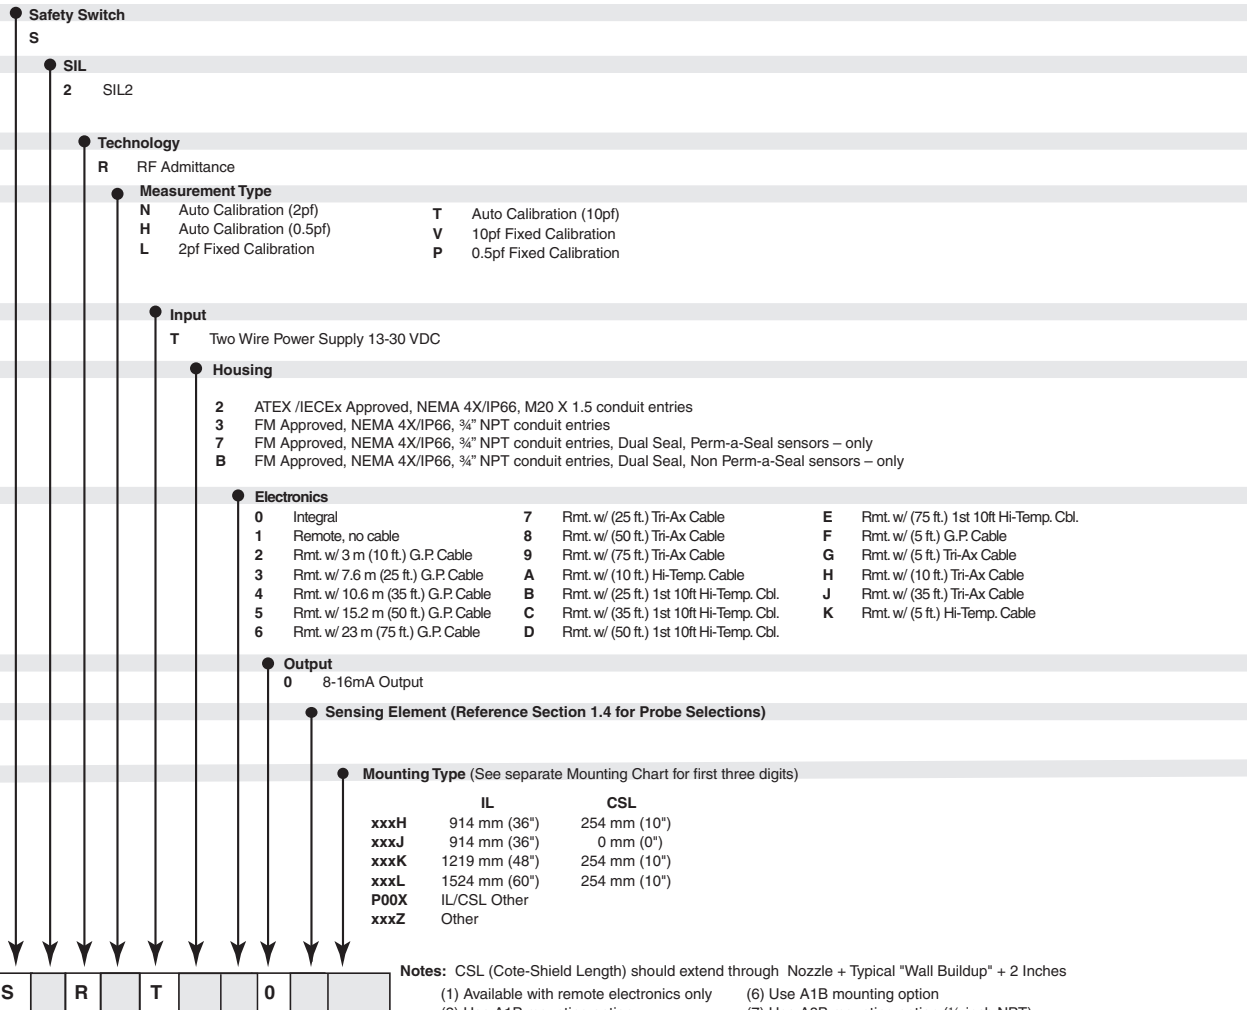

IMPORTANT:
Minimum Active Length for SIL Compliance is 24" (610mm)
Consult Factory for Shorter Lengths

- Notes:** CSL (Cote-Shield Length) should extend through Nozzle + Typical "Wall Buildup" + 2 Inches
- (1) Available with remote electronics only
 - (2) Use A1P mounting option
 - (3) Choose only sanitary mounting options
 - (4) Available with 0-inch CSL only
 - (5) Use P00X mounting option
 - (6) Use A1B mounting option
 - (7) Use A8B mounting option (¼-inch NPT)
 - (8) Choose from flange mounting only
 - (9) FM approved with remote electronics only

Not all mounting options are available with all sensing elements

NPT Threads			
A1B	¾"NPT	316SS	A2B 1"NPT 316SS
A1C	¾"NPT	Hastelloy C	A2C 1"NPT Hastelloy C
A1P	¾"NPT	PFA	

Sanitary TriClamps			
C2B	1"TriClamp	316SS	C5B 2-1/2"TriClamp 316SS
C3B	1½"TriClamp	316SS	C6B 3"TriClamp 316SS
C4B	2"TriClamp	316SS	C7B 3"TriClamp 316SS

DIN Flanges			
E01	25 mm	16 bar	RF 316/316L SS
EP1	25 mm	40 bar	RF 316/316L SS
EQ1	50 mm	16 bar	RF 316/316L SS
ER1	50 mm	40 bar	RF 316/316L SS
ES1	80 mm	16 bar	RF 316/316L SS
ET1	80 mm	40 bar	RF 316/316L SS
EU1	100 mm	16 bar	RF 316/316L SS
EV1	100 mm	40 bar	RF 316/316L SS
EW1	150 mm	16 bar	RF 316/316L SS
EX1	150 mm	40 bar	RF 316/316L SS
E02	25 mm	16 bar	RF CS
EP2	25 mm	40 bar	RF CS
EQ2	50 mm	16 bar	RF CS
ER2	50 mm	40 bar	RF CS
ES2	80 mm	16 bar	RF CS
ET2	80 mm	40 bar	RF CS
EU2	100 mm	16 bar	RF CS
EV2	100 mm	40 bar	RF CS
EW2	150 mm	16 bar	RF CS
EX2	150 mm	40 bar	RF CS

ANSI Flanges			
DA1	1"	150#	RF 316/316L SS
DB1	1½"	150#	RF 316/316L SS
DC1	2"	150#	RF 316/316L SS
DD1	2½"	150#	RF 316/316L SS
DE1	1"	300#	RF 316/316L SS
DF1	1½"	300#	RF 316/316L SS
DG1	2"	300#	RF 316/316L SS
DH1	2½"	300#	RF 316/316L SS
DI1	3"	150#	RF 316/316L SS
DJ1	3"	300#	RF 316/316L SS
DK1	4"	150#	RF 316/316L SS
DL1	4"	300#	RF 316/316L SS
DM1	6"	150#	RF 316/316L SS
DN1	6"	300#	RF 316/316L SS
DA2	1"	150#	RF CS
DB2	1½"	150#	RF CS
DC2	2"	150#	RF CS
DD2	2½"	150#	RF CS
DE2	1"	300#	RF CS
DF2	1½"	300#	RF CS
DG2	2"	300#	RF CS
DH2	2½"	300#	RF CS
DI2	3"	150#	RF CS
DJ2	3"	300#	RF CS
DK2	4"	150#	RF CS
DL2	4"	300#	RF CS
DM2	6"	150#	RF CS
DN2	6"	300#	RF CS

1.4 SIL Sensing Element List

#	Application	Sensing Element Part Number	Pressure/Temperature	Wetted Parts
General & Application Specific Sensing Elements	00 General purpose	700-1202-001 Remote & 700-1202-021 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK
	02 General purpose, longer insertion lengths w/cable attachment and 316/316L SS bottom weight	700-1202-014 Remote & 700-1202-024 Integral	13.8 bar @ 177°C (200 PSI @ 350°F)	316/316L SS and PEEK
	03 Proximity	700-1202-018 Remote & 700-1202-028 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK with 76mm (3) 216SS proximity plate.
	04 General purpose, high temperature and pressure	700-1202-041 Remote	69 bar @ 121°C (1000 PSI @ 250°F)	316/316L SS and PEEK
		700-1202-042 Integral	20.7 bar @ 232°C (300 PSI @ 450°F)	
	06 General purpose with FDA approved materials of construction	700-1202-031 Remote & 700-1202-032 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and FDA grade PEEK
	07 General purpose for granular materials	700-1202-010 Remote & 700-1202-020 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK with 7/8 inch dia. 316/316L SS collar
	09 General purpose for granular materials w/FDA approved materials of construction	700-1202-033 Remote & 700-1202-034 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and FDA grade PEEK with 7/8 inch dia. 316/316L SS collar
	10 Corrosive liquids	700-001-018 Remote	3.4 bar @ 149°C (50 PSI @ 300°F)	PFA
	11 General purpose, higher pressure, TFE compatibility required	700-0201-005 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	316/316L SS and TFE
			13.8 bar @ 232°C (200 PSI @ 450°F)	
	12 Corrosive material, higher pressure	700-0201-005 Integral or Remote (Hastelloy C)	69 bar @ 38°C (1000 PSI @ 100°F)	Hastelloy C and TFE
			13.8 bar @ 232°C (200 PSI @ 450°F)	
	13 Sanitary (Non- 3A Approved)	700-0201-019 Integral or Remote	13.8 bar @ 149°C (200 psi @ 300°F)	316/316L SS and TFE
	14 General purpose, low pressure	700-0202-002 Integral or Remote	3.4 bar @ 149°C (50 PSI @ 300°F)	316/316L SS and TFE
			1.4 bar @ 232°C (20 PSI @ 450°F)	
	15 Heavy Duty agitated tanks or material w/bulk density	700-0202-043 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	316/316L SS and TFE
			13.8 bar @ 232°C (200 PSI @ 450°F)	
	16 High integrity seal for hazardous materials	700-0002-360 Integral or Remote	34.5 bar @ 149°C (500 PSI @ 300°F)	PFA
	17 Sanitary low pressure	700-0202-029 Integral or Remote	34.5 bar @ 149°C (50 PSI @ 300°F)	316/316L SS and TFE
	18 Corrosive material, higher pressure with water like viscosity	700-0001-022 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	TFE
			34.5 bar @ 149°C (500 PSI @ 300°F)	
	19 Interface Measurement	700-0002-023 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	316/316L SS and TFE
			34.5 bar @ 149°C (500 PSI @ 300°F)	
	20 Miniature Pilot Plant Sensor	700-0209-002 Remote	69 bar @ 121°C (1000 PSI @ 250°F)	316/316L SS and TFE
			0 bar @ 232°C (0 PSI @ 450°F)	
	21 Heavy Duty agitated tanks or material w/bulk density and corrosive	700-0202-043 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	Hastelloy C and TFE
			13.8 bar @ 232°C (200 PSI @ 450°F)	
22 700-0202-043 with proximity plate	700-0202-044 Integral or Remote	69 bar @ 38°C (1000 PSI @ 100°F)	316/316L SS and TFE	
		13.8 bar @ 232°C (200 PSI @ 450°F)		
24 Inactive cable probe with active weight - liquids only	700-0005-485 Integral & 700-0005-285 Remote	200 psi @ 200°F	316/316L SS and FEP	
25 Inactive cable probe with active weight - corrosive liquids	700-0005-485 Integral & 700-0005-285 Remote	200 psi @ 200°F	Hastelloy C and FEP	
26 Extra heavy duty rear mount	700-0220-001 Remote	20 psi @ 180°F	316/316L SS and FEP	
27 Extra heavy duty	700-0221-002 Remote	50 psi @ 300°F	316/316L SS and FEP	
		20 psi @ 450°F		
28 General purpose very high pressure	700-1202-051 Remote	1500 PSI @ 250°F	316/316L SS and PEEK	
		500 psi @ 450°F		
High Pressure/ Temperature	60 High Pressure and High Temperature	700-0204-038 Remote	137.9 bar @ 93°C (2000 PSI @ 200°F)	316/316L SS and Ceramic
		68.9 bar @ 260°C (1000 PSI @ 500°F)		
	61 High Temperature	700-0204-002 Remote	1 psi @ 700°F	316/316L SS and Ceramic
	0 bar @ 816°C (0 PSI @ 1500°F)			
	62 Very high pressure - not for steam	700-0204-048 Remote	4000 psi @ 600°F	316/316L SS, Vespel and Ceramic
	64 High pressure and high temperature	700-0204-024 Remote	1000 psi @ 750°F	316/316L SS, Monel 400 and Alumina Ceramic
66 700-0204-002 with secondary seal - vertical only in liquids	700-0204-022 Remote	1000 psi @ 100°F	316/316L SS and Ceramic	
200 psi @ 800°F				
3A	67 700-3201 Series 3A Sanitary Probe	700-3201-001 Remote & 700-3201-002 Integral	13.8 bar @ 121°C (200 psi @ 250°F)	316/316L SS and PEEK
Retractable	72 Retractable, insulated center rod	700-0201-027 Integral or Remote	150 psi @ 300°F	316/316L SS and TFE
	73 Retractable, bare center rod	700-0201-028 Integral or Remote	150 psi @ 300°F	316/316L SS and TFE
Specialty	85 Leak detection	700-9000-494 Remote	0 psi @ 185°F	316/316L SS and TFE
	87 SIL floating roof and hydrocarbon liquids - 1.5"	700-0005-595 Integral	0 psi @ 185°F	Brass Polyolefin and FEP - 1.5 inch diameter probe
Integrated Ground Reference	90 Perforated concentric shield	700-0201-059 Integral or Remote	300 psi @ 300°F	316/316L SS and TFE
	91 General purpose with perforated concentric shield	700-1202-015 Remote & 700-1202-016 Integral	13.8 bar @ 232°C (200 PSI @ 450°F)	316/316L SS and PEEK
			1000 PSI @ 250°F	
	92 General purpose higher pressure with perforated concentric shield	700-1202-045 Remote	1000 PSI @ 250°F	316/316L SS and PEEK
			300 psi @ 450°F	
	93 General purpose very high pressure with perforated concentric shield	700-1202-055 Remote	1500 PSI @ 250°F	316/316L SS and PEEK
500 psi @ 450°F				
94 Miniature Pilot Plant Sensor with concentric shield	700-0209-024 Remote	69 bar @ 121°C (1000 PSI @ 250°F)	316/316L SS and TFE	
		0 bar @ 232°C (0 PSI @ 450°F)		

J:\Engineering\Projects\SIL2 - IntelliPoint\Technical Requirements Documents\Probe Addendum Comparison_06192019.xlsx

1.5 Dual Compartment Housing Detail


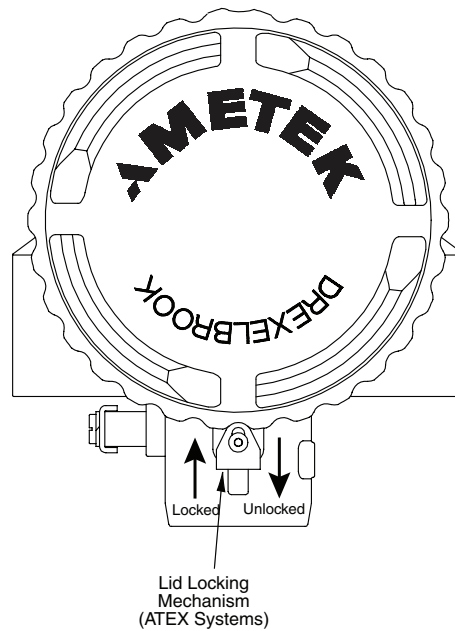


Figure 1-3
Dual Compartment Housing Detail

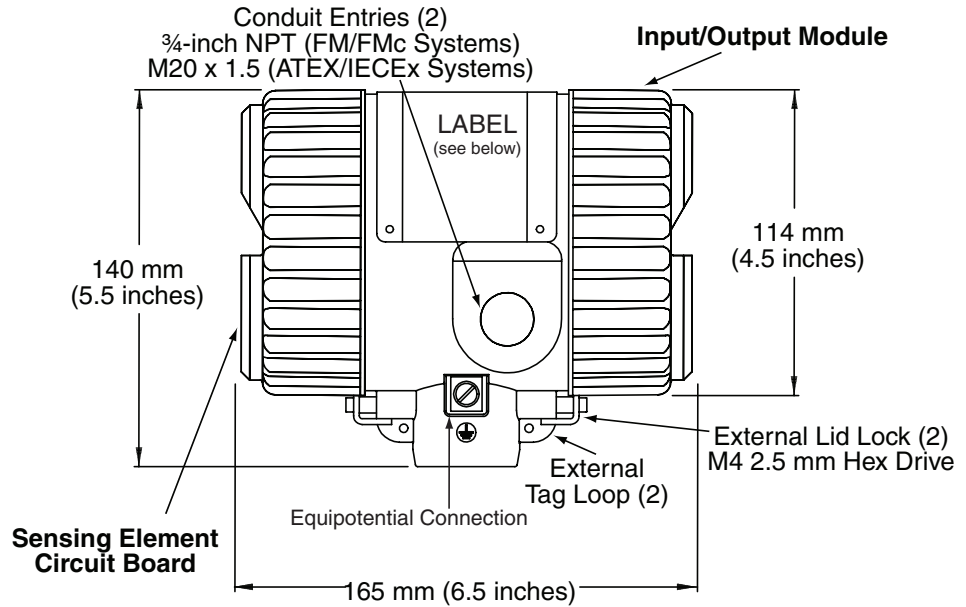

The Input/Output Module (IOM) is located on Customer Connection side; sensing element/circuit board are on opposite side.

Section 2: Installation

2.1 Unpacking

Carefully remove the contents of the shipping carton and check each item against the packing list before destroying any packing material. If there is any shortage or damage, report it to the factory immediately.

2.2 Mounting and Installation Guidelines



CAUTION:

The IntelliPoint RF instrument must be powered AFTER it is installed in the application and with material BELOW the sensing element.

The IntelliPoint RF instrument can be mounted vertically or horizontally at any angle. The mounting location should be as free as possible from vibration, corrosive atmospheres, and any possibility of mechanical damage. Ambient temperatures at electronics should be between limits as specified by control drawings in section 6.

The IntelliPoint RF instrument uses a dual compartment housing and a completely encapsulated input/output module to reduce the possibility that damage may occur from water migrating into the housing through the conduit. To further reduce the possibility of damage caused by water in the conduit, install a drip loop and breather drain to purge any accumulating

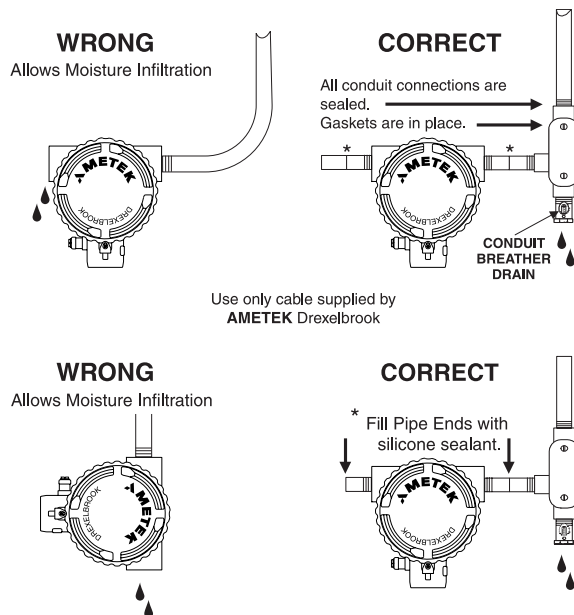


Figure 2-1
Recommended Conduit Connection

2.2 Mounting and Installation Guidelines (Continued)

moisture. *Refer to Figure 2-1.*

After system is installed and level is **below** the sensing element, apply power. The RF Series instrument automatically calibrates and is ready to detect change in level. If properly installed, the Green LED lights when power is applied. The Red LED should not be flashing. If the Red LED is flashing, refer to **Section 4: Troubleshooting**.



Cable fittings supplied are weather-resistant. They are NOT certified as explosion-proof (XP) or flameproof (d) unless they are specifically marked.

The IntelliPoint RF instrument is rated Intrinsically Safe (I.S.) when power is provided from an I.S. supply.



WARNING:

IntelliPoint RF equipment is rated explosion-proof. When installing in explosion hazardous areas [rated “potentially hazardous” (EU) or “hazardous classified” (USA)] observe all national and local regulations as well as specifications in the certificate.

Mount sensing element using the following installation guidelines. *See Figure 2-2.*

When installing IntelliPoint RF instrument, ambient temperature at electronics must not exceed 70°C (158°F).

When installing flange-mounted sensing elements, keep mating surfaces and bolts free of paint and corrosion to ensure proper electrical contact with vessel. Avoid using excessive amounts of Teflon™ tape when installing threaded sensing elements.

Install systems with threaded NPT connection via wrench flats on the process connection **ONLY**.

Locate sensing element to avoid enhancing electrostatic discharge from process medium, as is good practice with any thermowell, displacer, or sampler. This includes correct bonding to the tank or silo wall.

If installation area is rated explosion-proof and requires conduit seal fittings, they should be used in accordance with company

2.2 Mounting and Installation Guidelines (Continued)

standards and local codes.

Mounting sensing element inside a pipe is not recommended.

Do not mount a Cote-Shield sensing element through a nozzle that exceeds length of first insulator.

Ensure that there are no obstructions or agitator blades to interfere with sensing element.

Rigid sensing elements can be mounted either vertically or horizontally.



Do Not Shorten the sensing element without checking with the factory. 215-674-1234.



After the system has been installed, a proof test must be performed (See Section 4.2).

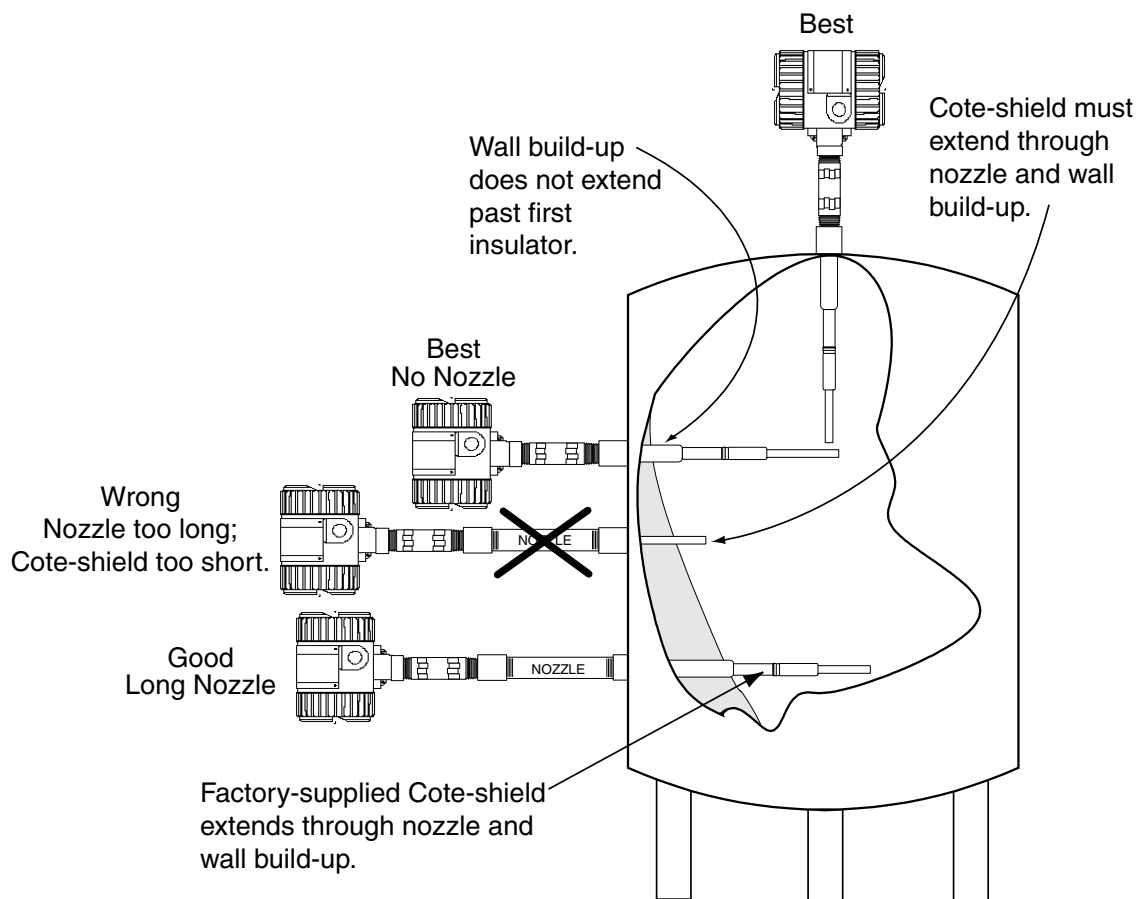


Figure 2-2
Installation Considerations

2.3 Input Wiring



WARNING:

If The IntelliPoint instrument is located in a hazardous environment, do not open the enclosure cover or make/break any electrical connections without first disconnecting electrical power at the source. Ensure that the wiring, electrical fittings and conduit connections conform to electrical codes for the specific location and hazard level.

The IntelliPoint RF instrument requires a 13-30 Vdc supply to operate. To access, remove the housing lid on the customer connections side to reveal the Input/Output Module (IOM). The IOM is an encapsulated assembly that contains the power supply, outputs and eight wiring terminals. IOM is held in

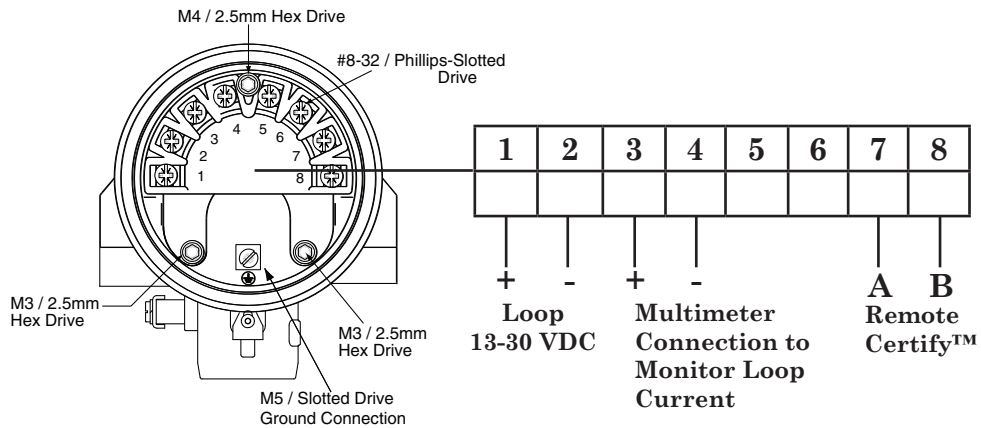


Figure 2-3
Input Wiring

place with three screws. *See Figure 2-3.*

2.4 Spark Protection

Applications involving insulating granulars and insulating liquids may produce a static discharge that can damage the electronics. The RF series instrument is supplied with integral heavy-duty spark protection to prevent static discharges from

damaging the electronic circuits.

2.5 Circuit Board

The circuit board is located on the sensing element/circuit side of the housing (marked on label). Remove the housing lid to access the status LEDs, time delay adjustment, and configuration jumpers. *See Figure 2-4.*

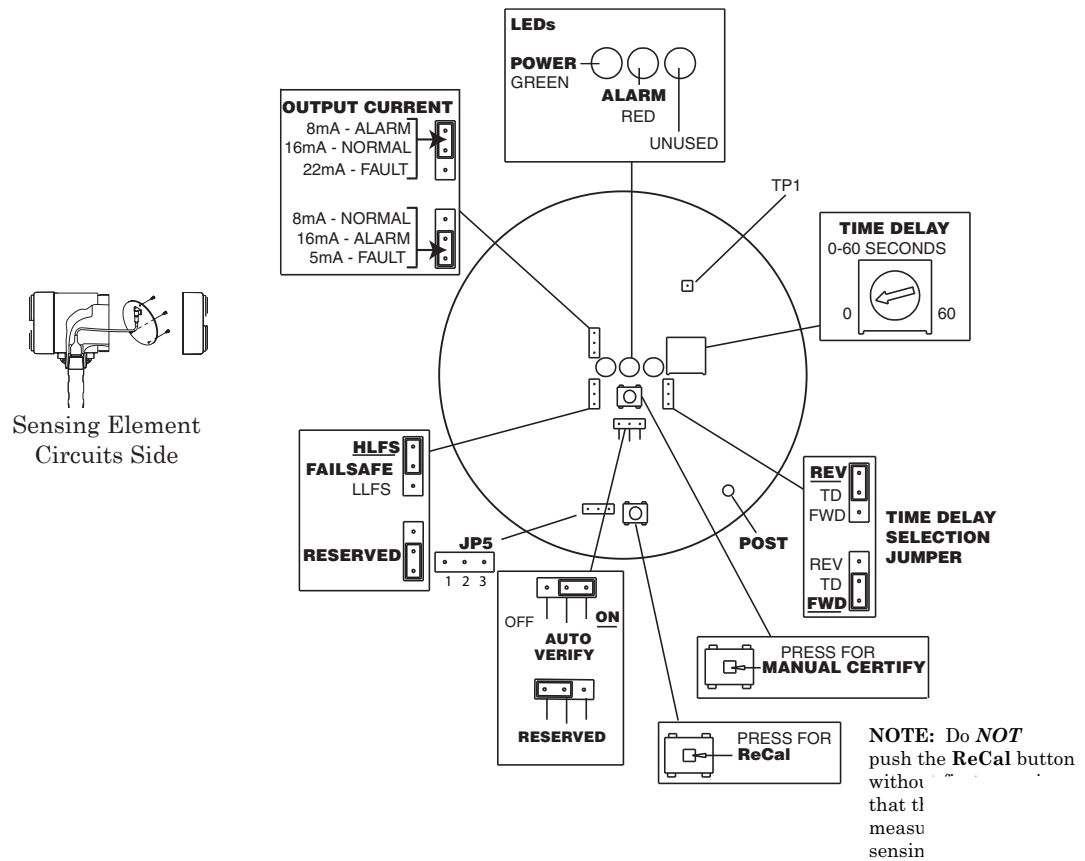


Figure 2-4
Circuit Board



Do **NOT** push the ReCal button without first ensuring the material being measured is below the sensing element

2.5.1 Time Delay

The "Time Delay" adjustment is located on the sensing element/circuit board side of the housing (marked on label). It is used to help stop an oscillating current output due to agitation or waves in the vessel. The time delay adjustment can be field adjusted from 0 to 60 seconds. The unit is shipped with the Time Delay set to zero (0) seconds.



The Time Delay adjustment is a 270-Degree turn pot and is at zero seconds when in the full counter-clockwise position. Do not force the pot past the stop or damage will occur.

2.5.2 Time Delay Action

"Time Delay Action" describes if loop current is delayed from going into alarm state or recovering after an alarm state.

- The Time Delay Action is field-selectable using the TD jumper on sensing element side of the housing.
- **FWD**: delays system from coming out of alarm.
- **REV**: delays system from going in alarm.
- The instrument is supplied with time delay action set in forward mode (**FWD**) position.

2.5.3 Failsafe

"Failsafe" describes the level condition that causes the transmitter to go into alarm.

- Safety Switches are only applicable to High Level Fail Safe (HLFS) applications. Fail Safe is factory pre-set and tamper proof sealed. This mode cannot be changed.

2.5.4 Current Output Assignment

The Output Current can be configured using the jumpers as follows:

- Jumper on pin #1 and #2:
8mA - Alarm, 16mA - Normal, 22mA - Fault
- Jumper on pin #2 and #3:
8mA - Normal, 16mA - Alarm, 5mA - Fault

2.5.5 Manual / Remote Certify™

The "Certify" test feature performs a confidence test of the system by duplicating the same signal as a high-level alarm condition without requiring the system to be removed from the tank. Simulating a high level with the Manual/Remote Certify feature:

- Checks the AutoVerify™ and system circuits to ensure proper operation.
- Checks the integrity of the wiring connections.
- Verifies that the sensing element is working properly.

The "**Manual Certify**" test is initiated with the press of the Manual Certify Button located on the sensing element / circuit side of the housing.

The "**Remote Certify**" test is initiated by creating a momentary short between contacts 7 and 8 located on the power supply side of the housing. This can be done with a push button or relay closure.

After initializing the Certify test, the green LED flashes for 5 seconds and the red LED will illuminate. The current moves to the alarm condition for 2 seconds. If the red LED does not turn on, and the current does not move to the alarm condition, the Certify has detected a fault. ***Consult Section 4: Troubleshooting.***

2.5.6 AutoVerify™

"AutoVerify" is a self-testing function that continuously checks the system for proper operation when the unit is in the High Level Failsafe (HLFS) mode and in normal condition.

The Safety IntelliPoint switch is shipped with AutoVerify Enabled and tamper sealed.

AutoVerify Can Not be Disabled on the Safety IntelliPoint.

If a fault is detected during the AutoVerify cycle, both LEDs will flash alternately, and the current will go to the fault output of 5mA or 22mA.

AutoVerify Criteria

- 1.. In order for the Safety IntelliPoint to correctly detect a disconnected sensor, the active sensor length (active length = insertion length – cote shield length) must be greater than 24 inches (610 mm).
2. Consult Factory for specialty sensors that may be available for shorter length requirements.

2.5.7 Periodic Testing Requirement

The intent of periodic testing is to ensure the SIS continues to function according to design requirements. Periodic testing intervals should be calculated during the SIF design verification. This time interval must be made part of the maintenance procedure for this process.

2.5.8 Re-Calibration



Do not push the "ReCal" Button without first ensuring the IntelliPoint is properly installed and is below the sensing element.

If reset is unsuccessful a red LED will flash. The system is now ready for installation.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Nonvolatile Memory

The IntelliPoint has nonvolatile memory, allowing the unit to re-start after power outages without recalibrating.

When unit is powered for the first time the internal microprocessor records and stores the "Air" value. This is the uncovered value of the sensor mounted in the vessel. The unit will also store the last covered value and the last uncovered value.

Whenever the unit is powered it uses these values as a reference point to determine its current condition (normal or alarm).

2.5.8 Re-Calibration (Continued)

The nonvolatile memory will retain the recorded values even if power is lost for months. When the unit regains power, the microprocessor compares the stored values to the current measured value. Then determines its current status.

The setpoint is stored in memory to indicate the last status of the switch. So, when the unit regains power the microprocessor reads the current value of the sensor and determines the status based on the stored values. It will only re-calibrate if the re-call button is pressed.

2.6 Output & Status LEDs



There are two status LEDs located on the sensing element/circuit board side of the housing. One is used to indicate that the unit has power. The second LED is used to indicate the status of the unit: **Normal** or **Alarm**. See *Figure 2-5*.

Second Red LED is not used on the two wire transmitter.

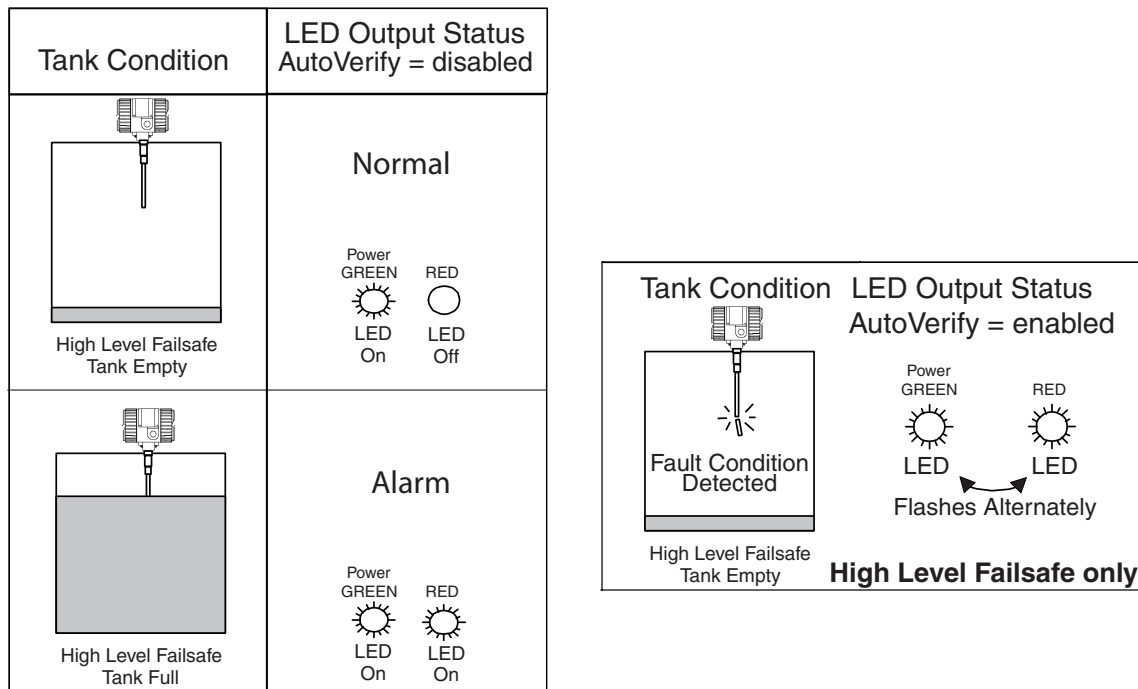


Figure 2-5
Output and LED Status

2.7 Sensing Element Connection

Sensing element connects to the rear side of the circuit board and is factory-installed.



The sensing element is sealed to the housing and cannot be removed without permanent damage.

For IntelliPoint RF instruments that are mounted remotely from the sensing element, an additional housing with terminals is provided to connect the cable from the sensing element. This housing is factory wired to the Intellipoint circuit board. **See Figure 2-7.** Connect Green (Ground) wire to green screw, Red (Shield) wire to red screw, and Blue (Center) wire to blue screw.


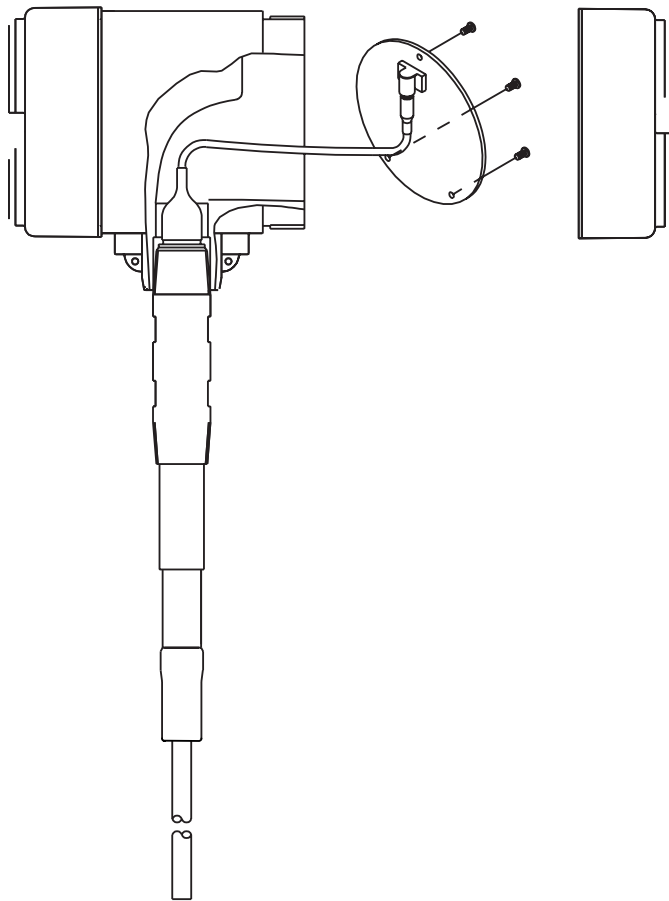


Figure 2-6
Sensing Element Connection (Integral Mounting)

2.7 Sensing Element Connection (Continued)





See Section 6.5 for Spark Protection, Mounting and Wiring




Housing and Bracket are shown rotated 90° for clarity.

G=Ground
S=Shield
C=Center

3 TERMINAL PROBE (TYP)

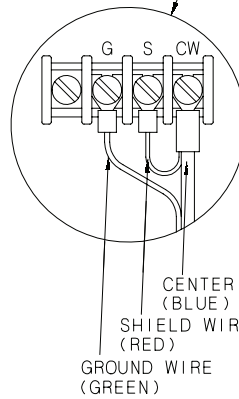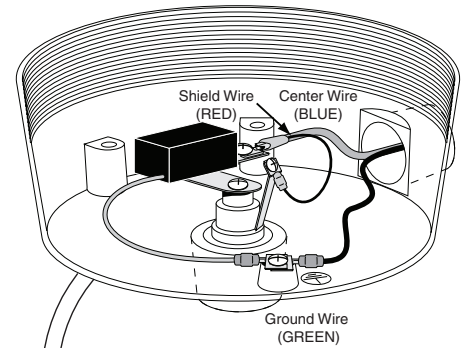

2 TERMINAL PROBE (TYP)

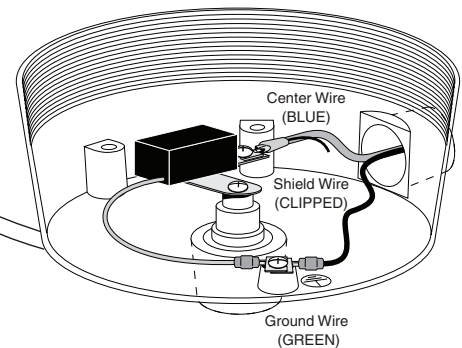

SHIELD WIRE MUST BE CLIPPED BY USER
CLIPPED SHIELD WIRE MUST NOT TOUCH CONDULET HOUSING



After the system has been installed, a proof test must be performed (See Section 4.2).



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Figure 2-7
Sensing Element Connection (Remote Mounting)

2.8 Calibration



The IntelliPoint™ model RNT (Standard Sensitivity) and RHT (High Sensitivity) feature Auto-Cal calibration. Auto-Calibration is suitable for liquid and slurry applications.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

2.8.1 Using the IntelliPoint with Auto-Calibration

After the IntelliPoint is installed in the vessel with material below the sensing element, simply apply power. The IntelliPoint electronic unit will auto calibrate.



Caution – The material being measured must be below the sensing element when power is applied (Sensing element uncovered).

Calibration is complete.

If power has been applied to the IntelliPoint prior to installation (on a test bench) or, if the IntelliPoint is moved from one vessel to another, RECAL is necessary for the unit to capture the new air value.

After the IntelliPoint has been installed with the measured material below the sensing element, press and hold the "ReCal" button (shown in *Figure 2-4*) for five (5) seconds. After five seconds, the two LED's flash for sixty seconds before reset occurs.

2.8.2 IntelliPoint Calibration Mode Change

The IntelliPoint was shipped in a calibration mode that was determined to meet the needs of the application for which it was originally sold. If, for some reason, the IntelliPoint is used on a different application, or for other reasons it is determined that a different calibration mode should be used, use the following procedure to make a calibration mode change.

2.8.2 IntelliPoint Calibration Mode Change (Continued)

Each IntelliPoint has 4 different Calibration Modes that are available, dependant on the model purchased.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

2.8.3 Available IntelliPoint calibration modes:

Standard Sensitivity systems (RL, RN, RT, RV model series prefix):

Mode 1: Auto-Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 2: Fixed Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.

Mode 3: Auto-Cal 10 pF.

This mode provides a 10 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 4: Fixed Cal 10 pF.

This mode provides a 10 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

High Sensitivity systems (RH, RP model series prefix):

Mode 1: Auto-Cal 0.5 pF.

This mode provides a 0.5 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 2: Fixed Cal 0.5 pF.

This mode provides a 0.5 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.

2.8.2 IntelliPoint Calibration Mode Change (Continued)

Mode 3: Auto-Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint varies depending on material and coating deposit changes.

Mode 4: Fixed Cal 2 pF.

This mode provides a 2 pF preload; alarm setpoint is locked to starting capacitance value recorded at system start-up.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Calibration Mode changes



Mode Selection change must be performed with the sensing element in air (Material below sensing element).

1. On the RF circuit board (**Figure 2-8**), temporarily remove the shunt jumper from the “Time Delay Selection Jumper” and place it on pins 1 & 2 of JP5. The green LED will go out, and the red LED’s will begin to flash. The number of flashes indicates which mode the unit is in: 1, 2, 3, or 4.
2. To change modes, press and hold the ReCal button (next to JP 5). The unit will cycle through the modes: first it will flash one time – then pause, this indicates mode #1. It will then flash twice then pause, indicating mode #2, then mode #3, etc. It will scroll through all 4 modes then start over again at mode #1. Release the button when it reaches the desired mode. The LED’s will now flash the number of times indicating which mode has been selected.
3. Remove the shunt from pins 1 & 2 of JP5 and replace it on the “Time Delay Selection Jumper” pins from which it was removed. The unit will remain in the new selected calibration mode. Put the lid back on the housing securely.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

2.8.2 IntelliPoint Calibration Mode Change (Continued)

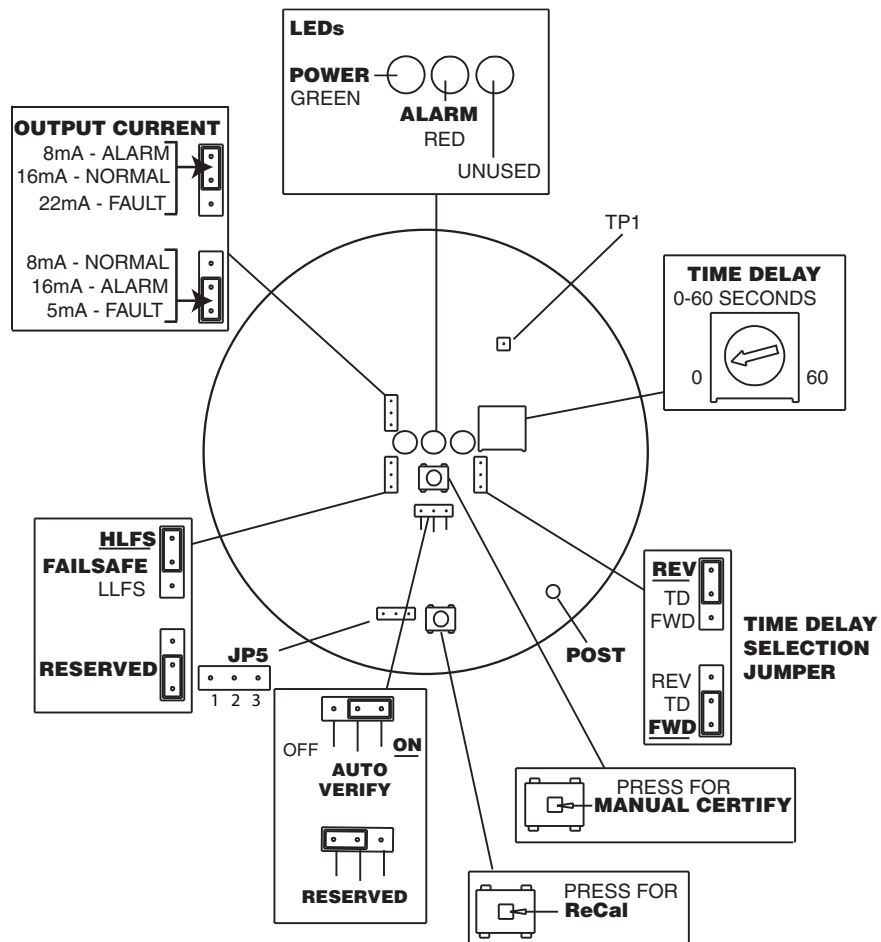


Figure 2-8
Circuit Board

Section 3: Spare Parts List

O-ring 250-1-75

Housing ¼-Inch NPT Conduit Entry 260-2-540

Housing M20 Conduit Entry 260-2-542

Input/ Output Module..... 385-48-6

Input/ Output Module, Gold Relay 385-48-18

Circuit Board

 RLT - 2pf Fixed Calibration 385-48-003-FT2

 RHT - Auto Calibration (0.5pf)..... 385-48-19-HT1

 RNT - Auto Calibration (2pf)..... 385-48-19-003-NT1

 RPT - 0.5pf Fixed Calibration 385-48-19-PT2

 RTT - Auto Calibration (10pf) 385-48-3-QT3

 RVT - 10pf Fixed Calibration 385-48-3-VT4

Integral Sensing Element Cable (PEEK Probes) 380-9000-97

Integral Sensing Element Cable (All Other Probes)..... 380-9000-99

Section 4: Troubleshooting



WARNING:

If The IntelliPoint instrument is located in a hazardous environment, do not open enclosure cover or make/break any electrical connections without first disconnecting electrical power at the source. Ensure that wiring, electrical fittings and conduit connections conform to electrical codes for the specific location and hazard level.

4.1 RF Point Level Troubleshooting Guide

Symptom	Possible Cause	Solution	See Section
Switch is in alarm and will not clear	Sensor is coated by a conductive material and the Cote-Shield™ element does not extend far enough into the vessel	Need a sensor with a longer Cote-Shield element. Rule of thumb is nozzle length + expected wall coating + 2 inches.	Section 2.2, 4.5
	Fail Safe switch is set to the wrong setting	Check to make sure the fail safe switch is in the correct position	Section 2.6.3
	Active section of sensor is touching an internal structure or material is bridging active to ground.	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A Section 2.2, 4.5
	Connection cable or harness between unit and sensor is damaged	Check connection cable for shorts, opens, or damage and proper termination	Section 4.7, 4.6
	Flexible sensor is swaying and active is touching vessel or structure	Add 1 or 2 seconds of reverse acting time delay.	Section 2.6.2
Switch stays in alarm for extended period after level falls below sensor	Material bridging from active to tank structure	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A Section 2.2, 4.5
	Time delay may be active	Make sure time delay pot is full counterclockwise.	Section 2.6.2
Switch does not respond to material	There may not be enough active to detect an insulating material	Change to high sensitivity or adding active length to sensor	Consult Factory Section 4.9, App. A
	Switch was calibrated with sensor covered by material	Make sure material level is below sensor and re-calibrate	Section 2.6.7
	Granular material – Active section is not getting enough coverage due to angle of repose	Relocate sensor to get more coverage or lengthen active. Changing to high sensitivity may also help.	Appendix A
	Connection cable or harness between unit and sensor is damaged	Check connection cable for shorts, opens, or damage and proper termination	Section 4.6, 4.7
Switch delays in responding to material	Reverse acting time delay may be active	Check time delay settings to make sure they are correct	Section 2.6.2
LED's are Flashing	Flashing LED's indicate one of three things. Over Range / Under Range / fault	Consult instruction manual to determine which of the three symptoms are experienced.	Section 4.3, 4.4, 2.7
Over Range indicates that the standing capacitance of the sensing element in the vessel is too large to allow calibration	A long sensing element may generate too much standing capacitance to calibrate	Additional capacitance must be added to the calibration range (padding)	Section 4.9 Consult Factory
	The sensor could be touching an internal tank structure	May be able to shorten sensor (consult factory) or relocate sensor.	Appendix A
	Switch was calibrated with sensor covered by material	Make sure material level is below sensor and re-calibrate	Section 2.6.7
	Improper wiring connection (Remote Switches)	Check remote cable connections to confirm they are correct.	Section 2.8
Under Range indicates that the electronic unit is not seeing enough capacitance.	Sensing Element is Disconnected	Verify sensing element cable connections. Test cable continuity.	Section 4.6, 4.7
	Unit is damaged	Consult factory	Section 4.9
Fault Indicates the Auto-Verify feature has detected a problem.	Sensing Element is Damaged	Check Sensing Element for Damaged	Section 2.6.6
	Center wire to shield short	Check cable & sensor	Section 4.5, 4.6, 4.7
	Connecting Cable is Damaged	Check connection cable for damage, shorts, and proper termination	Section 4.6, 4.7
	Electronic Unit is damaged	Consult factory	Section 4.9
Green Power LED is out	Electronic unit is not getting power	Check power source to make sure proper power is supplied and connections are correct	Section 2.4
	Electronic Unit is damaged	Consult factory	Section 4.9

4.2 Testing Electronic Unit



This test is only a test of the electronic unit for troubleshooting purposes, and does not serve as a Verify or Certify test of the complete system.




Proof test must be performed to certify proper operation for SIL performance. Reference Appendix B in the EXIDA Failure Modes, Effects and Diagnostic Analysis located on the Drexelbrook.com website under support/documentation.



A full system proof test must be performed when:

- Any system component is changed or replaced by the user.
- Any system component or setting is modified by the user.

Use the following steps to test the electronic unit:



1. Be sure the environment is safe before removing the lid from the housing.
2. If possible to access the sensing element with the material below the sensor, or remove the IntelliPoint from the vessel, use your finger to touch TP1 (Shown in Figure 2-4) while holding any bare metal portion of the instrument housing with the other hand. The system should go to its high level state.
3. Again with no material touching the sensing element, touch the tip of the sensing element with your finger, while holding any bare metal portion of the instrument housing with the other hand. The system should go to its high level state.
4. If the IntelliPoint changes to the high level state while touching test point TP 1, but not when touching the tip of the sensor, in most cases, the interconnecting cable is faulty. **See Section 4.6: Testing Integral Cable, or Section 4.7 Testing Remote Cable.**
5. If The IntelliPoint is stuck in one state:
 - A. Remove power.
 - B. Disconnect coax cable that joins sensing element to electronic unit.
 - C. Apply power.
 - D. Repeat steps 3 and 4.
 - E. If The IntelliPoint changes state with sensing element disconnected, in most cases, sensing element is faulty. **See Section 4.5: Testing Sensing Element.**
6. If there was no action in any of steps 2, 3, or 4:
 - A. Remove and then reapply power.
 - B. Press **ReCal** Button (**Shown in Figure 2-4**).
 - C. Observe that green LED flashes for about 60 seconds.
 - D. Green LED should be lit after 60 seconds.
 - E. Touch test point (**Shown in Figure 2-4**) with your finger.
 - F. Alarm & Loop Current should change state. If so, circuit board is working properly.
 - G. Reinstall instrument and press **ReCal** Button.
7. If The IntelliPoint fails all of above tests, in most cases instrument is faulty. Use a replacement Input/Output Module (**IOM**) or circuit board to determine fault. **Consult factory.**



4.3 Over Range

If the Red LED is flashing quickly (4 times/second), IntelliPoint has detected that uncovered sensing element capacitance exceeds limits of transmitter. Consult factory for pad capacitor values and instructions.

4.4 Under Range

If the Red LED is flashing slowly (once per second), IntelliPoint has detected that pad capacitor value is too large or a center wire to Cote Shield short. Consult factory for pad capacitor values.

4.5 Testing The Sensing Element

Integral electronics, *Ref figure 4-1:*

Remove Sensing Element Circuit Board and disconnect cable from circuit board

Remote electronics, *Ref figure 4-2*

Disconnect remote cable at the sensing element.

1. With the sensing element in the vessel, verify level is below the sensing element
2. Use an analog ohmmeter¹ that is set to the R x 1K ohm scale, measure the resistances between each pair of sensing element connections. *Ref Figure 4-1 & 4-2.* Record values in Table 4.1
 - a. If the process material is conductive, it is normal to measure some resistance between sensing element connections. The lowest permissible resistance values are:

Center Wire to Ground	1000 ohms.
Center Wire to Shield	600 ohms.
Cote Shield to Ground	300 ohms.
 - b. If all measurements are open circuit the sensing element has passed the test. If lower resistance was measured continue with testing.
3. Clean sensing element and repeat resistance measurements with the sensing element external to the vessel.
 - a. A clean sensing element should measure an open circuit on all resistance tests.
 - b. If the resistance values increase to an open circuit the resistance was installation or coating related. The most common causes are:
 - i. Cote Shield element does not extend sufficiently into

4.5 Testing The Sensing Element (Continued)

- the vessel. Verify the CoteShield element extends at least 2" into the vessel and past wall build-up.
- ii. Extremely conductive coating on the sensing element. This may require changing the sensing element or electronics. Contact the factory for recommendations.
 - iii. Sensing element is touching vessel. A resistance reading of less than 10 ohms to ground (sensing element housing or tank) is usually due to a metal-to-metal short circuit. Verify that the sensing element is not touching any vessel structure.
- c. If the sensing element still shows resistance between terminals of less than 10K ohms, it is possible that moisture is present internal to the sensing element. It may be possible to dry the sensing element until the resistance increases to a value in excess of 10K ohms. However this is an indication the integrity of the sensing element has been compromised. Contact the factory for recommendations.

¹ A digital ohmmeter will often produce a resistance measurement that is higher than the actual value.

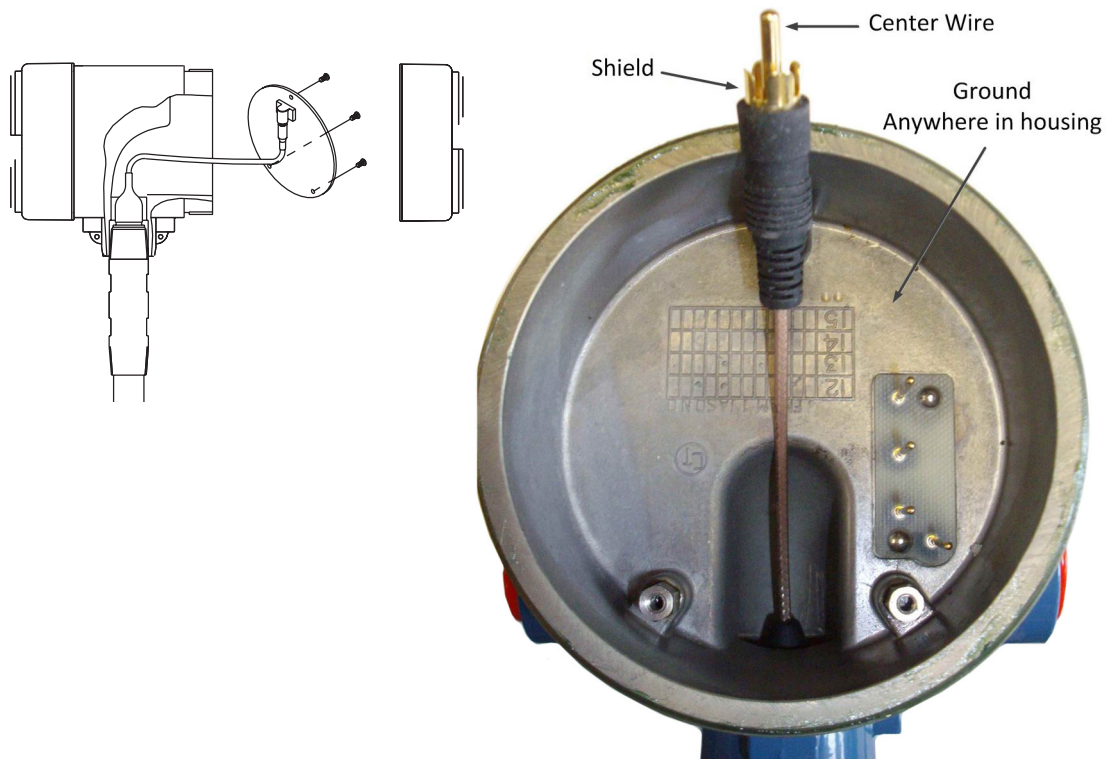
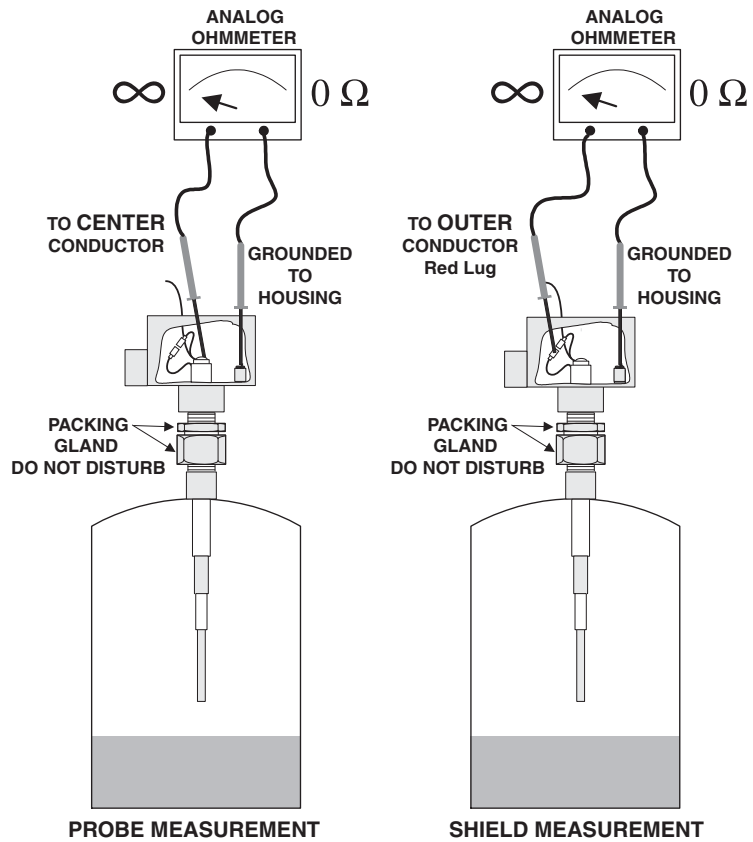


Figure 4-1
Checking the Sensing Element

4.5 Testing The Sensing Element (Continued)



*Figure 4-2
Checking the Sensing Element
Center = Probe
Outer = Shield
Housing = Ground*

Sensing Element in Vessel		
Center Conductor to Housing	_____	Ohms
Center Conductor to Cote Shield	_____	Ohms
Cote Shield to Housing	_____	Ohms
Sensing Element Cleaned		
Center Conductor to Housing	_____	Ohms
Center Conductor to Cote Shield	_____	Ohms
Cote Shield to Housing	_____	Ohms

Table 4-1

4.6 Testing the Integral Cable

1. Disconnect integral cable from electronic.
2. Check for continuity.
 - a. Using an ohmmeter measure the resistances.
 - i. From the center wire connection on the RCA plug to the sensing element active section (center wire)
 - ii. From the shield connection on the RCA plug to the sensing element shield.
 - iii. If the resistance is greater than 5Ω the cable has failed.
3. Check for shorts.
 - a. The integral cable is tested as part of sensing element test, section 4.5.

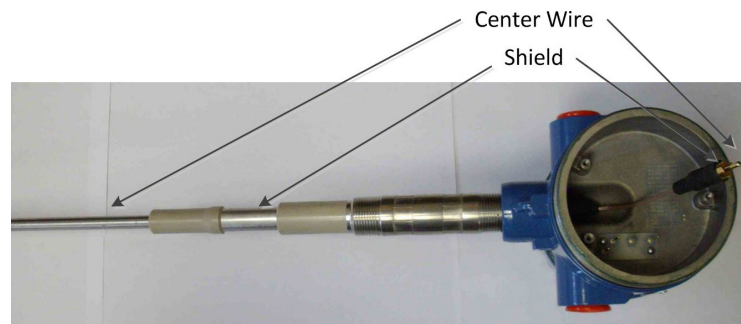


Figure 4-2
Testing Integral Cable

4.7 Testing the Remote Cable

1. Disconnect remote cable from electronic unit and sensing element.
2. Using an ohmmeter measure the resistances as shown in Figure 4-3
 - a. Check for shorts.
 - i. Connect ohmmeter to cable center wire and ground wire. Measure resistance as shown.
 - ii. Move ohmmeter leads and repeat for all measurements shown.
 - iii. If the resistance is less than 100 k-ohms cable has failed
 - b. Check for continuity.
 - i. Short center wire to ground wire and measure resistance as shown. Should be close to 0 ohms
 - ii. Short center wire to shield and repeat.
 - iii. If the resistance is greater than 10 ohms cable has failed

4.7 Testing the Remote Cable (Continued)

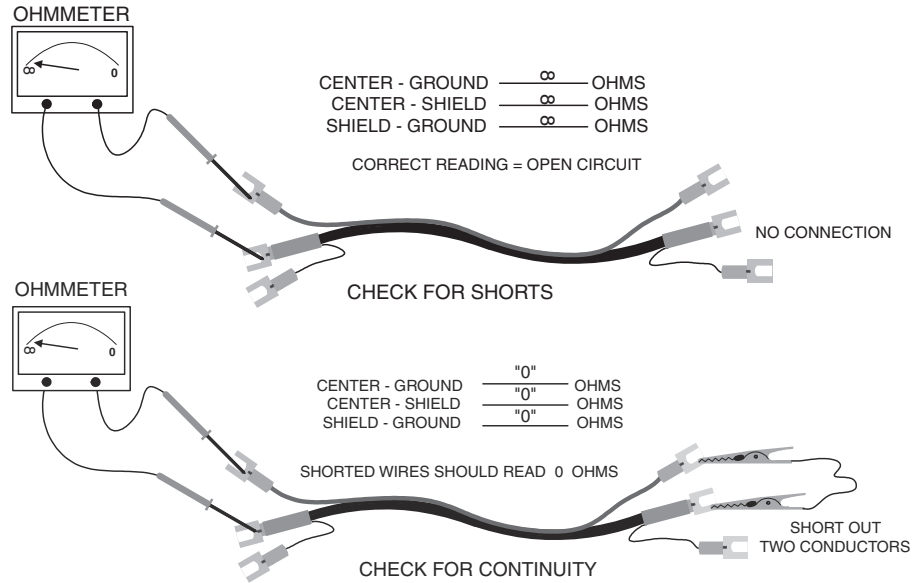


Figure 4-3
Testing Remote Cable

4.8 Testing the Power Supply

Power supply can be tested separately as follows:

1. Remove power from electronic unit.
2. Remove three screws holding circuit board into housing.
3. Disconnect sensing element connection. **See to Section 2.8 Sensing Element Connection.**
4. Reapply power.
5. Using a DC voltmeter, measure voltage from -5 to Common and +5 to Common. Correct readings are -5 to -6 and +5 to +6 Vdc. **See Figure 4-4**

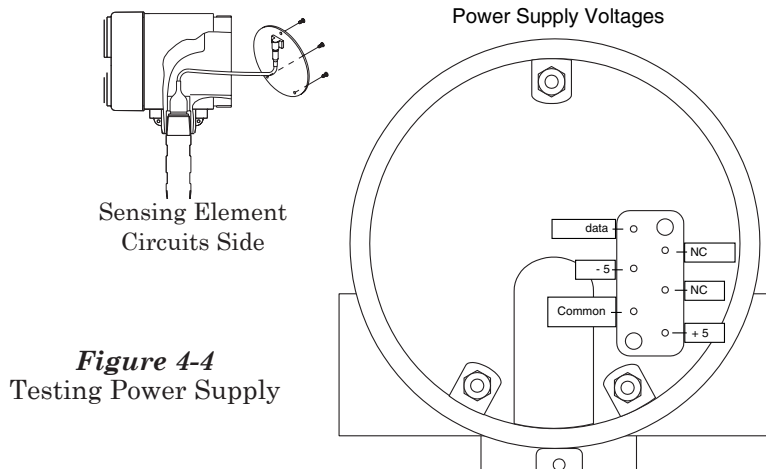


Figure 4-4
Testing Power Supply

4.9 Factory Assistance

AMETEK Drexelbrook can answer any questions about The Intellipoint series instrument. Call Customer Service at +1 215 674-1234.

If you require assistance and attempts to locate the problem have failed:

Contact your local Drexelbrook representative,



Telephone the Service department: +1 215 674-1234

FAX: Service Department + 215-443-5117

E-Mail: drexelbrook.service@ametek.com

Please provide the following information:

- Instrument Model Number
- Sensing Element Model Number and Length
- Original Purchase Order Number
- Material being measured
- Temperature
- Pressure
- Agitation
- Brief description of the problem
- Checkout procedures that have failed

4.10 Field Service

Trained Field Service Engineers are available on a time-plus-expense basis to assist in start-ups, diagnosing difficult application problems, or in-plant training of personnel. Contact the service department for further details.

4.11 Customer Training

Periodically, AMETEK Drexelbrook instrument training seminars for customers are held at the factory. These sessions are guided by Drexelbrook engineers and specialists, and provide detailed information on all aspects of level measurement, including theory and practice of instrument operation. For more information call AMETEK Drexelbrook, Customer Service at 215-674-1234.

4.12 Equipment Return

In order to provide the best service, any equipment being returned for repair or credit must be pre-approved by the factory.

In many applications, sensing elements are exposed to hazardous materials.

- **OSHA mandates** that our employees be informed and protected from hazardous chemicals.
- **Material Safety Data Sheets (MSDS)** listing the hazardous materials to which the sensing element has been exposed **MUST** accompany any repair.
- It is your responsibility to fully disclose all chemicals and **decontaminate** the sensing element.



To obtain a return authorization (RA#), contact the Service department at + 215-674-1234.

- Please provide the following information:
- Model Number of Return Equipment
- Serial Number
- Original Purchase Order Number
- Process Materials to which the equipment has been exposed.
- MSDS sheets for any hazardous materials
- Billing Address
- Shipping Address
- Purchase Order Number for Repairs
- Please include a purchase order even if the repair is under warranty. If repair is covered under warranty, you will not be charged.

Ship equipment freight prepaid to:

AMETEK-DREXELBROOK.
205 KEITH VALLEY ROAD
HORSHAM, PA 19044-1499
COD shipments will not be accepted

Section 5

Section 5: Specifications

Technology:	RF/Capacitance
Safety:	SIL 2, IEC61508-2, ed2, 2010 (EXIDA)
Calibration:	None
Modes of Operation:	High Level Fail Safe
Repeatability:	2mm (0.08 inch) conductive liquids
Response Time:	Less than 1 second
Time Delay:	0 to 60 seconds forward and reverse acting
Ambient Electronics:	-30 to 70°C (-22 to 158°F) ATEX/IECEX -40 to 70°C (-40 to 158°F) FM
Storage Temperature:	-40 to 85°C (-40 to 185°F)
Indicators:	LEDs: Green Power, Red Alarm Status
Self-Check:	Continuous AutoVerify and Manual Certify
Power Supply:	13 to 30 VDC <i>Note: The minimum supply voltage at the transmitter terminal is:</i> 13 VDC at 22mA (Fault) 19 VDC at 5mA (Fault)
Power Consumption:	1 watt maximum
Output:	8 mA - Alarm 16 mA - Normal 22 mA - Fault (or field-selectable) 8 mA - Normal 16 mA - Alarm 5 mA - Fault
Housing (Electronics):	Dual Compartment, powder-coated aluminum with two cable entries
Cable Entry:	M20 x 1.5 ATEX/IECEX ¾-inch NPT FM/FMc
Ingress Protection:	IP66 NEMA 4X

5.1 Approvals



The IntelliPoint RF Point Level System Transmitter has been evaluated as Explosion-proof for use in Class I, Division 1, Groups A, B, C, and D, Dust-Ignition proof for use in Class II and III, Division 1, Groups E, F, and G; Non-incendive for use in Class I, Division 2, Groups A, B, C, and D; Suitable for use in Class II and III, Division 2, Groups F and G Hazardous (Classified) Indoor and Outdoor (Type 4, 4X, IP66) Locations with Intrinsically Safe connections to Class I, II, and III, Division 1, Groups A, B, C, D, E, F, and G Hazardous (Classified) locations in accordance with control drawing 420-0004-144-CD for the RxLx and SxRxL Series and Control Drawing 420-0004-173-CD for the RxTx and SxRxT Series; Intrinsically Safe for use in Class I, II, and III, Division 1, Groups A, B, C, D, E, F, and G hazardous (Classified) locations in accordance with entity requirements and control drawing 420-0004-173-CD.

ATEX (FM14ATEX0049X)

Integral II 1 G Ex ia IIC T5... T2 $-30^{\circ}\text{C} \leq \text{TAMB} \leq +70^{\circ}\text{C}$; IP66
 II 1 D Ex ia IIIC T90°C $-30^{\circ}\text{C} \leq \text{TAMB} \leq +70^{\circ}\text{C}$; IP66

Temperature Class	Process Temperature
T5	100°C
T4	135°C
T3	200°C
T2	230°C



Remote II 1 G Ex ia IIC T5... T2 $-30^{\circ}\text{C} \leq \text{TAMB} \leq +70^{\circ}\text{C}$; IP66
 II 1 D Ex ia IIIC T90°C $-30^{\circ}\text{C} \leq \text{TAMB} \leq +70^{\circ}\text{C}$; IP66

IECEX (FTZU 18.0007X)

Ex ia IIC T5 Ga
 Ex ia IIIC T90°C Da
 $-30^{\circ}\text{C} \leq \text{Ta} \leq 70^{\circ}\text{C}$



Reference control drawing 420-0004-562-CD for entity and installation requirements

Special Condition for Safe Use


1. THE EQUIPMENT SHALL NOT BE APPLIED IN AN EXPLOSIVE DUST ATMOSPHERE WHERE HIGH ELECTROSTATIC CHARGING PROCESSES ARE PRESENT THAT COULD RESULT IN PROPAGATING BRUSH DISCHARGES.
2. CONSULT THE MANUFACTURER IF DIMENSIONAL INFORMATION ON THE FLAMEPROOF JOINTS IS NECESSARY.
3. AMBIENT TEMPERATURE RANGE:
 -30°C TO $+58^{\circ}\text{C}$ FOR RXLX/SXRXTX INTELLIPOINT RF LEVEL SYSTEM
 -30°C TO $+70^{\circ}\text{C}$ FOR RXTX/SXRXTX INTELLIPOINT RF TWO-WIRE POINT LEVEL SYSTEM

Section 6

Section 6: Control Drawings

6.1 FM / FMc Control Drawings


NO. 420-0004-173-CD SHT 1 OF 16

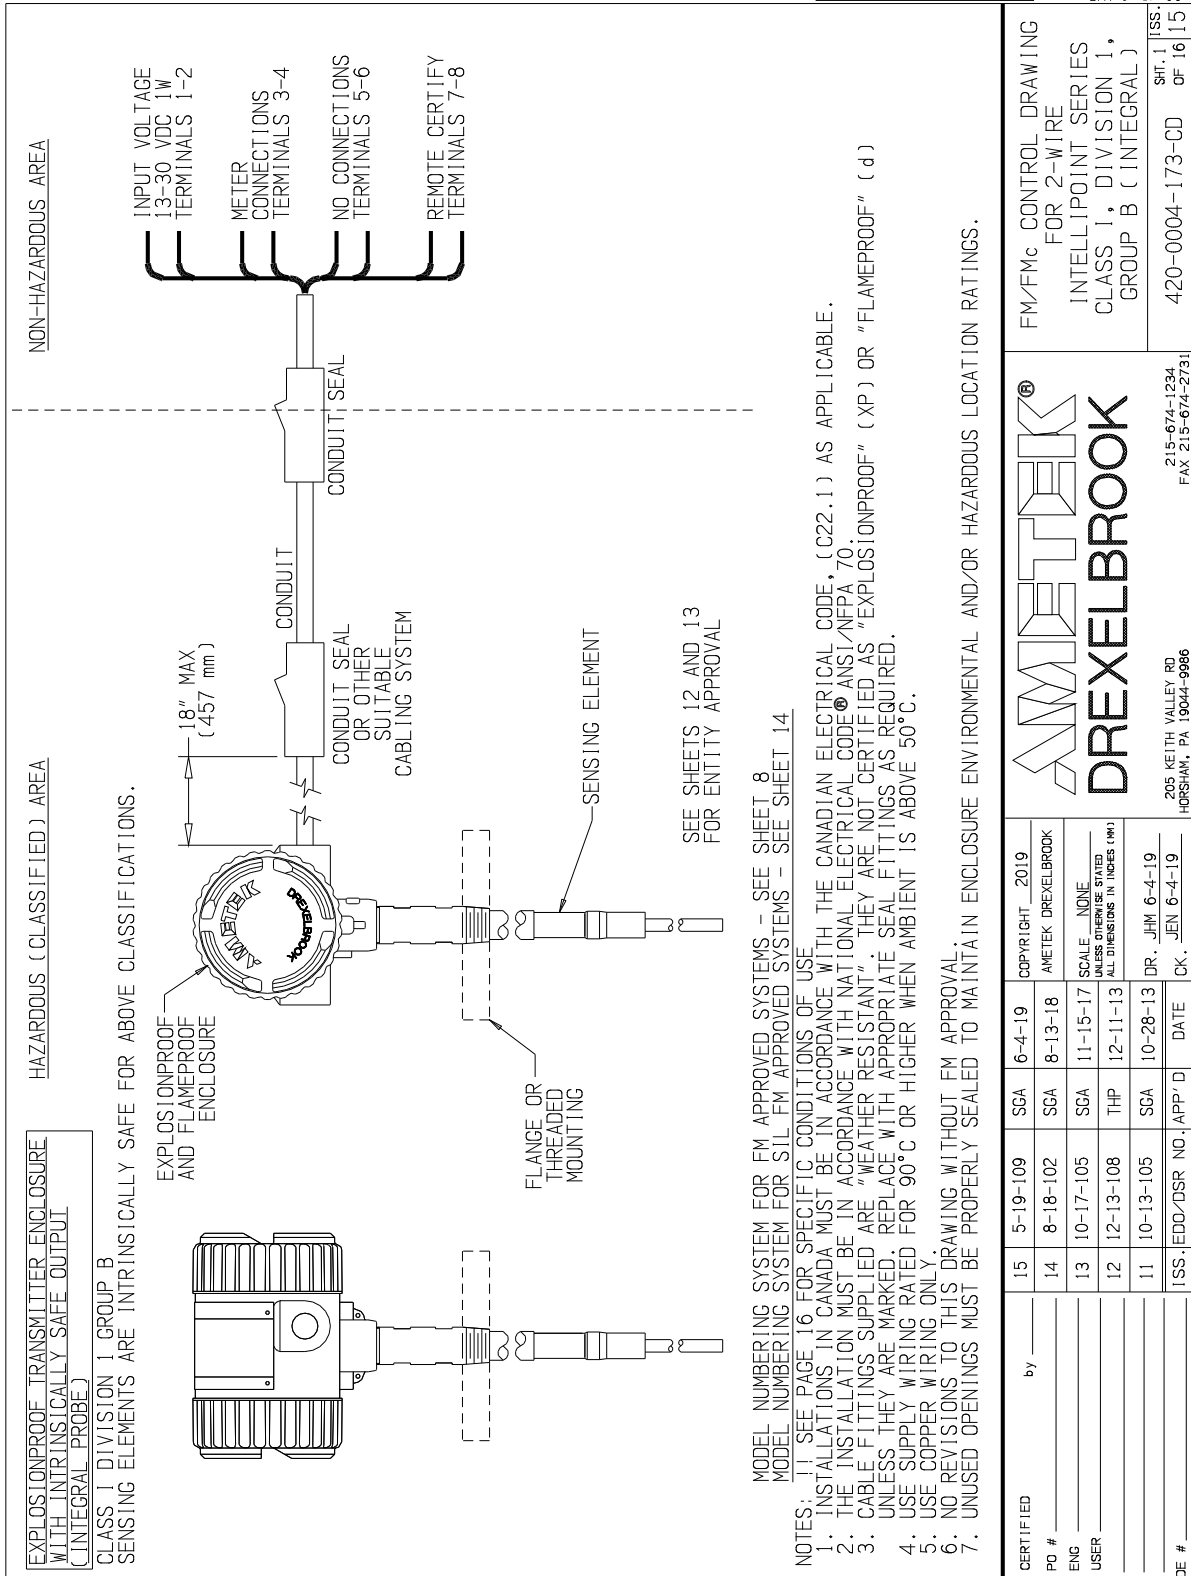

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 14


NOTES: 1) SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
 1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
 2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70)
 3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d)
 UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 5. USE COPPER WIRING ONLY.
 6. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED		by		15	5-19-109	SGA	6-4-19	COPYRIGHT	2019	FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS 1, DIVISION 1, GROUP B (INTEGRAL)	
PO #	14	8-18-102	SGA	8-13-18	AMETEK DREXELBROOK		215-674-1234 FAX 215-674-2731		SHT. 1 OF 16		
ENG	13	10-17-105	SGA	11-15-17	SCALE NONE		205 WETH VALLEY RD HORSHAM, PA 19044-9966		ISS.		
USER	12	12-13-108	THP	12-11-13	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)		DR. JHM 6-4-19		OF 16		
DE #	11	10-13-105	SGA	10-28-13	DR.	JHM	6-4-19	420-0004-173-CD		ISS.	
ISS.		EDD/DSR	NO.	APP'D	DATE	CK.	JEN	6-4-19	420-0004-173-CD		

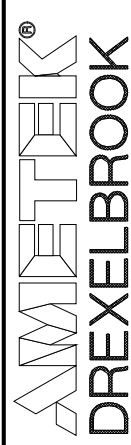

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHT 2 OF 16

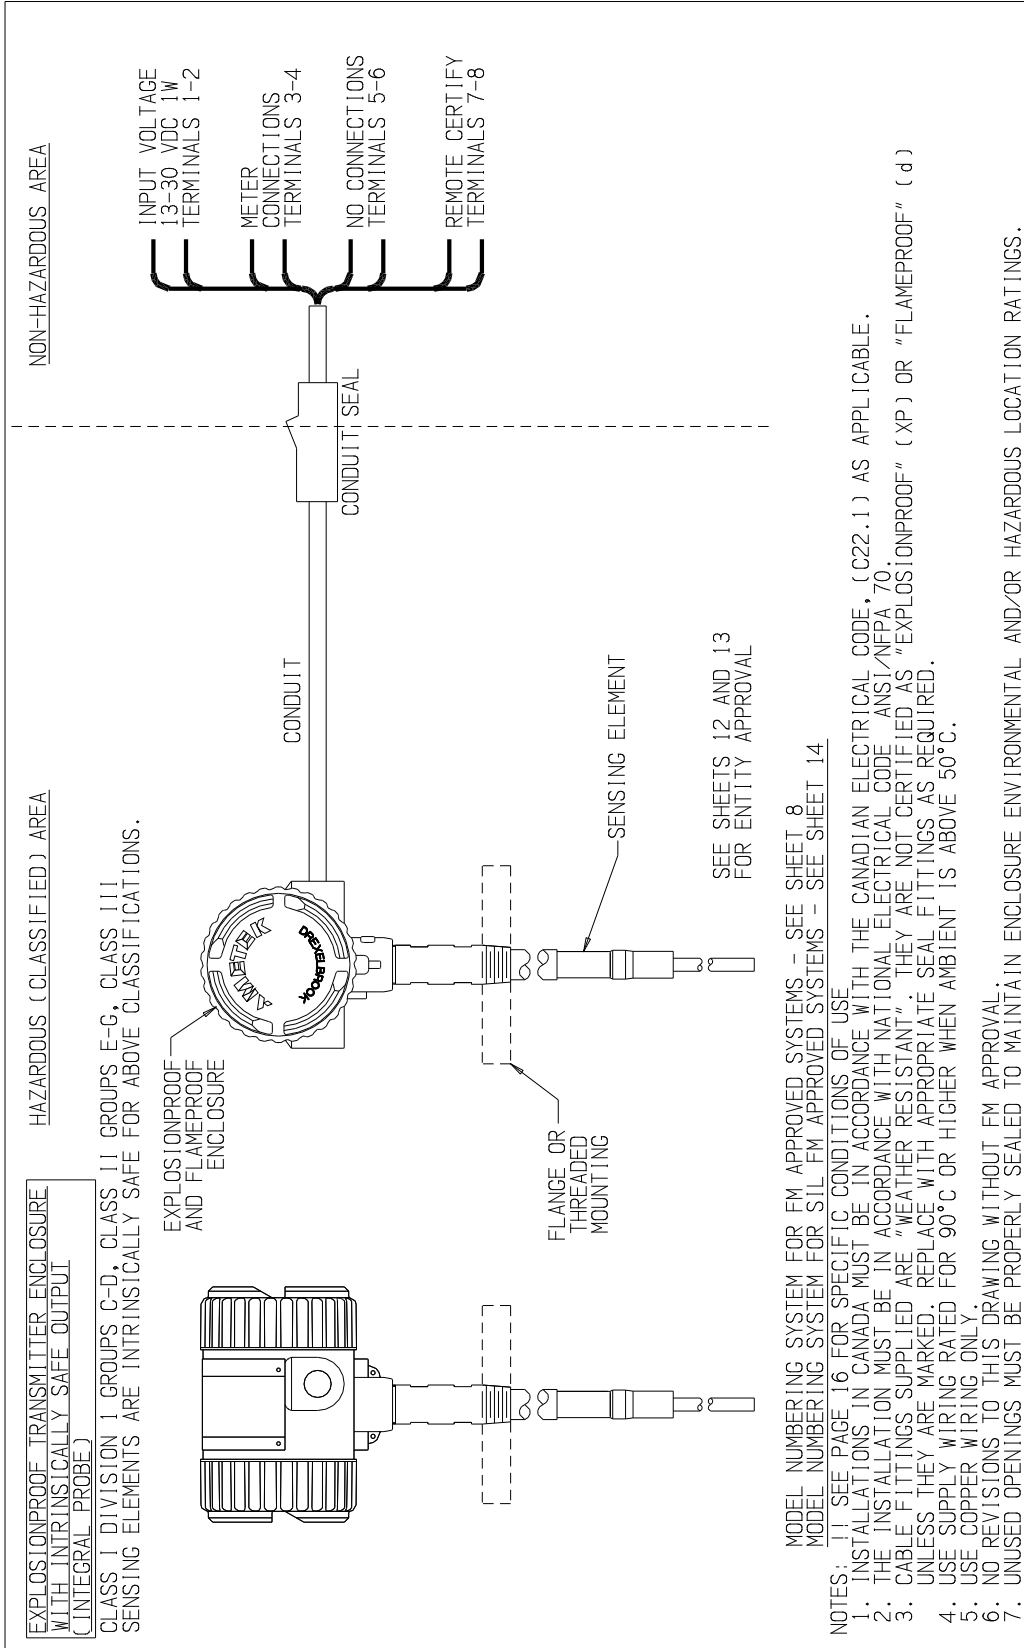

NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (INTEGRAL PROBE)

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

CONDUIT

CONDUIT SEAL

FLANGE OR THREADED MOUNTING

SENSING ELEMENT

SEE SHEETS 12 AND 13 FOR ENTITY APPROVAL

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 14

NOTES: 1. SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE.

1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE ANSI/NFPA 70.
3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
5. USE COPPER WIRING ONLY.
6. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLASURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	SGA	6-4-19	SCA	6-4-19	COPYRIGHT	2019
PO #		SGA	8-13-18	AMETEK	DREXELBROOK		
ENG		SGA	11-15-17	SCALE	NONE		
USER		THP	12-11-13	UNLESS OTHERWISE STATED	ALL DIMENSIONS IN INCHES (IN)		
		SGA	10-28-13	DR.	JHM	6-4-19	
ISS.	EDO/DSR	NO.	APP'D	DATE	CK.	JEN	6-4-19
DE #							


FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS 1, II, III, DIVISION 1, GROUPS C-G (INTEGRAL)

AMETEK®
DREXELBROOK
 205 KEITH VALLEY RD.
 HORSHAM, PA 19044-9986
 215-674-1234
 FAX 215-674-2731

420-0004-173-CD SHT. 2 OF 16

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHT 3 OF 16

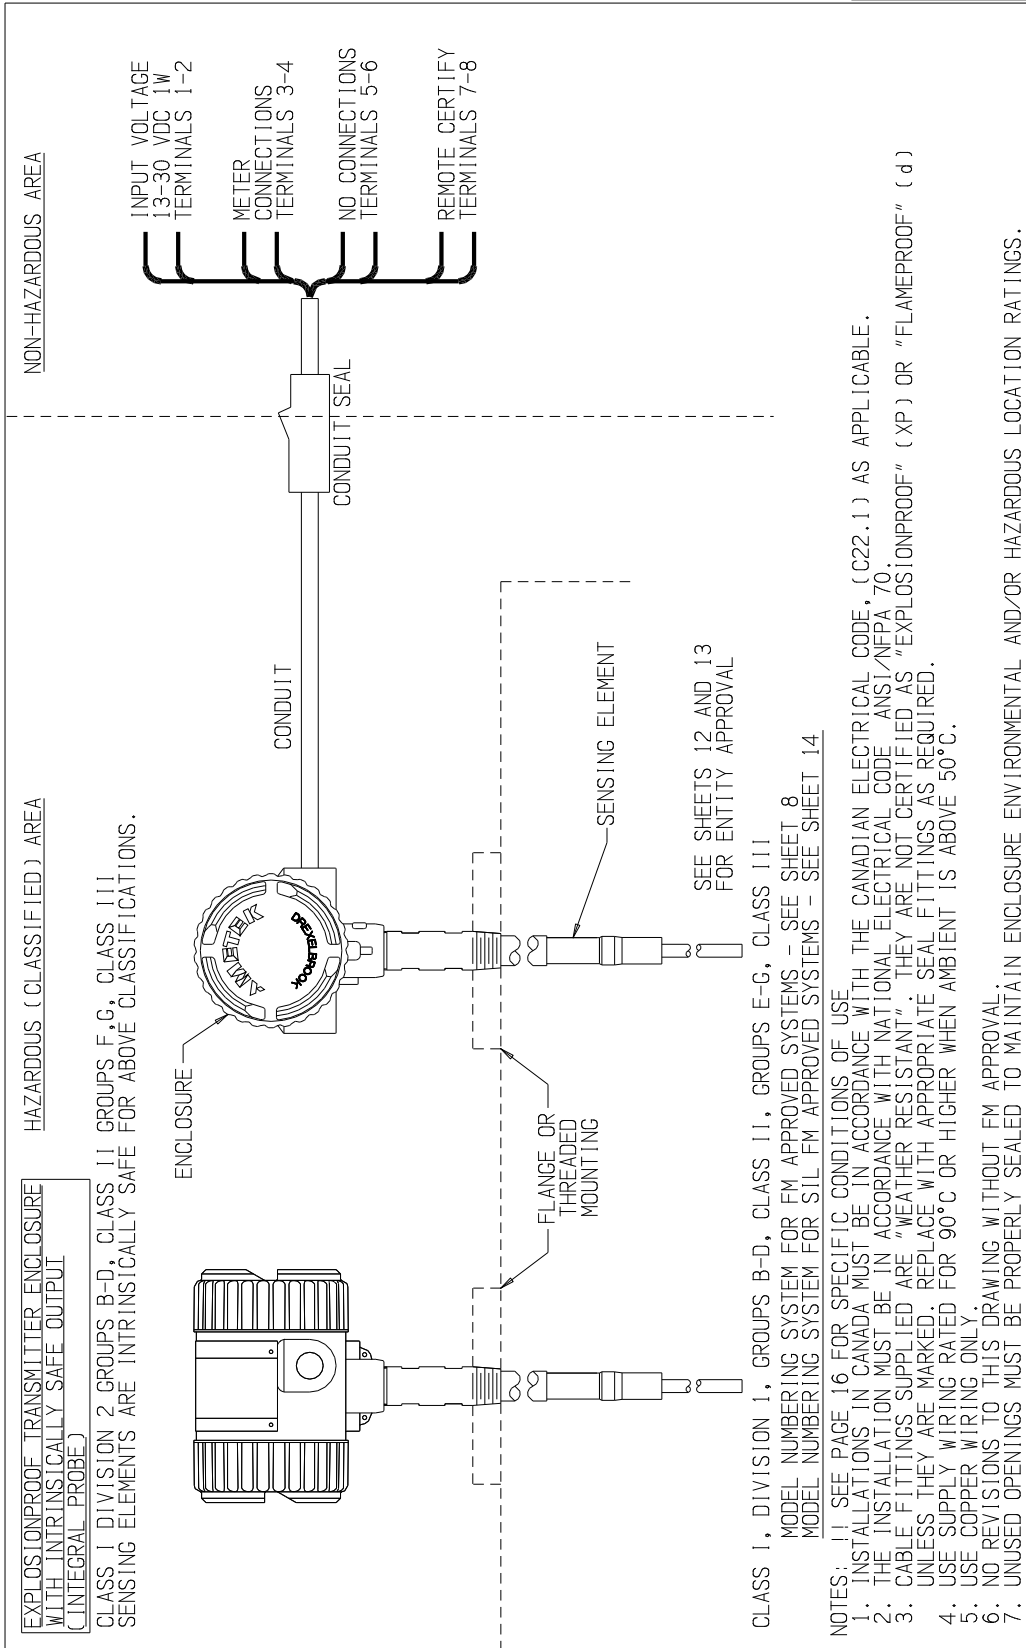


CLASS 1, DIVISION 1, GROUPS B-D, CLASS 11, GROUPS E-G, CLASS 111
 MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 14

NOTES: 11 SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
 1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
 2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE - ANSI/NFPA 70.
 3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d)
 4. UNLESS THEY ARE MARKED, REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 5. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 6. USE COPPER WIRING ONLY.
 7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (INTEGRAL PROBE)		HAZARDOUS (CLASSIFIED) AREA		NON-HAZARDOUS AREA	
CERTIFIED	by	SCA	6-4-19	COPYRIGHT	2019
PO #		SCA	8-13-18	AMETEK	DREXELBROOK
ENG		SCA	11-15-17	SCALE	NONE
USER		THP	12-11-13	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	
DE #		SCA	10-28-13	DR.	JHM 6-4-19
		ISS.	EDD/DSR NO.	APP'D	DATE
		CK.	JEN 6-4-19		
AMETEK® DREXELBROOK			205 KEITH VALLEY RD HORSHAM, PA 19044-9886		
FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES DIVISION 2 (INTEGRAL)			215-674-1234 FAX 215-674-2731		
			420-0004-173-CD		
			SHT. 3 OF 16		
			ISS. OF 15		

6.1 FM / FMc Control Drawings (Continued)

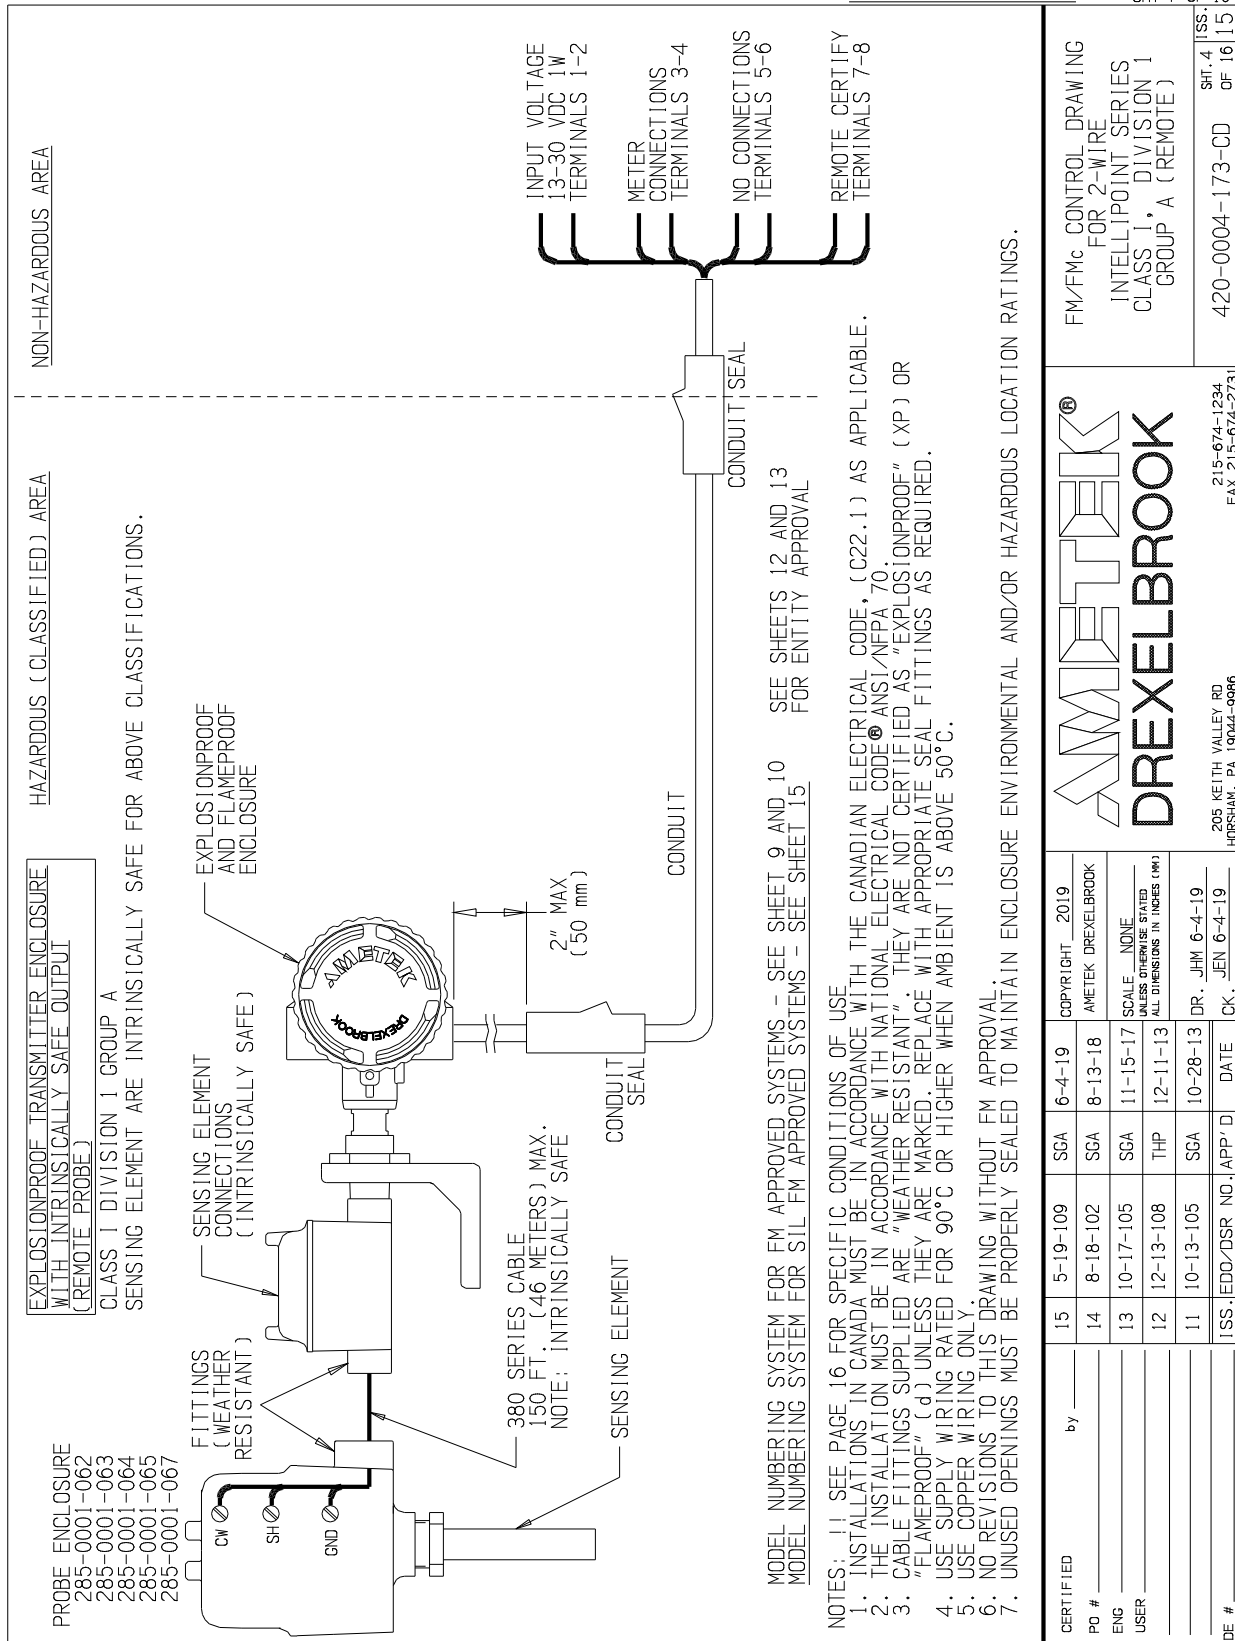

NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)

CLASS 1 DIVISION 1 GROUP A SENSING ELEMENT ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

- PROBE ENCLOSURE
- 285-0001-062
- 285-0001-063
- 285-0001-064
- 285-0001-065
- 285-0001-067



EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)

FITTINGS (WEATHER RESISTANT)

380 SERIES CABLE (150 FT. (46 METERS) MAX. NOTE: INTRINSICALLY SAFE)


SENSING ELEMENT

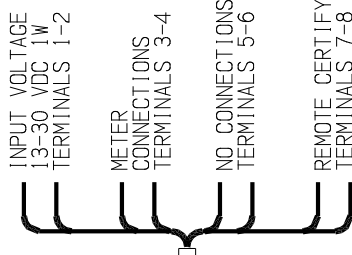

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 9 AND 10
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 15

- NOTES: 1. SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
 1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
 2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
 3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT", THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 5. USE COPPER WIRING ONLY.
 6. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by _____	15	5-19-109	SCA	6-4-19	SCA	6-4-19	COPYRIGHT	2019
PO #		14	8-18-102	SCA	8-13-18	SCA	8-13-18	AMETEK	DREXELBROOK
ENG		13	10-17-105	SCA	11-15-17	SCALE	NONE		
USER		12	12-13-108	THP	12-11-13	UNLESS OTHERWISE STATED			
		11	10-13-105	SCA	10-28-13	ALL DIMENSIONS IN INCHES (IN)			
ISS. #	EDD/DSR NO. APP'D	DATE	DR.	JHM	6-4-19				
DE #	CK.	JEN	6-4-19						

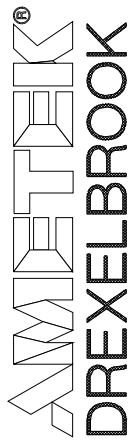

205 KEITH VALLEY RD
 HORSHAM, PA 19044-9966
 215-674-1234
 FAX 215-674-2731

FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS 1, DIVISION 1 GROUP A (REMOTE)


420-0004-173-CD SHT. 4 OF 15

No. 420-0004-173-CD

SHT 4 OF 16

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHT 5 OF 16

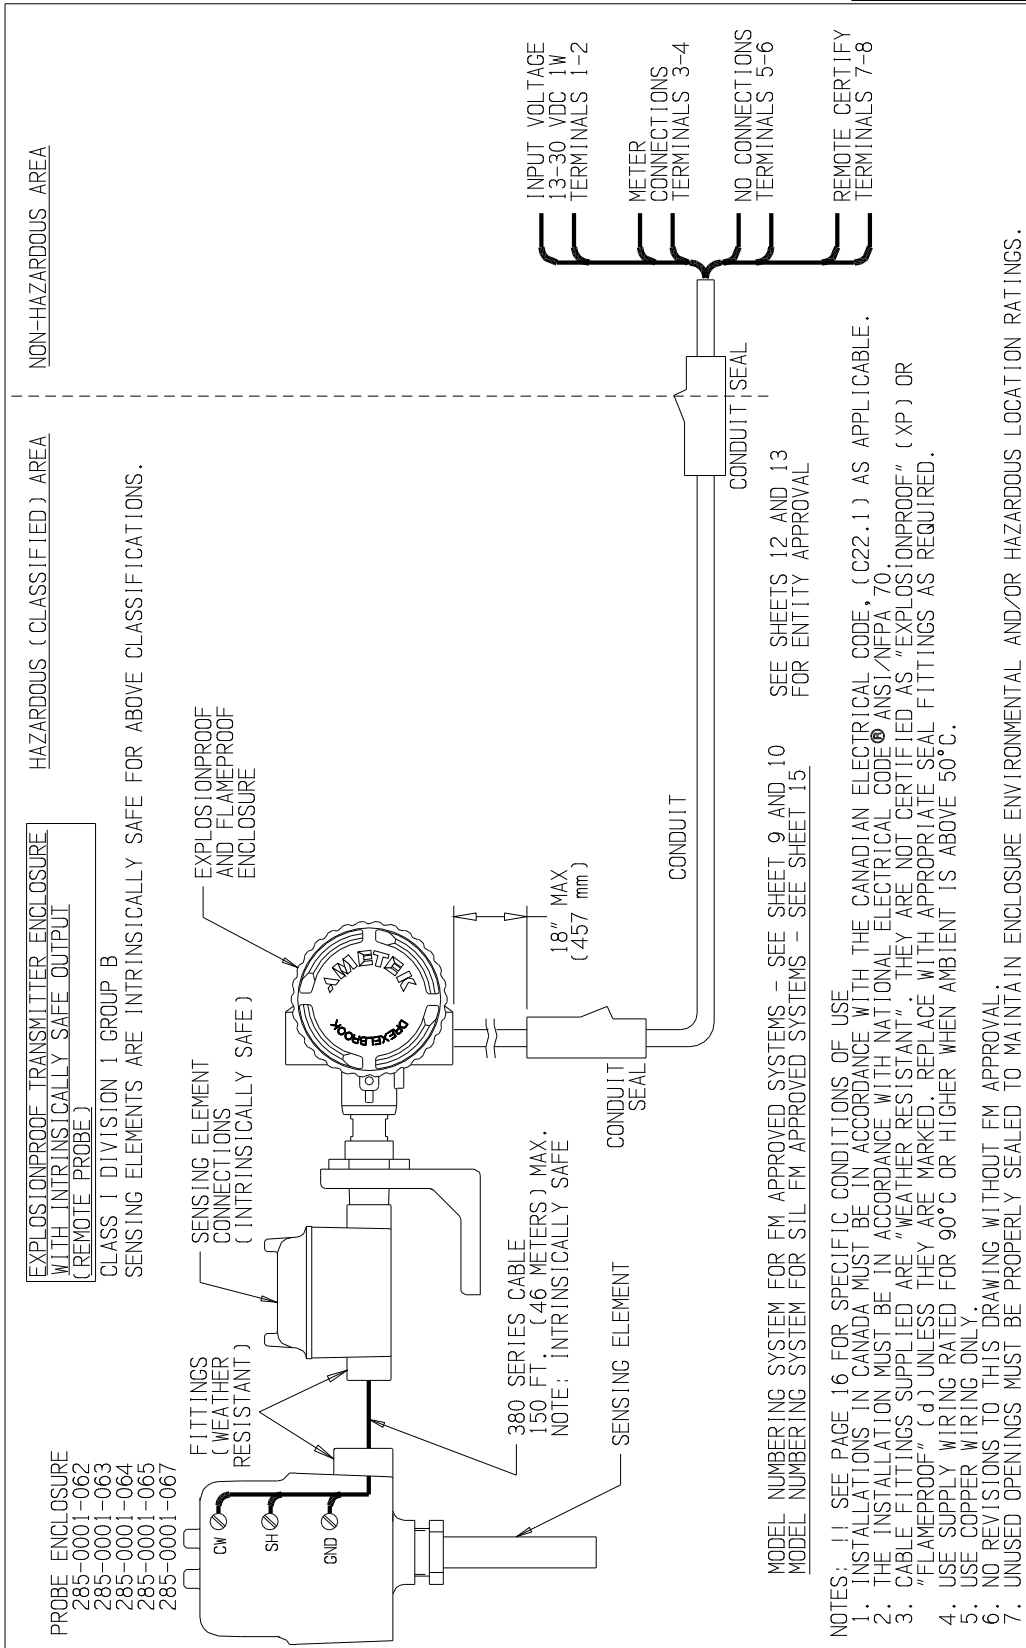

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)
 CLASS 1 DIVISION 1 GROUP B
 SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.


NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

PROBE ENCLOSURE
 285-0001-062
 285-0001-063
 285-0001-064
 285-0001-065
 285-0001-067

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 9 AND 10
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 15

- NOTES: 1. SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
 2. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
 3. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
 4. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 5. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 6. USE COPPER WIRING ONLY.
 7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

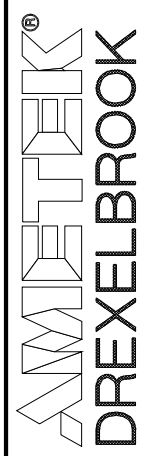

FM/FMc CONTROL DRAWING
 FOR 2-WIRE
 INTELLIPOINT SERIES
 CLASS 1, DIVISION 1
 GROUP B (REMOTE)


CERTIFIED	15	5-19-109	SGA	6-4-19	CDP/YR/LIGHT	2019
PO #	14	8-18-102	SGA	8-13-18	AMETEK	DREXELBROOK
ENG	13	10-17-105	SGA	11-15-17	SCALE	NONE
USER	12	12-13-108	THP	12-11-13	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS IN INCHES (IN#)	
ISS. #	11	10-13-105	SGA	10-28-13	DR.	JHM 6-4-19
EDQ/DSR NO.					DATE	
APP' D					CK.	JEN 6-4-19
DE #						

215-674-1234
 205 KEITH VALLEY RD
 HORSHAM, PA 19044-9986
 FAX 215-674-2731

420-0004-173-CD
 SHT. 5 OF 16
 ISS. OF 15

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHT 6 OF 16

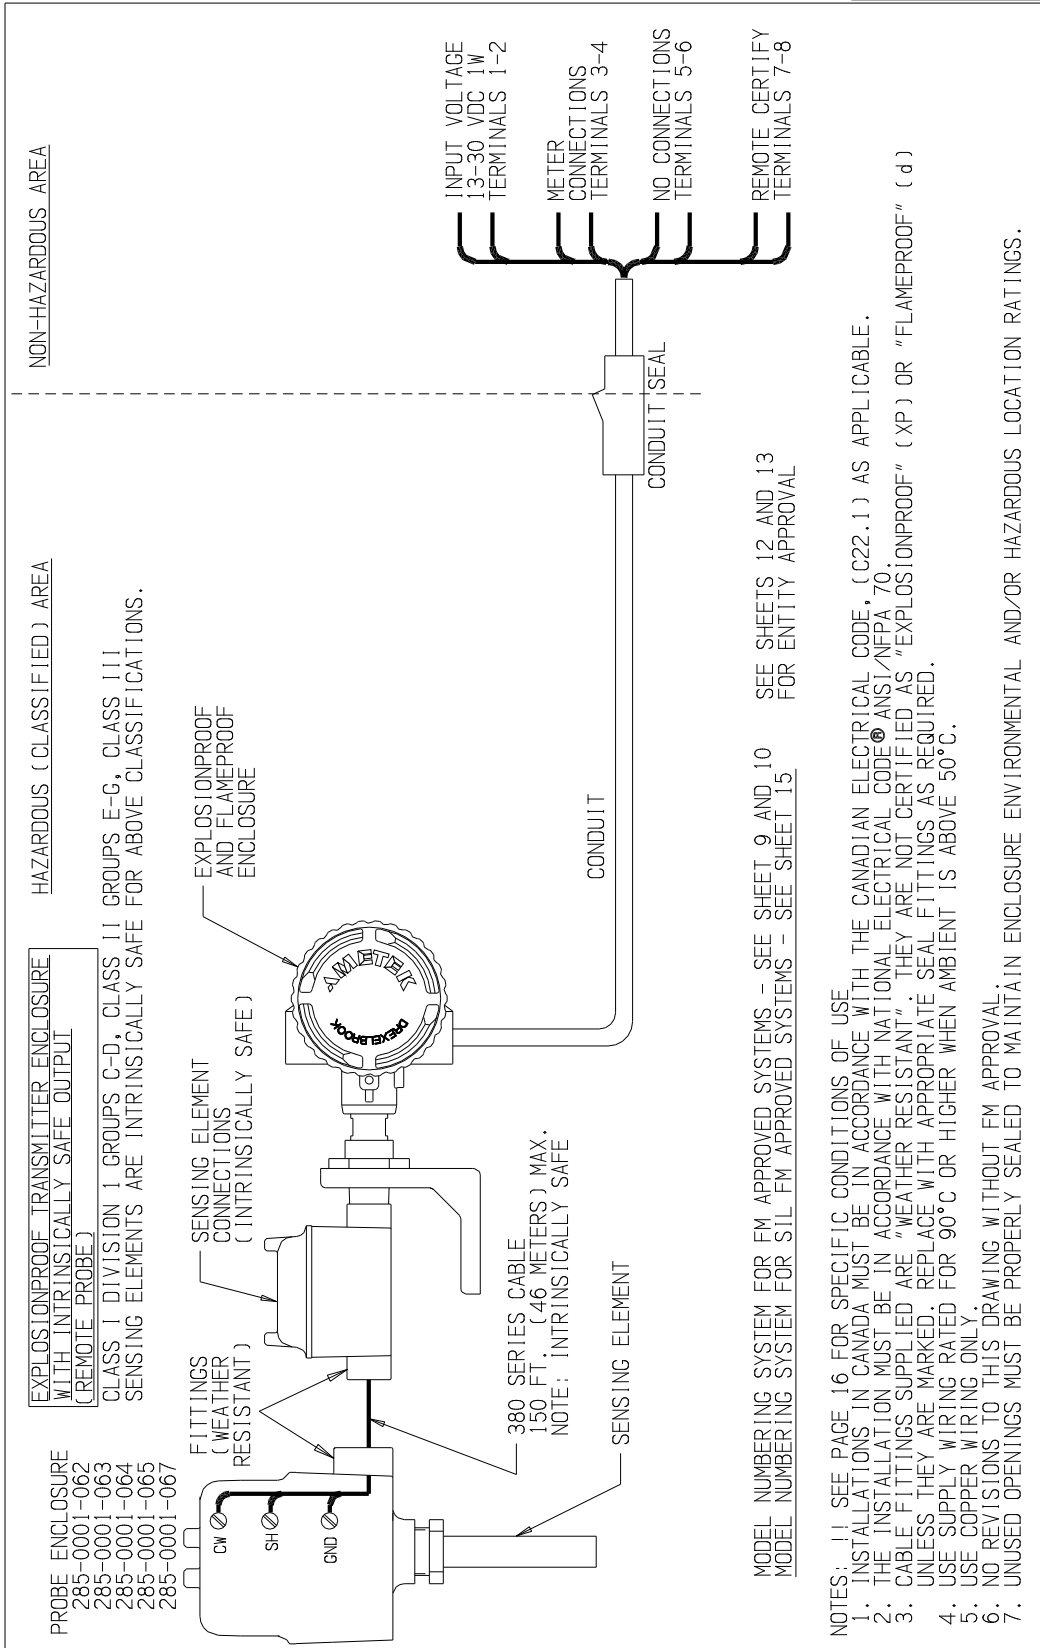

NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)

CLASS I DIVISION 1 GROUPS C-D, CLASS II GROUPS E-G, CLASS III SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

- PROBE ENCLOSURE
- 285-0001-062
- 285-0001-063
- 285-0001-064
- 285-0001-065
- 285-0001-067

FITTINGS (WEATHER RESISTANT)

SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

380 SERIES CABLE 150 FT. (46 METERS) MAX. NOTE: INTRINSICALLY SAFE

SENSING ELEMENT

CONDUIT

CONDUIT (SEAL)

- INPUT VOLTAGE 13-30 VDC 1W TERMINALS 1-2
- METER CONNECTIONS TERMINALS 3-4
- NO CONNECTIONS TERMINALS 5-6
- REMOTE CERTIFY TERMINALS 7-8


MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 9 AND 10 SEE SHEETS 12 AND 13 FOR ENTITY APPROVAL
 MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 15

- NOTES: 11 SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
 2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
 3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
 4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 5. USE COPPER WIRING ONLY.
 6. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
 7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	SCA	6-4-19	SCA	5-19-109	15	COPYRIGHT - 2019	AMETEK DREXELBROOK	FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS I, II, III, DIVISION 1 GROUP C-G (REMOTE)
PO #		SCA	8-13-18	SCA	8-18-102	14			420-0004-173-CD
ENG		SCA	11-15-17	SCA	10-17-105	13	SCALE - NONE		SHT. 6 OF 16
USER		THP	12-11-13	THP	12-13-108	12	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IN)		ISS
DE #		SCA	10-28-13	SCA	10-13-105	11	DR. JHM 6-4-19		OF 15
ISS.	EDD/DSR	NO.	APP/D	DATE	CK.	JEN 6-4-19			
								205 KEITH VALLEY RD HORSHAM, PA. 19044-9886	
								215-674-1234 FAX 215-674-2731	

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHT. 7 OF 16

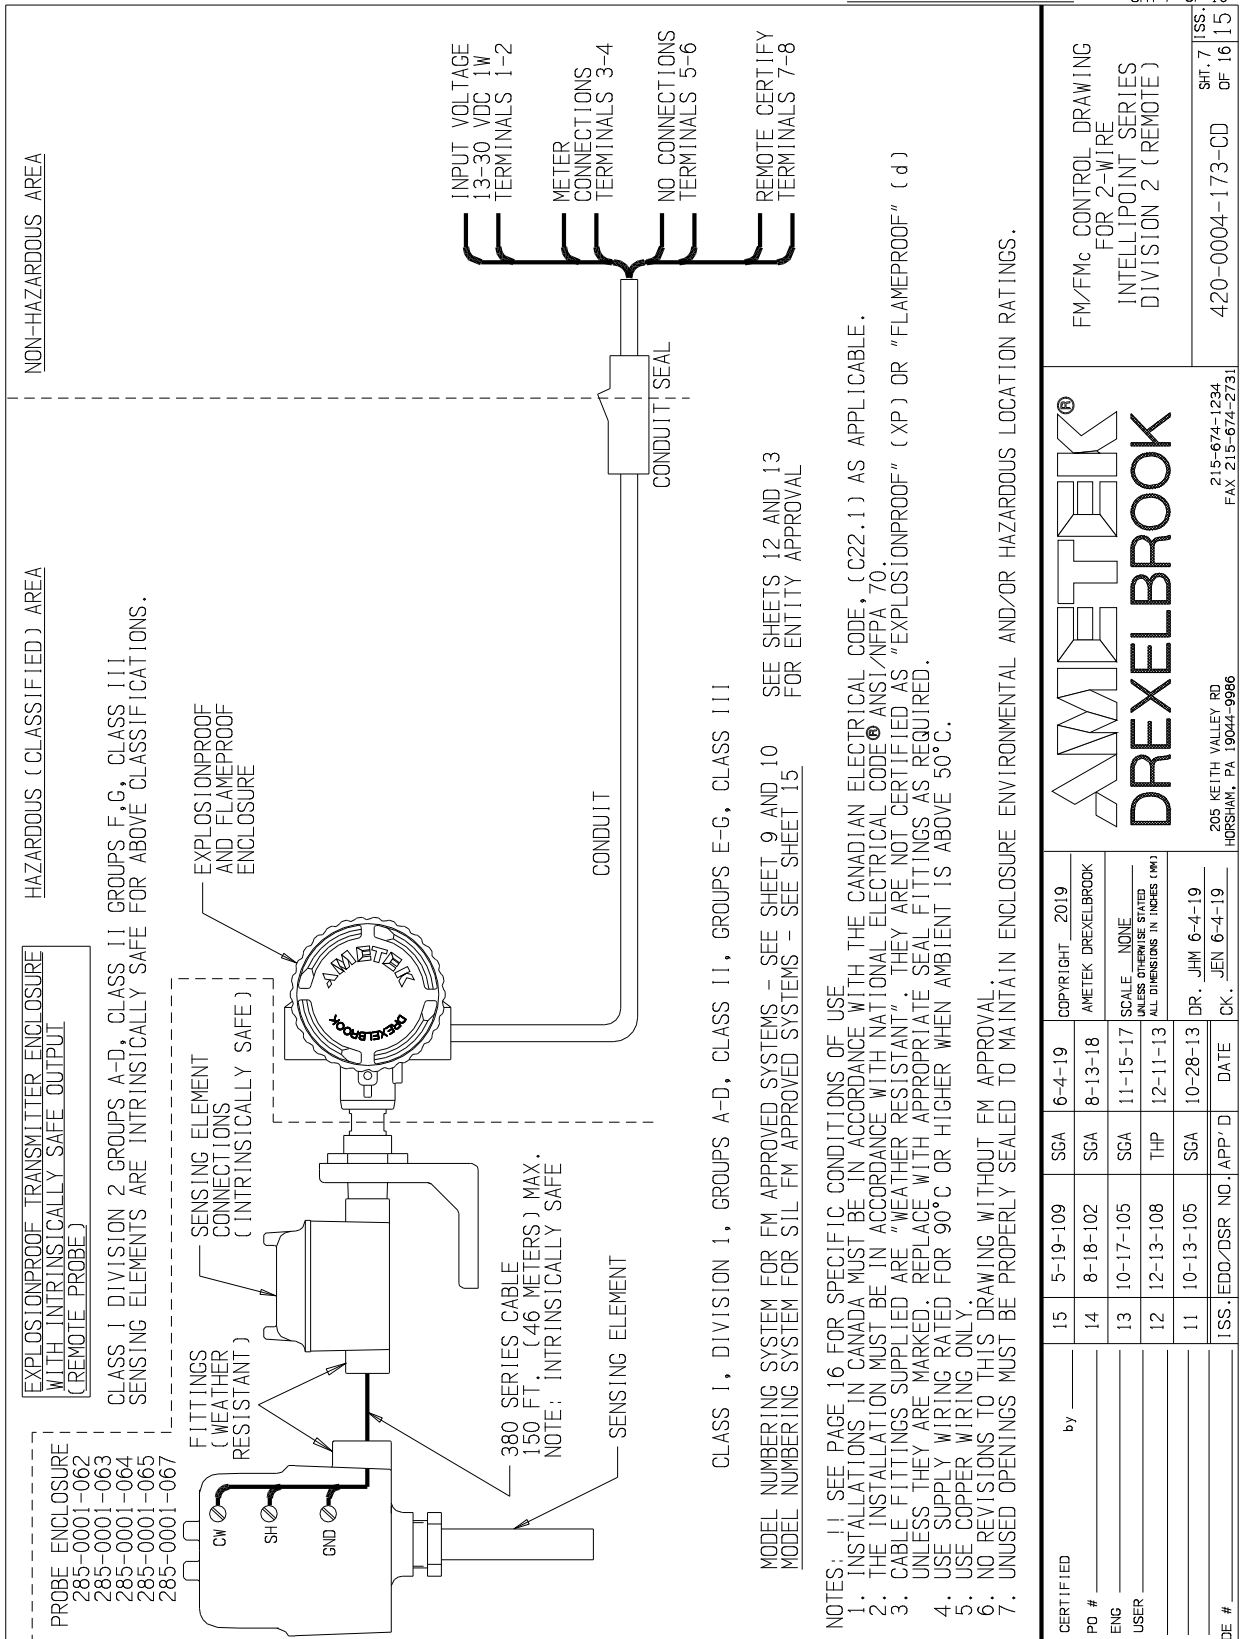

NON-HAZARDOUS AREA

HAZARDOUS (CLASSIFIED) AREA

EXPLOSIONPROOF TRANSMITTER ENCLOSURE WITH INTRINSICALLY SAFE OUTPUT (REMOTE PROBE)

CLASS 1 DIVISION 2 GROUPS A-D, CLASS II GROUPS F,G, CLASS III SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE

SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)

FITTINGS (WEATHER RESISTANT)

380 SERIES CABLE 150 FT. (46 METERS) MAX. NOTE: INTRINSICALLY SAFE

SENSING ELEMENT

INPUT VOLTAGE 13-30 VDC 1W TERMINALS 1-2
METER CONNECTIONS TERMINALS 3-4
NO CONNECTIONS TERMINALS 5-6
REMOTE CERTIFY TERMINALS 7-8

CONDUIT SEAL


CONDUIT

CLASS 1, DIVISION 1, GROUPS A-D, CLASS II, GROUPS E-G, CLASS III

MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 9 AND 10
MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 15
SEE SHEETS 12 AND 13 FOR ENTITY APPROVAL

- NOTES: 1. SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE
2. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.
3. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).
4. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT", THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED. REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.
5. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
6. USE COPPER WIRING ONLY.
7. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.
8. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES DIVISION 2 (REMOTE)

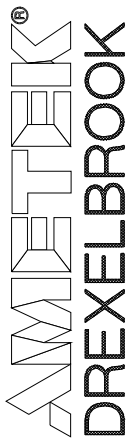

215-674-1234
FAX 215-674-2731
205 KEITH VALLEY RD
HORSHAM, PA 19044-9966

420-0004-173-CD
SHT. 7 OF 16

CERTIFIED	by	15	5-19-109	SCA	6-4-19	COPYRIGHT	2019
PO #		14	8-18-102	SCA	8-13-18	AMETEK DREXELBROOK	
ENG		13	10-17-105	SCA	11-15-17	SCALE NONE	
USER		12	12-13-108	THP	12-11-13	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IMP)	
DE #		11	10-13-105	SCA	10-28-13	DR.	JHM 6-4-19
						DATE	JEN 6-4-19
						CHK.	

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	b	-	0	0	c	d	-	*	*	*	*
	a												
													a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
													R = (HIGH SENSITIVITY)
			b										b = OPTIONS
													3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
													7 = FM/FMc APPROVAL, DUAL SEAL
													B = FM/FMc APPROVAL, DUAL SEAL
							c	d					c, d = SENSING ELEMENTS: 00, 02, 03, 04, 06, 07, 09, 11-19,
													21, 22, 24, 25, 28, 72, 73, 86, 87, 90-93, NN, or ZZ.
							0	0					700-1202-021
								2					700-1202-024
								3					700-1202-028
								4					700-1202-042
								6					700-1202-032
								7					700-1202-020
								9					700-1202-034
							1	1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
							2	1					700-0202-043 (HAST-C)
								2					700-0202-044
								4					700-0005-485
								5					700-0005-485 (HAST-C)
								8					700-1202-052
							6	7					700-3201-002 ⁽¹⁵⁾
							7	2					700-0201-027
								3					700-0201-028
							8	6					700-0005-594
								7					700-0005-595
							9	0					700-0201-059
								1					700-1202-016
								2					700-1202-046
								3					700-1202-056
							N	N					RETROFIT KIT 285-0001-671
							Z	Z					SEE SHEET 11 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

FM/FMc APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 8 OF 16
 420-0004-173-CD ISS. 15

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	
R	a	T	b	c	0	d	e	*	*	*	*	
	a											a = MEASUREMENT OPTIONS:
												N = 2 pF AUTO-CAL
												M = MANUAL-CAL (STANDARD SENSITIVITY)
												H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
												G = MANUAL-CAL (HIGH SENSITIVITY)
												L = 2 pF FIXED
												T = 10 pF AUTO-CAL
												V = 10 pF FIXED
												P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b									b = OPTIONS
												3 = FM/FMc APPROVAL, 3/4 NPT HOUSING
												7 = FM/FMc APPROVAL, DUAL SEAL
												B = FM/FMc APPROVAL, DUAL SEAL
				c								c = 1-9, A-K CABLE OPTIONS, REMOTE
						d	e					d, e = SENSING ELEMENTS: 00, 02, 03, 04, 06, 07, 09-22, 24, 25-28,
												31-40, 50-53, 55, 60-62, 64, 66, 72, 73, 80-83, 85, 90-94, NN or ZZ.
						0	0					700-1202-001
							2					700-1202-014
							3					700-1202-018
							4					700-1202-041
							6					700-1202-031
							7					700-1202-010
							9					700-1202-033
						1	0					700-0001-018
							1					700-0201-005
							2					700-0201-005 (HAST C)
							3					700-0201-019
							4					700-0202-002
							5					700-0202-043
							6					700-0002-360
							7					700-0202-029
							8					700-0001-022
							9					700-0002-023
						2	0					700-0209-002
							1					700-0202-043 (HAST-C)
							2					700-0202-044
							4					700-0005-285
							5					700-0005-285 (HAST-C)
							6					700-0220-001
							7					700-0221-002
							8					700-1202-051

SENSING ELEMENT LIST
CONTINUED ON NEXT PAGE

FM/FMc APPROVED
REMOTE, 2-WIRE, INTELLIPOINT
MODEL NUMBERING SYSTEM

SHT 9 OF 16
420-0004-173-CD ISS. 14

6.1 FM / FMc Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	
R	a	T	b	c	0	d	e	*	*	*	*	
							3	1				700-0029-001
								2				700-0029-002
								3				700-0029-003
								4				700-0029-004
								5				700-0029-005
								6				700-0029-102
								7				700-0029-103
								8				700-0029-104
								9				700-0029-105
							4	0				700-0029-106
							5	0				700-0207-001
								1				700-0207-002
								2				700-0207-003
								3				700-0207-004
								5				700-0207-006
							6	0				700-0204-038
								1				700-0204-002
								2				700-0204-048
								4				700-0204-024
								6				700-0204-022
								7				700-3201-001 15
							7	2				700-0201-027
								3				700-0201-028
							8	0				700-4200-020
								1				700-4200-030
								2				700-4200-040
								3				700-4200-060
								5				700-9000-494
							9	0				700-0201-059
								1				700-1202-015
								2				700-1202-045
								3				700-1202-055
								4				700-0209-024
							N	N				RXXX-1XNN-NN-CD
							Z	Z				SEE SHEET 11 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

FM/FMc APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 10 OF 16
 420-0004-173-CD ISS. 15

6.1 FM / FMc Control Drawings (Continued)

MODEL NUMBERS OF APPROVED REMOTE SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERATURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1 μ F.
3. MAXIMUM INSERTION LENGTH **RIGID SENSOR** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH **FLEXIBLE SENSOR** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

!! SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE


FM/FMc APPROVED
ADDITIONAL
SENSING ELEMENTS

SHT 11 OF 16
420-0004-173-CD ISS. 15

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD

SHT 12 OF 16

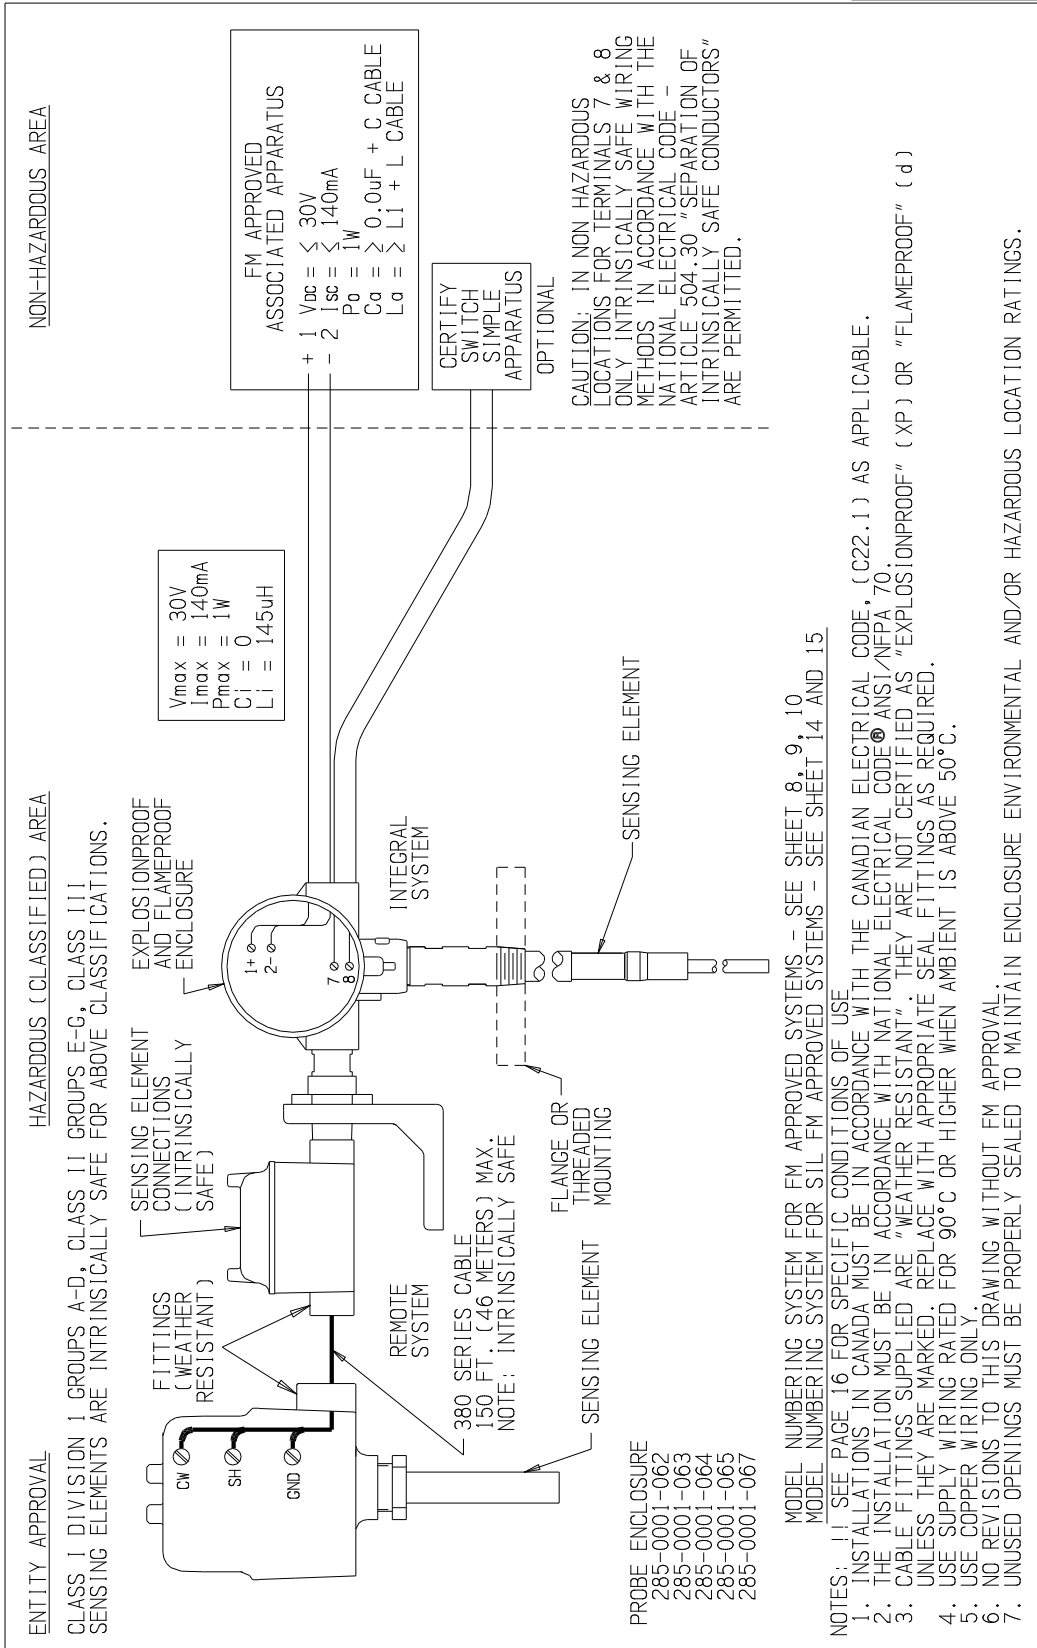

CERTIFIED		15	5-19-109	SCA	6-4-19	COPYRIGHT - 2019	FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS I, II, III, DIVISION 1, ENTITY INSTALLATIONS
PO #	by	14	8-18-102	SCA	8-13-18	AMETEK DREXELBROOK	420-0004-173-CD
ENG		13	10-17-105	SCA	11-15-17	SCALE - NONE	SHT. 12 OF 16
USER		12	12-13-108	THP	12-11-13	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	OF 16
DE #		11	10-13-105	SCA	10-28-13	DR. JHM 6-4-19	ISS. 12
		ISS. EDD/DSR NO. APP'D	DATE	CK.	JEN 6-4-19		OF 16


205 KEITH VALLEY RD
HORSHAM, PA 19044-9886

215-674-1234
FAX 215-674-2731

AMETEK®
DREXELBROOK

6.1 FM / FMc Control Drawings (Continued)

No. 420-0004-173-CD SHEET 13 OF 16

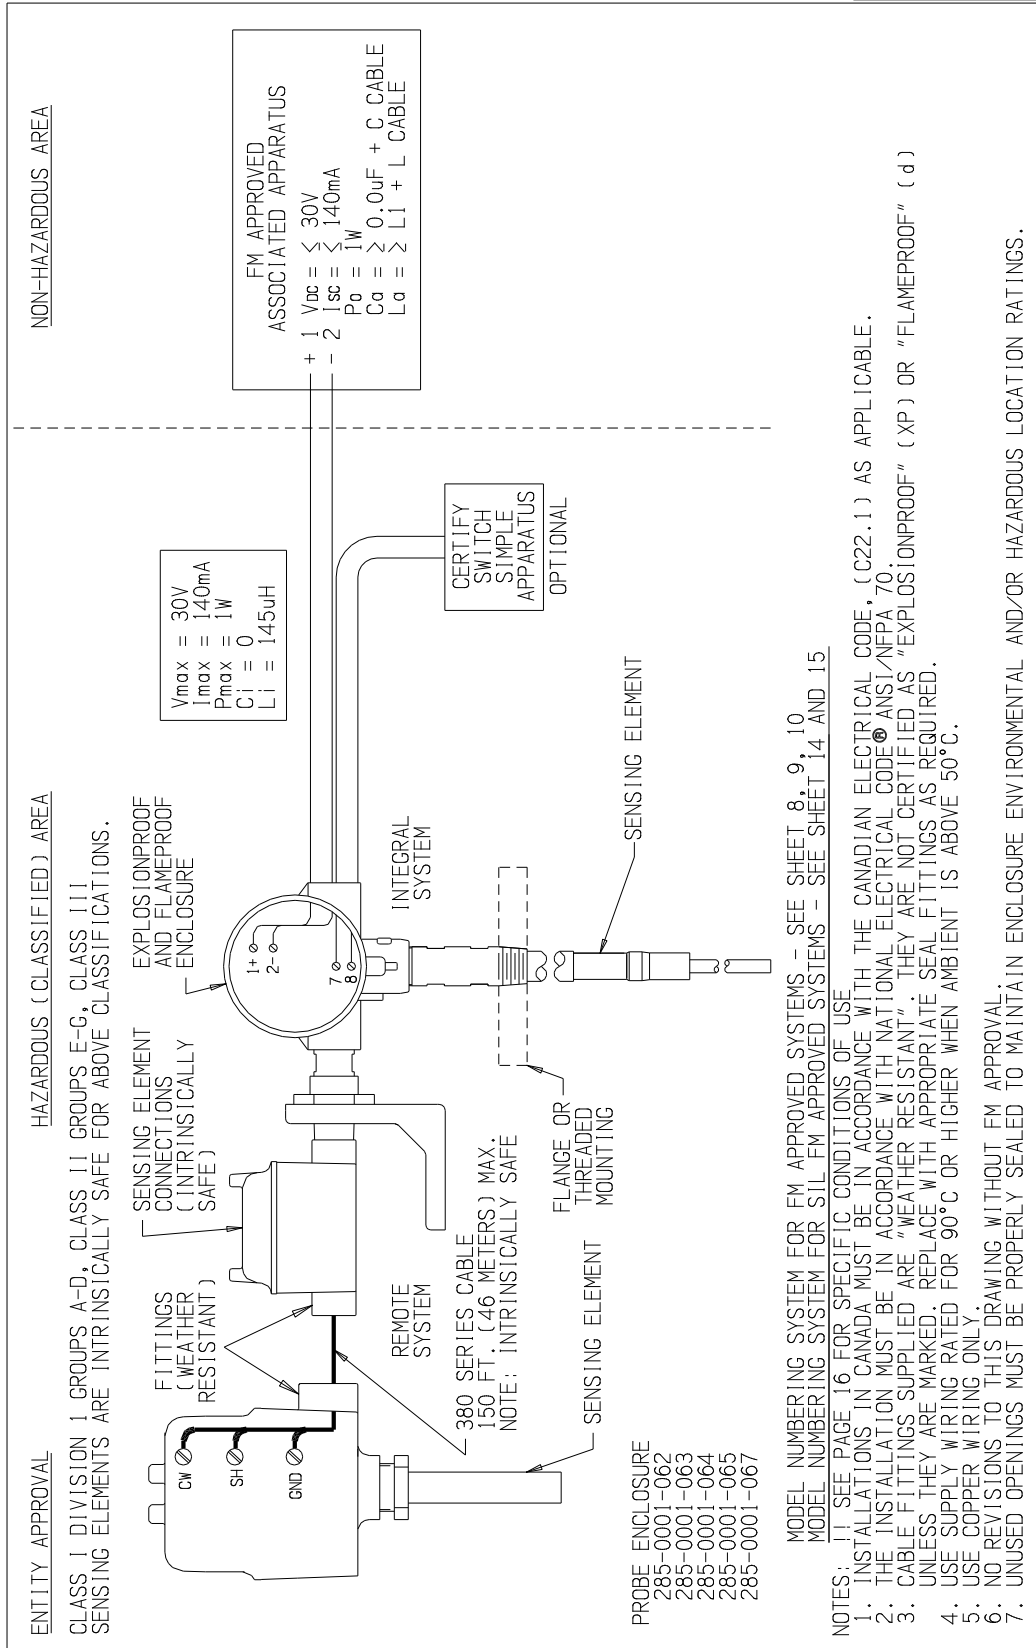

ENTITY APPROVAL		HAZARDOUS (CLASSIFIED) AREA		NON-HAZARDOUS AREA	
CLASS I DIVISION 1 GROUPS A-D, CLASS II GROUPS E-G, CLASS III SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.					
<p>EXPLOSIONPROOF AND FLAMEPROOF ENCLOSURE</p> <p>SENSING ELEMENT CONNECTIONS (INTRINSICALLY SAFE)</p> <p>FITTINGS (WEATHER RESISTANT)</p> <p>REMOTE SYSTEM</p> <p>INTEGRAL SYSTEM</p> <p>SENSING ELEMENT</p> <p>FLANGE OR THREADED MOUNTING</p> <p>SENSING ELEMENT</p> <p>CERTIFY SWITCH APPARATUS OPTIONAL</p> <p>FM APPROVED APPARATUS ASSOCIATED APPARATUS</p> <p>+ 1 $V_{dc} \leq 30V$ - 2 $I_{sc} \leq 140mA$ $P_o \leq 1W$ $C_a \geq 0.0\mu F + C_{CABLE}$ $L_a \geq L_I + L_{CABLE}$</p> <p>$V_{max} = 30V$ $I_{max} = 140mA$ $P_{max} = 1W$ $C_i = 0$ $L_i = 145\mu H$</p>					
<p>MODEL NUMBERING SYSTEM FOR FM APPROVED SYSTEMS - SEE SHEET 8, 9, 10</p> <p>MODEL NUMBERING SYSTEM FOR SIL FM APPROVED SYSTEMS - SEE SHEET 14 AND 15</p> <p>NOTES: 11 SEE PAGE 16 FOR SPECIFIC CONDITIONS OF USE</p> <p>1. INSTALLATIONS IN CANADA MUST BE IN ACCORDANCE WITH THE CANADIAN ELECTRICAL CODE, (C22.1) AS APPLICABLE.</p> <p>2. THE INSTALLATION MUST BE IN ACCORDANCE WITH NATIONAL ELECTRICAL CODE (ANSI/NFPA 70).</p> <p>3. CABLE FITTINGS SUPPLIED ARE "WEATHER RESISTANT". THEY ARE NOT CERTIFIED AS "EXPLOSIONPROOF" (XP) OR "FLAMEPROOF" (d) UNLESS THEY ARE MARKED; REPLACE WITH APPROPRIATE SEAL FITTINGS AS REQUIRED.</p> <p>4. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.</p> <p>5. USE COPPER WIRING ONLY.</p> <p>6. NO REVISIONS TO THIS DRAWING WITHOUT FM APPROVAL.</p> <p>7. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.</p>					
CERTIFIED	by	15	5-19-109	SCA	6-4-19
PO #		14	8-18-102	SCA	8-13-18
ENG		13	10-17-105	SCA	11-15-17
USER		12	12-13-108	THP	12-11-13
ISS.	EDD/DSR	11	10-13-105	SCA	10-28-13
DE #		10	6-4-19	DR.	JHM
<p>AMETEK®</p> <p>DREXELBROOK</p> <p>205 KEITH VALLEY RD HORSHAM, PA 19044-9886</p> <p>215-674-1234 FAX 215-674-2731</p>					
<p>FM/FMc CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES CLASS I, II, III, DIVISION 1, ENTITY INSTALLATIONS</p> <p>420-0004-173-CD</p> <p>SHT. 13 OF 16</p>					

6.1 FM / FMc Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	7	8	9	10	11	12	13	14		
S	a	R	b	T	c	-	0	0	d	e	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS: N = 2 pF AUTO-CAL H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY) L = 2 pF FIXED T = 10 pF AUTO-CAL V = 10 pF FIXED P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c										c = OPTIONS 3 = FM/FMc APPROVAL, 3/4 NPT HOUSING 7 = FM/FMc APPROVAL, DUAL SEAL B = FM/FMc APPROVAL, DUAL SEAL
									d	e					d, e = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-19, 21, 24, 25, 28, 72, 73, 86, 87, 90-93.
									0	0					700-1202-021
										2					700-1202-024
										4					700-1202-042
										6					700-1202-032
										7					700-1202-020
										9					700-1202-034
									1	1					700-0201-005
										2					700-0201-005 (HAST C)
										3					700-0201-019
										4					700-0202-002
										5					700-0202-043
										6					700-0002-360
										7					700-0202-029
										8					700-0001-022
										9					700-0002-023
									2	1					700-0202-043 (HAST-C)
										4					700-0005-485
										5					700-0005-485 (HAST-C)
										8					700-1202-052
									6	7					700-3201-002 15
										7	2				700-0201-027
										3					700-0201-028
									8	6					700-0005-594
										7					700-0005-595
									9	0					700-0201-059
										1					700-1202-016
										2					700-1202-046
										3					700-1202-056

SIL, FM/FMc APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 14 OF 16
 420-0004-173-CD ISS. 15

6.1 FM / FMc Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	13	14	
S	a	R	b	T	c	d	0	e	f	*	*	*	*	
	a													a = 2 SIL LEVEL 2
			b											b = MEASUREMENT OPTIONS: N = 2 pF AUTO-CAL H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY) L = 2 pF FIXED T = 10 pF AUTO-CAL V = 10 pF FIXED P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c									c = OPTIONS 3 = FM/FMc APPROVAL, 3/4 NPT HOUSING 7 = FM/FMc APPROVAL, DUAL SEAL B = FM/FMc APPROVAL, DUAL SEAL
						d								d = 1-9, A-K CABLE OPTIONS, REMOTE
								e	f					e, f = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-21, 24-28, 60-62, 64, 66, 72, 73, 85, 90-94.
								0	0					700-1202-001
									2					700-1202-014
									4					700-1202-041
									6					700-1202-031
									7					700-1202-010
									9					700-1202-033
								1	1					700-0201-005
									2					700-0201-005 (HAST C)
									3					700-0201-019
									4					700-0202-002
									5					700-0202-043
									6					700-0002-360
									7					700-0202-029
									8					700-0001-022
									9					700-0002-023
								2	0					700-0209-002
									1					700-0202-043 (HAST-C)
									4					700-0005-285
									5					700-0005-285 (HAST-C)
									6					700-0220-001
									7					700-0221-002
									8					700-1202-051
								6	0					700-0204-038
									1					700-0204-002
									2					700-0204-048
									4					700-0204-024
									6					700-0204-022
									7					700-3201-001 (15)
								7	2					700-0201-027
									3					700-0201-028
								8	5					700-9000-494
								9	0					700-0201-059
									1					700-1202-015
									2					700-1202-045
									3					700-1202-055
									4					700-0209-024

SIL, FM/FMc APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 15 OF 16
 420-0004-173-CD ISS. 15

6.1 **EM / FMc Control Drawings (Continued)**

SPECIFIC CONDITIONS OF USE


1. *"The equipment shall not be applied in an explosive dust atmosphere where high electrostatic charging processes are present that could result in propagating brush discharges. See IEC TS60079-32-1 for additional guidance."*
2. *The enclosure contains aluminum and is considered a potential risk of ignition by impact or friction. Care must be taken into account during installation and use to prevent impact or friction.*

SPECIFIC CONDITIONS OF USE
SHT 16 OF 16
420-0004-173-CD ISS. 15

6.2 ATEX Control Drawings

No. 420-0004-175-CD

SHT 1 OF 9

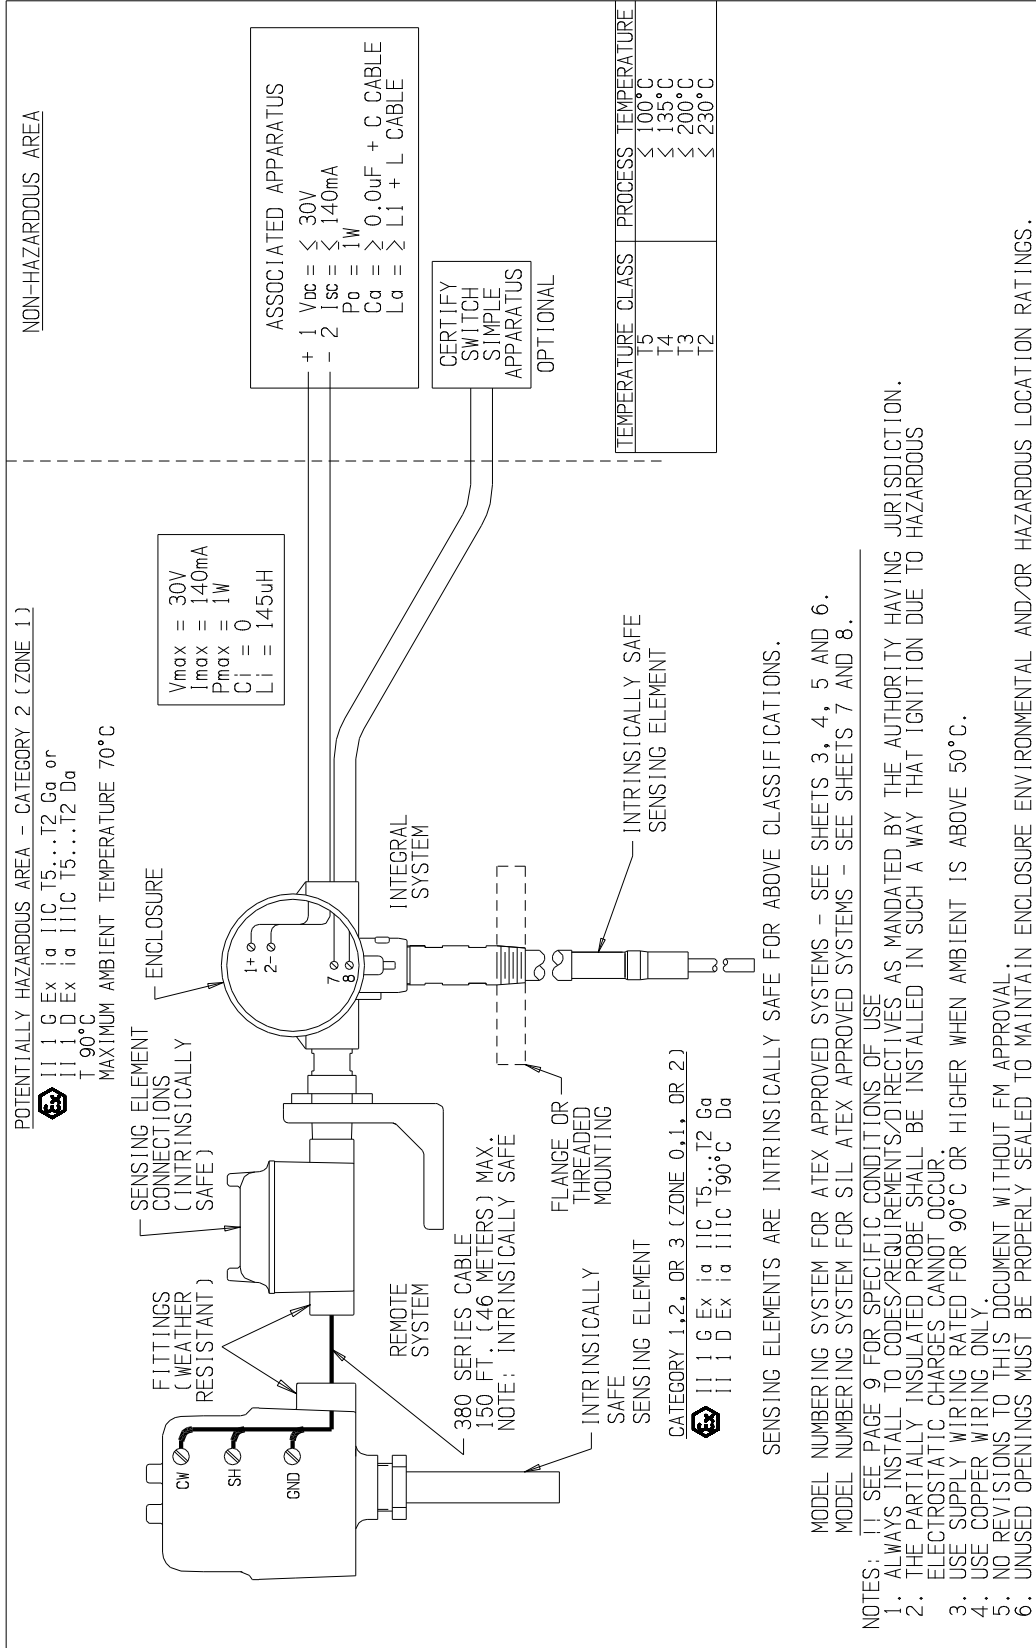

SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.



MODEL NUMBERING SYSTEM FOR ATEX APPROVED SYSTEMS - SEE SHEETS 3, 4, 5 AND 6.
 MODEL NUMBERING SYSTEM FOR SIL ATEX APPROVED SYSTEMS - SEE SHEETS 7 AND 8.

- NOTES: 1. SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE
 1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. THE PARTIALLY INSULATED PROBE SHALL BE INSTALLED IN SUCH A WAY THAT IGNITION DUE TO HAZARDOUS ELECTROSTATIC CHARGES CANNOT OCCUR.
 3. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 4. USE COPPER WIRING ONLY.
 5. NO REVISIONS TO THIS DOCUMENT WITHOUT FM APPROVAL.
 6. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by	10 8-18-102	SGA	8-13-18	COPYRIGHT - 2018
PO #		9 10-17-105	SGA	11-15-17	AMETEK DREXELBROOK
ENG		8 1-14-129	THP	11-4-14	SCALE NONE
USER		7 11-08-114	SGA	3-17-09	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IPK)
DE #		6 3-08-106	SGA	3-10-08	DR. JHM 8-13-18
					ISS. EDD/DSR NO./APP/D DATE CK. JEN 8-13-18
205 KEITH VALLEY RD. HORSHAM, PA. 19044-9986 215-674-1234 FAX 215-674-2731					
ATEX CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES ENTITY INSTALLATIONS					
420-0004-175-CD					
SHT. 1 OF 9					

6.2 ATEX Control Drawings (Continued)

No. 420-0004-175-CD SHT 2 OF 9

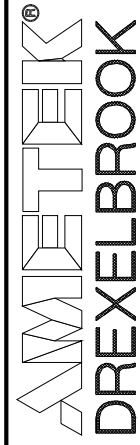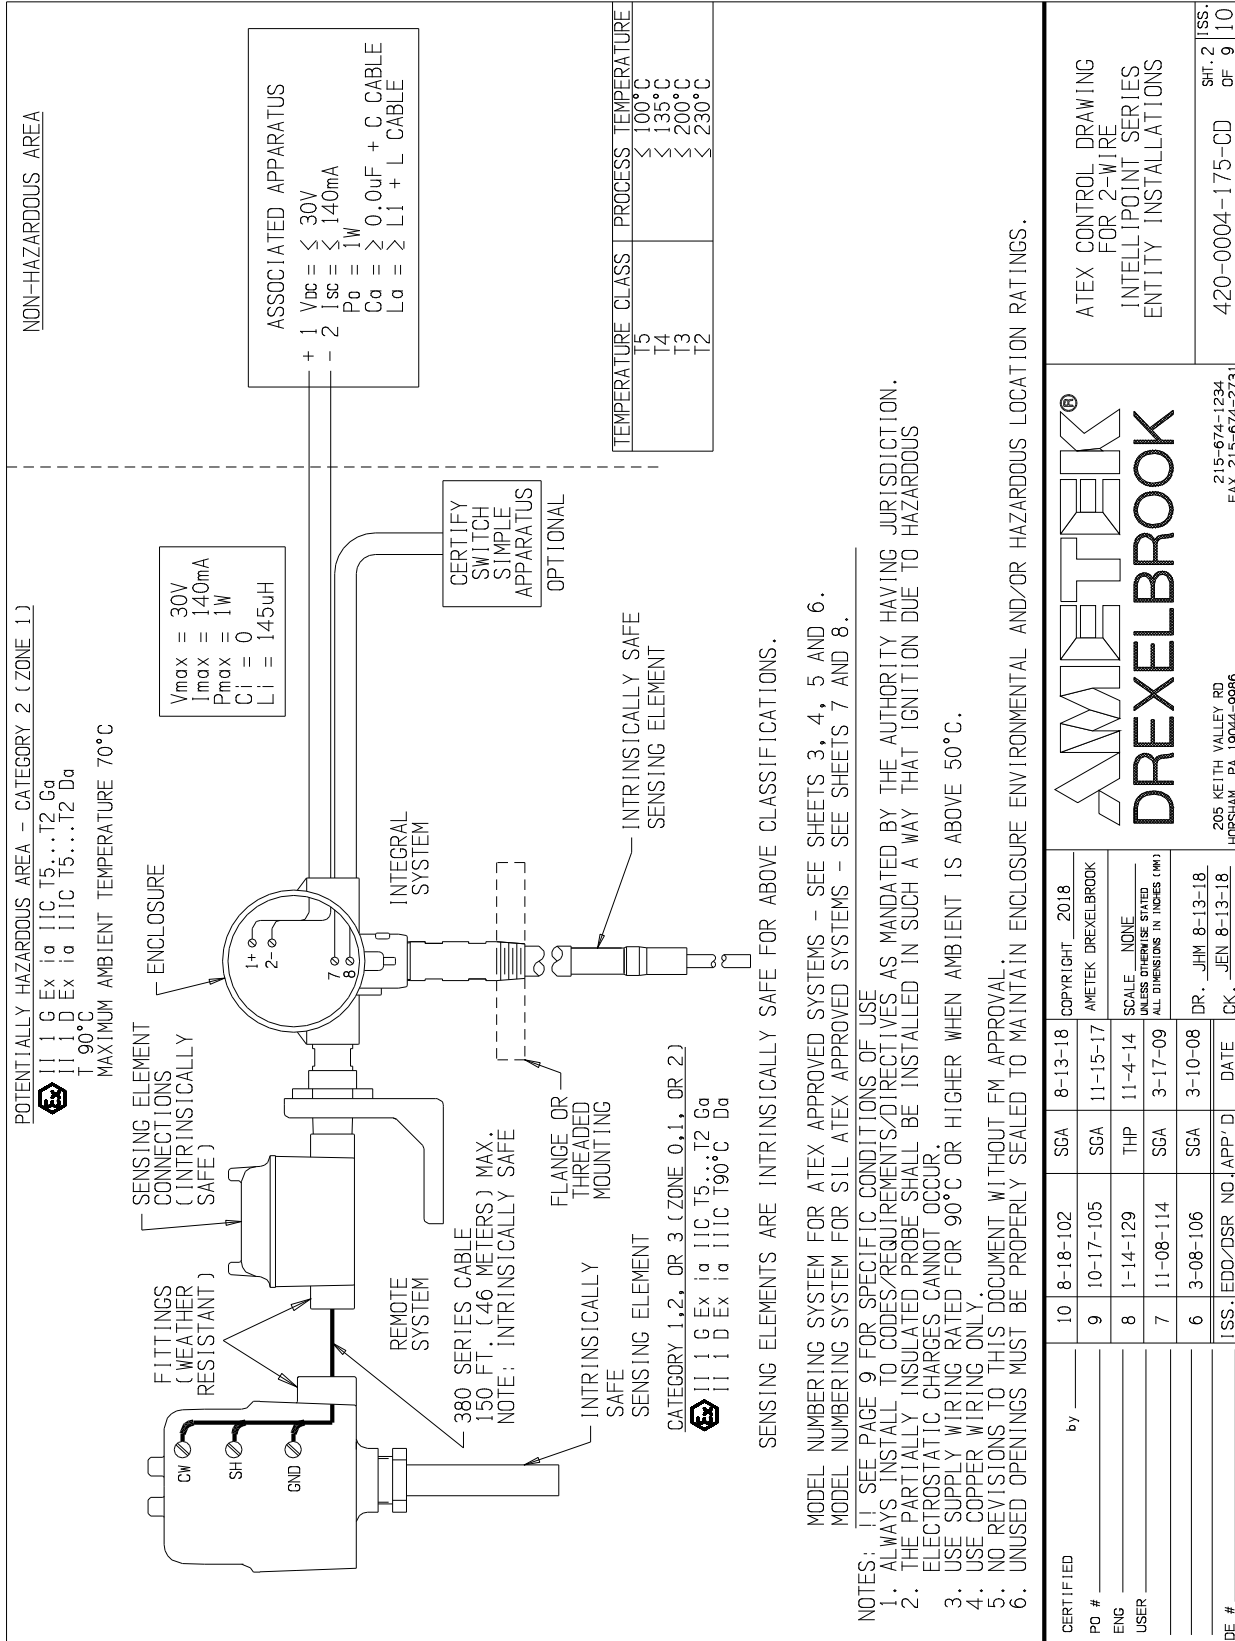

215-674-1234
 FAX 215-674-2731

205 KEITH VALLEY RD
 HORSHAM, PA 19044-9986

DR. JHM 8-13-18
 CK. JEN 8-13-18

CERTIFIED	by	SGA	8-13-18	COPYRIGHT	2018
PO #	9	SGA	11-15-17	AMETEK DREXELBROOK	
ENG	8	THP	11-4-14	SCALE NONE	
USER	7	SGA	3-17-09	INTERPRETED ALL DIMENSIONS IN INCHES (IN)	
ISS. EDO/DSR NO. APP'D	6	SGA	3-10-08	DATE	
DE #					

ATEX CONTROL DRAWING FOR 2-WIRE INTELLIPOINT SERIES ENTITY INSTALLATIONS	
420-0004-175-CD	SHT. 2 OF 9
ISS. 10	

6.2 ATEX Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	2	-	0	0	b	c	-	*	*	*	*
	a												
													a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			2										2 = ATEX APPROVAL, M20 HOUSING
							b	c					b, c = SENSING ELEMENTS: 00, 02-04, 06, 07, 09, 11-19,
							0	0					21, 22, 24, 25, 28, 72, 73, 86, 87, 90-93, or ZZ.
													700-1202-021
													700-1202-024
													700-1202-028
													700-1202-042
													700-1202-032
													700-1202-020
													700-1202-034
							1	1					700-0201-005
													700-0201-005 (HAST C)
													700-0201-019
													700-0202-002
													700-0202-043
													700-0002-360
													700-0202-029
													700-0001-022
													700-0002-023
							2	1					700-0202-043 (HAST-C)
													700-1202-044
													700-0005-485
													700-0005-485 (HAST-C)
													700-1202-052
							7	2					700-0201-027
													700-0201-028
							8	6					700-0005-594
													700-0005-595
							9	0					700-0201-059
													700-1202-016
													700-1202-046
													700-1202-056
							Z	Z					SEE SHEET 6 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

ATEX APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 3 OF 9
 420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	2	-	b	0	c	d	-	*	*	*	*
	a												a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			2										2 = ATEX APPROVAL, M20 HOUSING
				b									b = 1-9, A-K CABLE OPTIONS, REMOTE
							c	d					c, d = SENSING ELEMENTS: 00, 02-04, 06, 07, 09-22, 24-28,
													31-40, 50-53, 55, 60-62, 64, 66, 72, 73, 80-83, 85, 90-94, or ZZ.
							0	0					700-1202-001
								2					700-1202-014
								3					700-1202-018
								4					700-1202-041
								6					700-1202-031
								7					700-1202-010
								9					700-1202-033
							1	0					700-0001-018
								1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
							2	0					700-0209-002
								1					700-0202-043 (HAST-C)
								2					700-0202-044
								4					700-0005-285
								5					700-0005-285 (HAST-C)
								6					700-0220-001
								7					700-0221-002
								8					700-1202-051

SENSING ELEMENT LIST
CONTINUED ON NEXT PAGE

ATEX APPROVED
REMOTE, 2-WIRE, INTELLIPOINT
MODEL NUMBERING SYSTEM

SHT 4 OF 9
420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY				
1	2	3	4	5	6	7	8	9	10	11	12	
R	a	T	2	b	0	c	d	*	*	*	*	
												SENSING ELEMENTS: CONTINUED...
						3	1					700-0029-001
							2					700-0029-002
							3					700-0029-003
							4					700-0029-004
							5					700-0029-005
							6					700-0029-102
							7					700-0029-103
							8					700-0029-104
							9					700-0029-105
						4	0					700-0029-106
						5	0					700-0207-001
							1					700-0207-002
							2					700-0207-003
							3					700-0207-004
							5					700-0207-006
						6	0					700-0204-038
							1					700-0204-002
							2					700-0204-048
							4					700-0204-024
							6					700-0204-022
						7	2					700-0201-027
							3					700-0201-028
						8	0					700-4200-020
							1					700-4200-030
							2					700-4200-040
							3					700-4200-060
							5					700-9000-494
						9	0					700-0201-059
							1					700-1202-015
							2					700-1202-045
							3					700-1202-055
							4					700-0209-024
						Z	Z					OTHER SENSING ELEMENTS

ATEX APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 5 OF 9
 420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

MODEL NUMBERS OF APPROVED INTRINSICALLY SAFE SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERATURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1µF.
3. MAXIMUM INSERTION LENGTH **RIGID SENSOR** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH **FLEXIBLE SENSOR** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

!! SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE

ATEX APPROVED
ADDITIONAL INTRINSICALLY
SAFE SENSING ELEMENTS

SHT 6 OF 9
420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY						
1	2	3	4	5	6	-	7	8	9	10	-	11	12	13	14	
S	a	R	b	T	2	-	0	0	c	d	-	*	*	*	*	
	a															a = 2 SIL LEVEL 2
			b													b = MEASUREMENT OPTIONS:
																N = 2 pF AUTO-CAL
																H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
																L = 2 pF FIXED
																T = 10 pF AUTO-CAL
																V = 10 pF FIXED
																P = 0.5 pF FIXED (HIGH SENSITIVITY)
					2											2 = ATEX APPROVAL, M20 HOUSING
									c	d						c, d = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-19,
																21, 24, 25, 28, 72, 73, 86, 87, 90-93.
																SENSING ELEMENTS:
									0	0						700-1202-021
										2						700-1202-024
										4						700-1202-042
										6						700-1202-032
										7						700-1202-020
										9						700-1202-034
									1	1						700-0201-005
										2						700-0201-005 (HAST C)
										3						700-0201-019
										4						700-0202-002
										5						700-0202-043
										6						700-0002-360
										7						700-0202-029
										8						700-0001-022
										9						700-0002-023
									2	1						700-0202-043 (HAST-C)
										4						700-0005-485
										5						700-0005-485 (HAST-C)
										8						700-1202-052
									7	2						700-0201-027
										3						700-0201-028
									8	6						700-0005-594
										7						700-0005-595
									9	0						700-0201-059
										1						700-1202-016
										2						700-1202-046
										3						700-1202-056

SIL, ATEX APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 7 OF 9
 420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	7	8	9	10	11	12	13	14		
S	a	R	b	T	2	-	c	0	d	e	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS:
															N = 2 pF AUTO-CAL
															H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
															L = 2 pF FIXED
															T = 10 pF AUTO-CAL
															V = 10 pF FIXED
															P = 0.5 pF FIXED (HIGH SENSITIVITY)
					2										2 = ATEX APPROVAL, M20 HOUSING
							c								c = 1-9, A-K CABLE OPTIONS, REMOTE
								d	e						d, e = SENSING ELEMENTS: 00, 02, 04, 06, 07, 09, 11-21, 24-28,
															60-62, 64, 66, 72, 73, 85, 90-94.
								0	0						700-1202-001
									2						700-1202-014
									4						700-1202-041
									6						700-1202-031
									7						700-1202-010
									9						700-1202-033
								1	1						700-0201-005
									2						700-0201-005 (HAST C)
									3						700-0201-019
									4						700-0202-002
									5						700-0202-043
									6						700-0002-360
									7						700-0202-029
									8						700-0001-022
									9						700-0002-023
								2	0						700-0209-002
									1						700-0202-043 (HAST-C)
									4						700-0005-285
									5						700-0005-285 (HAST-C)
									6						700-0220-001
									7						700-0221-002
									8						700-1202-051
								6	0						700-0204-038
									1						700-0204-002
									2						700-0204-048
									4						700-0204-024
									6						700-0204-022
								7	2						700-0201-027
									3						700-0201-028
								8	5						700-9000-494
								9	0						700-0201-059
									1						700-1202-015
									2						700-1202-045
									3						700-1202-055
									4						700-0209-024

SIL, ATEX APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 8 OF 9
 420-0004-175-CD ISS. 10

6.2 ATEX Control Drawings (Continued)

<p>SPECIFIC CONDITIONS OF USE</p> <ol style="list-style-type: none"><i>1. The enclosure contains aluminum and is considered a potential risk of ignition by impact or friction. Care must be taken into account during installation and use to prevent impact or friction.</i><i>2. The equipment shall not be applied in an explosive dust atmosphere where high electrostatic charging processes are present that could result in propagating brush discharges. See CLC/TR 60079-32-1 for additional guidance.</i>
<p>SPECIFIC CONDITIONS OF USE SHT 9 OF 9 420-0004-175-CD ISS. 9</p>

6.3 CE Mark Declaration of Conformity



205 Keith Valley Road, Horsham, PA 19044
 Telephone: 215-674-1234 Fax: 215-674-2731
 www.ametek.com www.drexelbrook.com



420-0004-250		Sht. of	1 1	APP'D BY SGA
ISSUE	EDO NO.	APP'D	DATE	
8	9-18-102	SGA	9-13-18	
9	10-18-106	SGA	11-2-18	

Declaration of Conformity

**AMETEK DREXELBROOK
 205 KEITH VALLEY ROAD
 HORSHAM, PENNSYLVANIA
 USA, 19044**

We declare under our sole responsibility that the product **2 – Wire IntelliPoint Point** Level Measurement Systems Model Number RXTX2 / SXRXT2 Series which this declaration relates is in conformity with the following standards and entitled to carry the CE Mark:

Product Type: Measurement, Control Equipment and Laboratory

Following the provisions of 2014/30/EU Directive,

Conforms to the requirements of:

EN 61326-1:-2013	Clause 7.2 Emissions Class A and Class B
EN 61326-1:-2013	Table 2 Immunity Group 1, Class B Industrial Area

Following the provisions of 2014/34/EU ATEX Directive, Harmonized Standards

Conforms to the requirements of:

EN 60079-0:2012+A11:2013, EN 60079-1:2014, EN 60079-11:2012, EN 60079-26:2015, EN 60079-31:2013, EN 60529+A1:2000+A2:2013

QAN Notified Body Number 2460

EC-Type Examination Certificate Number FM14ATEX0049
 FM Approvals Ltd. 1 Windsor Dials, Windsor, Berkshire, UK SL4 1RS


Steven G. Arnold
 Quality Assurance & Product Safety Manager

Issue Date: ____

6.4 IECEx Control Drawings

No. 420-0004-562-CD

SHT 1 OF 9

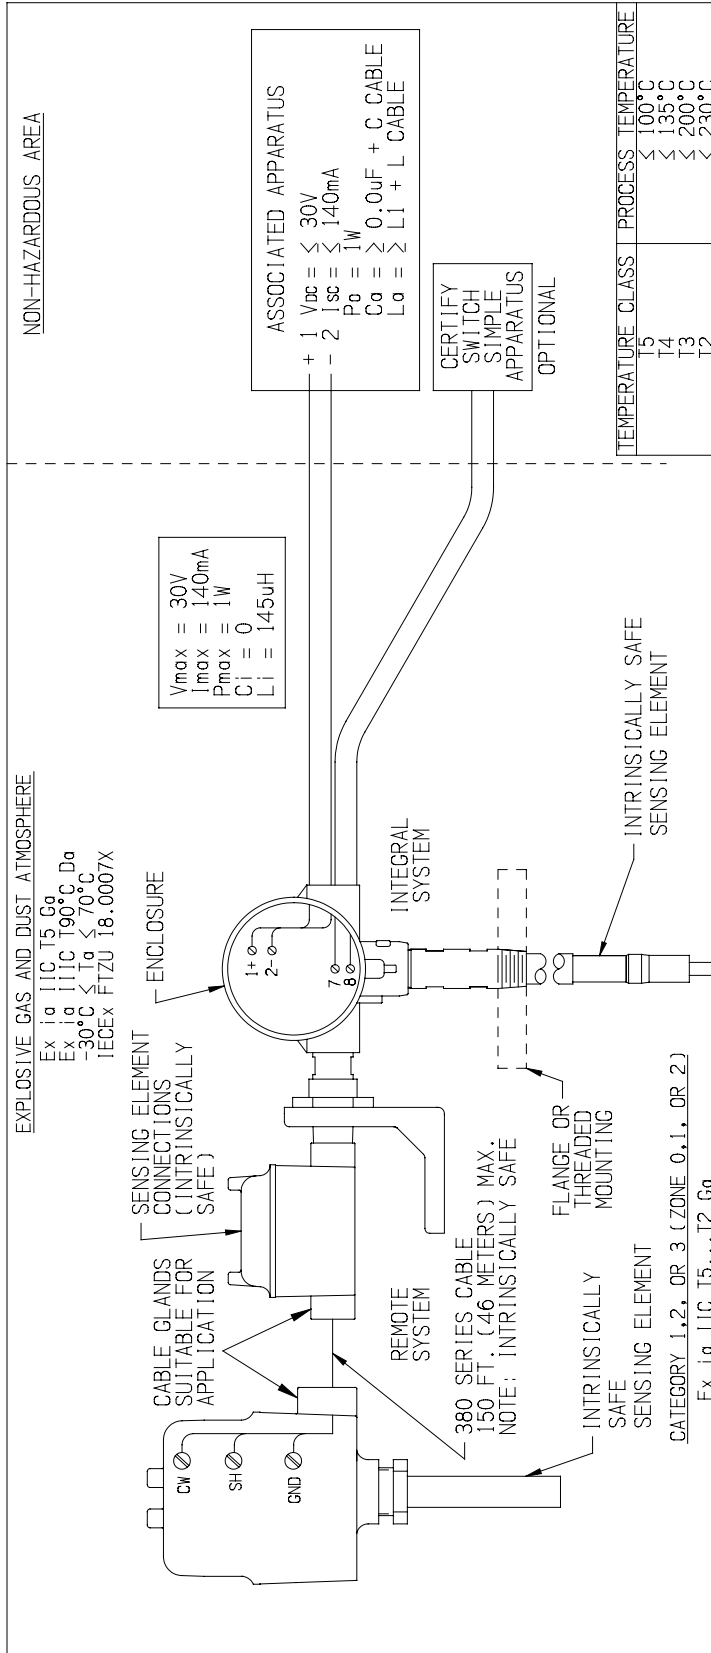


SENSING ELEMENTS ARE INTRINSICALLY SAFE FOR ABOVE CLASSIFICATIONS.

MODEL NUMBERING SYSTEM FOR IECEx APPROVED SYSTEMS - SEE SHEETS 3, 4, 5 AND 6.

MODEL NUMBERING SYSTEM FOR SIL IECEx APPROVED SYSTEMS - SEE SHEETS 7 AND 8.


- NOTES: **1** SEE PAGE 9 FOR SPECIFIC CONDITIONS OF USE.
1. ALWAYS INSTALL TO CODES/REQUIREMENTS/DIRECTIVES AS MANDATED BY THE AUTHORITY HAVING JURISDICTION.
 2. USE SUPPLY WIRING RATED FOR 90°C OR HIGHER WHEN AMBIENT IS ABOVE 50°C.
 3. USE COPPER WIRING ONLY.
 4. NO REVISIONS TO THIS DOCUMENT WITHOUT NOTIFIED BODY APPROVAL.
 5. UNUSED OPENINGS MUST BE PROPERLY SEALED TO MAINTAIN ENCLOSURE ENVIRONMENTAL AND/OR HAZARDOUS LOCATION RATINGS.

CERTIFIED	by _____	COPYRIGHT 2018	AMETEK DREXELBROOK
PO # _____		SCALE NONE	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)
ENG _____		DR. JEN 8-27-18	1 7-18-110 SGA 8-27-18
USER _____		ISS. EDO/DSR NO. APP' D	DATE
DE # _____		ISS. 420-0004-562-CD	SHT. 1 OF 9

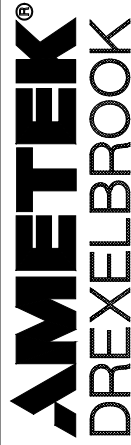

205 KELITH VALLEY RD
 HORSHAM, PA 19044-9986
 215-674-1234
 FAX 215-674-2731

6.4 IECEx Control Drawings (Continued)

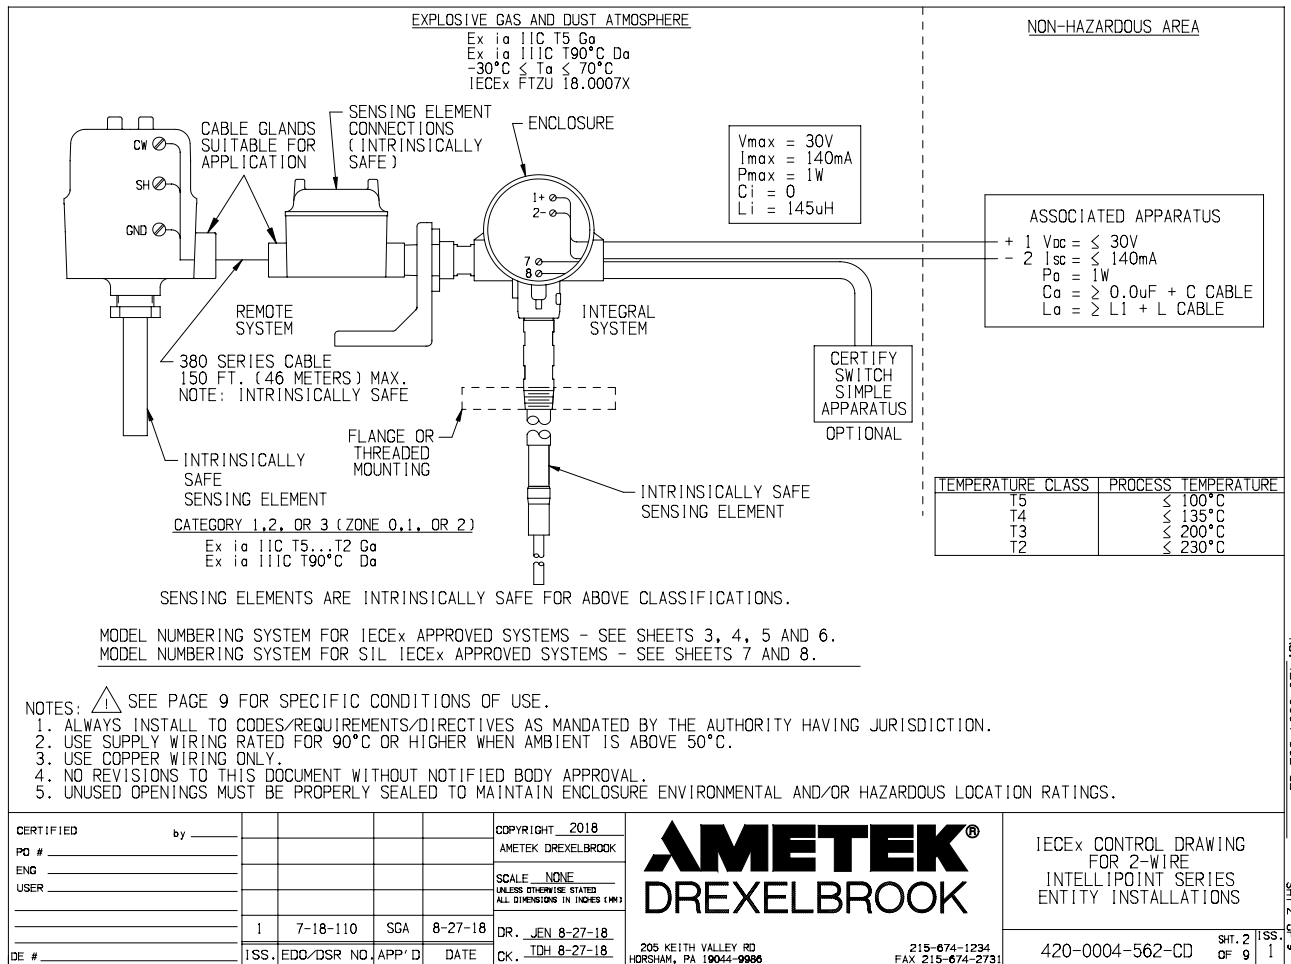

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	b	-	0	0	c	d	-	*	*	*	*
	a												
													a = MEASUREMENT OPTIONS:
													N = 2 pF AUTO-CAL
													M = MANUAL-CAL (STANDARD SENSITIVITY)
													H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
													G = MANUAL-CAL (HIGH SENSITIVITY)
													L = 2 pF FIXED
													T = 10 pF AUTO-CAL
													V = 10 pF FIXED
													P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b										b = 2 IECEx APPROVAL, M20 HOUSING
							c						c = 0, 1, 2, 7, 8, 9, Z SENSING ELEMENTS
								d					d = 0-9, Z SENSING ELEMENTS
								0	0				700-1202-021
									2				700-1202-024
									3				700-1202-028
									4				700-1202-042
									6				700-1202-032
									7				700-1202-020
									9				700-1202-034
							1	1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
							2	1					700-0202-043 (HAST-C)
								2					700-1202-044
								4					700-0005-485
								5					700-0005-485 (HAST-C)
								8					700-1202-052
							7	2					700-0201-027
								3					700-0201-028
							8	6					700-0005-594
								7					700-0005-595
							9	0					700-0201-059
								1					700-1202-016
								2					700-1202-046
								3					700-1202-056
							Z	Z					SEE SHEET 6 FOR LIST OF OTHER APPROVED SENSING ELEMENTS

IECEx APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM
 SHT 3 OF 9
 420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	b	-	c	0	d	e	-	*	*	*	*
	a												a = MEASUREMENT OPTIONS: N = 2 pF AUTO-CAL M = MANUAL-CAL (STANDARD SENSITIVITY) H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY) G = MANUAL-CAL (HIGH SENSITIVITY) L = 2 pF FIXED T = 10 pF AUTO-CAL V = 10 pF FIXED P = 0.5 pF FIXED (HIGH SENSITIVITY)
			b										b = 2 IECEx APPROVAL, M20 HOUSING
				c									c = 1-9, A-K CABLE OPTIONS, REMOTE
							d						d = 0-9, Z SENSING ELEMENTS
								e					e = 0-9, Z SENSING ELEMENTS
							0	0					700-1202-001
								2					700-1202-014
								3					700-1202-018
								4					700-1202-041
								6					700-1202-031
								7					700-1202-010
								9					700-1202-033
						1	0						700-0001-018
								1					700-0201-005
								2					700-0201-005 (HAST C)
								3					700-0201-019
								4					700-0202-002
								5					700-0202-043
								6					700-0002-360
								7					700-0202-029
								8					700-0001-022
								9					700-0002-023
						2	0						700-0209-002
								1					700-0202-043 (HAST-C)
								2					700-0202-044
								4					700-0005-285
								5					700-0005-285 (HAST-C)
								6					700-0220-001
								7					700-0221-002
								8					700-1202-051

SENSING ELEMENT LIST
CONTINUED ON NEXT PAGE

IECEx APPROVED
REMOTE, 2-WIRE, INTELLIPOINT
MODEL NUMBERING SYSTEM

SHT 4 OF 9
420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

								COLUMNS 9 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	-	5	6	7	8	-	9	10	11	12
R	a	T	b	-	c	0	d	e	-	*	*	*	*
													SENSING ELEMENTS: CONTINUED...
							3	1					700-0029-001
								2					700-0029-002
								3					700-0029-003
								4					700-0029-004
								5					700-0029-005
								6					700-0029-102
								7					700-0029-103
								8					700-0029-104
								9					700-0029-105
							4	0					700-0029-106
							5	0					700-0207-001
								1					700-0207-002
								2					700-0207-003
								3					700-0207-004
								5					700-0207-006
							6	0					700-0204-038
								1					700-0204-002
								2					700-0204-048
								4					700-0204-024
								6					700-0204-022
							7	2					700-0201-027
								3					700-0201-028
							8	0					700-4200-020
								1					700-4200-030
								2					700-4200-040
								3					700-4200-060
								5					700-9000-494
							9	0					700-0201-059
								1					700-1202-015
								2					700-1202-045
								3					700-1202-055
								4					700-0209-024
							N	N					RXXX-1XNN-NN-CD
							Z	Z					OTHER SENSING ELEMENTS

IECEx APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 5 OF 9
 420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

MODEL NUMBERS OF APPROVED INTRINSICALLY SAFE SENSING ELEMENTS

700-mnop-qrs-t LEVEL PROBE

m = FAMILY NUMBER: 0 THROUGH 9, BLANK

n = FAMILY NUMBER: 0 THROUGH 9, BLANK

o = 0 THROUGH 9, BLANK

p = 0 THROUGH 9

q = FAMILY NUMBER: 0 THROUGH 9, BLANK

r = FAMILY NUMBER: 0 THROUGH 9, BLANK

s = FAMILY NUMBER: 0 THROUGH 9

t = 24 CHARACTER EXPANDED NUMBERING SYSTEM, DOES NOT AFFECT SAFETY

NOTES:

1. MAXIMUM PROCESS TEMPERTURE 290°C.
2. MAXIMUM SENSOR CAPACITANCE < 1µF.
3. MAXIMUM INSERTION LENGTH ***RIGID SENSOR*** 30 FEET (9.14 METERS).
4. MAXIMUM INSERTION LENGTH ***FLEXIBLE SENSOR*** 2000 FEET (609.6 METERS).
5. SENSING ELEMENT ENCLOSURE IP66 (IP RATING DOES NOT APPLY TO SPECIAL SENSORS SUPPLIED WITHOUT A 285- SERIES SENSING ELEMENT ENCLOSURE).

IECEx APPROVED
ADDITIONAL INTRINSICALLY
SAFE SENSING ELEMENTS

SHT 6 OF 9
420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	-	7	8	9	10	-	11	12	13	14
S	a	R	b	T	c	-	0	0	d	e	-	*	*	*	*
	a														a = 2 SIL LEVEL 2
			b												b = MEASUREMENT OPTIONS:
															N = 2 pF AUTO-CAL
															H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)
															L = 2 pF FIXED
															T = 10 pF AUTO-CAL
															V = 10 pF FIXED
															P = 0.5 pF FIXED (HIGH SENSITIVITY)
					c										c = 2 IECEx APPROVAL, M20 HOUSING
									d						d = 0, 1, 2, 7, 8, 9 SENSING ELEMENTS
										e					e = 0-9
															SENSING ELEMENTS:
								0	0						700-1202-021
									2						700-1202-024
									4						700-1202-042
									6						700-1202-032
									7						700-1202-020
									9						700-1202-034
								1	1						700-0201-005
									2						700-0201-005 (HAST C)
									3						700-0201-019
									4						700-0202-002
									5						700-0202-043
									6						700-0002-360
									7						700-0202-029
									8						700-0001-022
									9						700-0002-023
								2	1						700-0202-043 (HAST-C)
									4						700-0005-485
									5						700-0005-485 (HAST-C)
									8						700-1202-052
								7	2						700-0201-027
									3						700-0201-028
								8	6						700-0005-594
									7						700-0005-595
								9	0						700-0201-059
									1						700-1202-016
									2						700-1202-046
									3						700-1202-056

SIL, IECEx APPROVED
 INTEGRAL, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 7 OF 9
 420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

										COLUMNS 11 AND UP, DO NOT AFFECT SAFETY					
1	2	3	4	5	6	7	8	9	10	-	11	12	13	14	
S	a	R	b	T	c	-	d	0	e	f	-	*	*	*	*
	a													a = 2 SIL LEVEL 2	
			b											b = MEASUREMENT OPTIONS:	
														N = 2 pF AUTO-CAL	
														H = 0.5 pF AUTO-CAL (HIGH SENSITIVITY)	
														L = 2 pF FIXED	
														T = 10 pF AUTO-CAL	
														V = 10 pF FIXED	
														P = 0.5 pF FIXED (HIGH SENSITIVITY)	
					c									c = 2 IECEx APPROVAL, M20 HOUSING	
						d								d = 1-9, A-K CABLE OPTIONS, REMOTE	
								e						e = 0, 1, 2, 6, 7, 8, 9 SENSING ELEMENTS	
									f					f = 0-9 SENSING ELEMENTS	
								0	0					700-1202-001	
									2					700-1202-014	
									4					700-1202-041	
									6					700-1202-031	
									7					700-1202-010	
									9					700-1202-033	
								1	1					700-0201-005	
									2					700-0201-005 (HAST C)	
									3					700-0201-019	
									4					700-0202-002	
									5					700-0202-043	
									6					700-0002-360	
									7					700-0202-029	
									8					700-0001-022	
									9					700-0002-023	
								2	0					700-0209-002	
									1					700-0202-043 (HAST-C)	
									4					700-0005-285	
									5					700-0005-285 (HAST-C)	
									6					700-0220-001	
									7					700-0221-002	
									8					700-1202-051	
								6	0					700-0204-038	
									1					700-0204-002	
									2					700-0204-048	
									4					700-0204-024	
									6					700-0204-022	
								7	2					700-0201-027	
									3					700-0201-028	
								8	5					700-9000-494	
								9	0					700-0201-059	
									1					700-1202-015	
									2					700-1202-045	
									3					700-1202-055	
									4					700-0209-024	

SIL, IECEx APPROVED
 REMOTE, 2-WIRE, INTELLIPOINT
 MODEL NUMBERING SYSTEM

SHT 8 OF 9
 420-0004-562-CD ISS. 1

6.4 IECEx Control Drawings (Continued)

SPECIFIC CONDITIONS OF USE:

- 1 THE EQUIPMENT SHALL NOT BE APPLIED IN AN EXPLOSIVE DUST ATMOSPHERE WHERE HIGH ELECTROSTATIC CHARGING PROCESSES ARE PRESENT THAT COULD RESULT IN PROPAGATING BRUSH DISCHARGES.

- 2 CONSULT THE MANUFACTURER IF DIMENSIONAL INFORMATION ON THE FLAMEPROOF JOINTS IS NECESSARY.

- 3 AMBIENT TEMPERATURE RANGE:
-30°C TO +58°C FOR RXLX/SXRXTX INTELLIPOINT RF LEVEL SYSTEM
-30°C TO +70°C FOR RXTX/SXRXTX INTELLIPOINT RF TWO-WIRE POINT LEVEL SYSTEM

IECEx APPROVED
2-WIRE, INTELLIPOINT
SPECIFIC CONDITIONS OF USE

SHT 9 OF 9
420-0004-562-CD ISS. 1

6.5 Mounting and Wiring for Spark Protector Drawings

NO. 377-0001-019

SHT 1 OF 2

TYPICAL INSTALLATION OF SPARK PROTECTORS

FIGURE -A- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO FLEXIBLE 2-TERMINAL ELEMENTS; 700-0005-XXX.

FIGURE -B- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO RIGID 2-TERMINAL SENSING ELEMENTS 700-0001-XXX & 700-0002-XXX.

FIGURE -C- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE TO RIGID 3-TERMINAL SENSING ELEMENTS; 700-0200-XXX & 700-0202-017.

FIGURE -D- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE ON FLEXIBLE 3-TERMINAL SENSING ELEMENT 700-0205-XXX.

FOR HI-TEMP APPLICATIONS REFER TO 377-0001-016-CD.

••APPROVED DRAWING••
 CHANGES TO THIS DRAWING
 REQUIRE AGENCY APPROVAL
 PER 440-0015-003
 CFM CSA KEMA

 420-0002-017

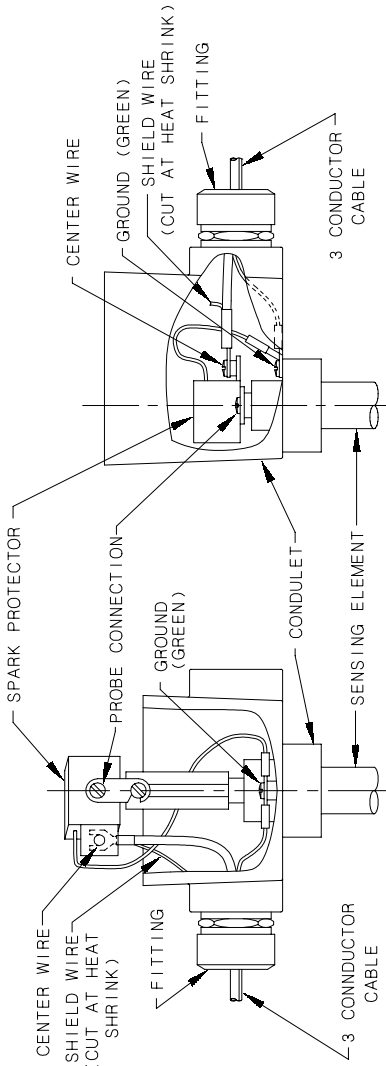


FIGURE -A-

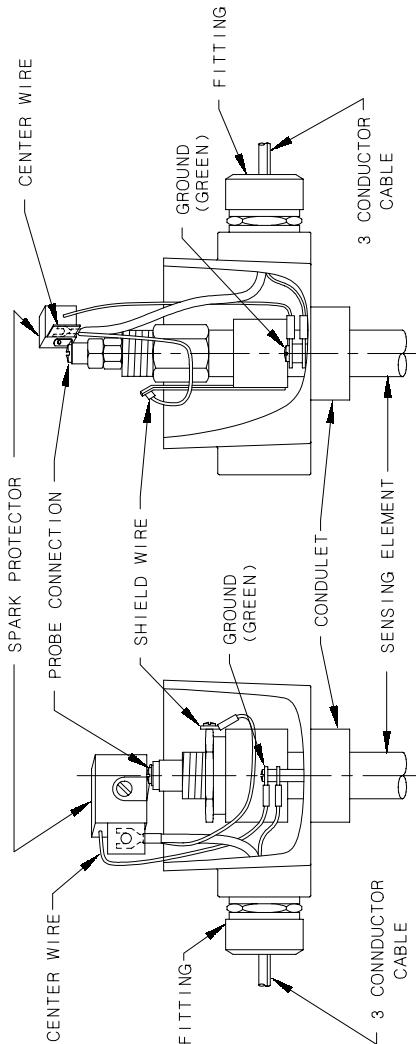


FIGURE -B-

FIGURE -C-

FIGURE -D-

CERTIFIED	by _____	COPYRIGHT 2004	AMETEK DREXELBROOK
PO #	5 2-04-336	SCALE	NONE
ENG	4 7-93-303	UNLESS OTHERWISE STATED	
USER	3 8-92-83	JET	5-25-93
ISS. #	ED0/DSR NO. APP'D	MPG	8-31-92
DATE	_____	DR.	CDW
DE #	_____	CK.	_____

<p>AMETEK® DREXELBROOK</p>		215-674-1234 FAX 215-674-2731
205 KEITH VALLEY RD. HORSHAM, PA 19044-9886		377-0001-019-CD
377-0001-019 HEAVY DUTY SPARK PROTECTOR CUSTOMER CONNECTION MOUNTING & WIRING		SHT. 1 OF 2 OF 2

6.5 Mounting and Wiring for Spark Protector (Continued)

NO. 377-0001-019

SHT 2 OF 2

TYPICAL INSTALLATION OF SPARK PROTECTORS

FIGURE -E- : CONNECTION OF THREE CONDUCTOR COTE SHIELD CABLE IN PARALLEL WITH REMOTE VERIFY SWITCH.

FOR HI. TEMP APPLICATIONS REFER TO 377-0001-016 -CD.


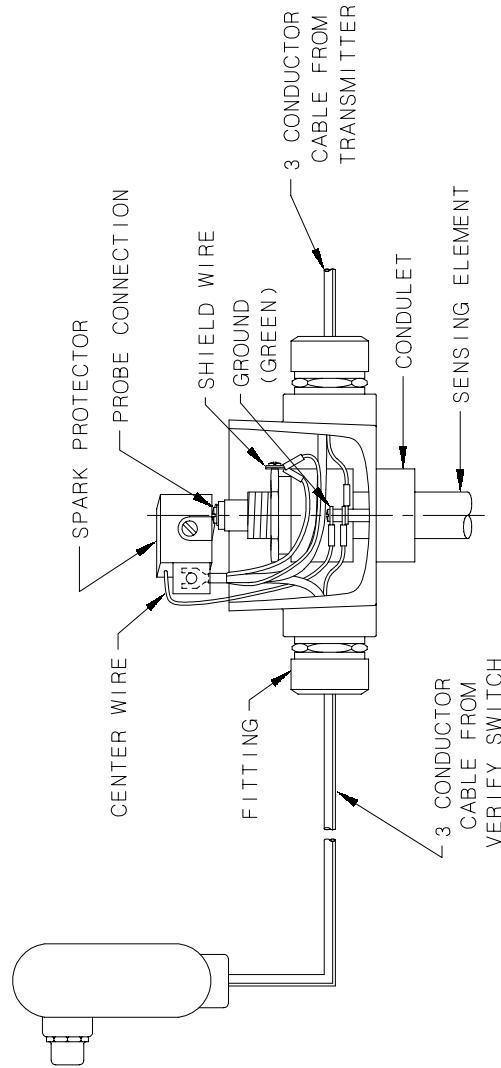



FIGURE -E-

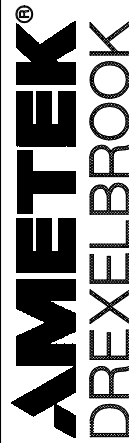

205 KEITH VALLEY RD.
HOBBSHAM, PA. 19044-9886
215-674-1934
FAX 215-674-2731

CERTIFIED	by	COPYRIGHT	2004	377-0001-019 HEAVY DUTY SPARK PROTECTOR CUSTOMER CONNECTION MOUNTING & WIRING		
PO #		AMETEK	DREXELBROOK	SHT. 2 OF 2		
ENG	5	SCALE	NONE	OF 2		
USER		UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (IMA)		5		
	4	7-93-303	JET	5-25-93		
	3	8-92-83	MPG	8-31-92		
ISS. #		EDO/DSR NO.	APP'D	DATE		
DE #						

6.5 Mounting and Wiring for Spark Protector (Continued)

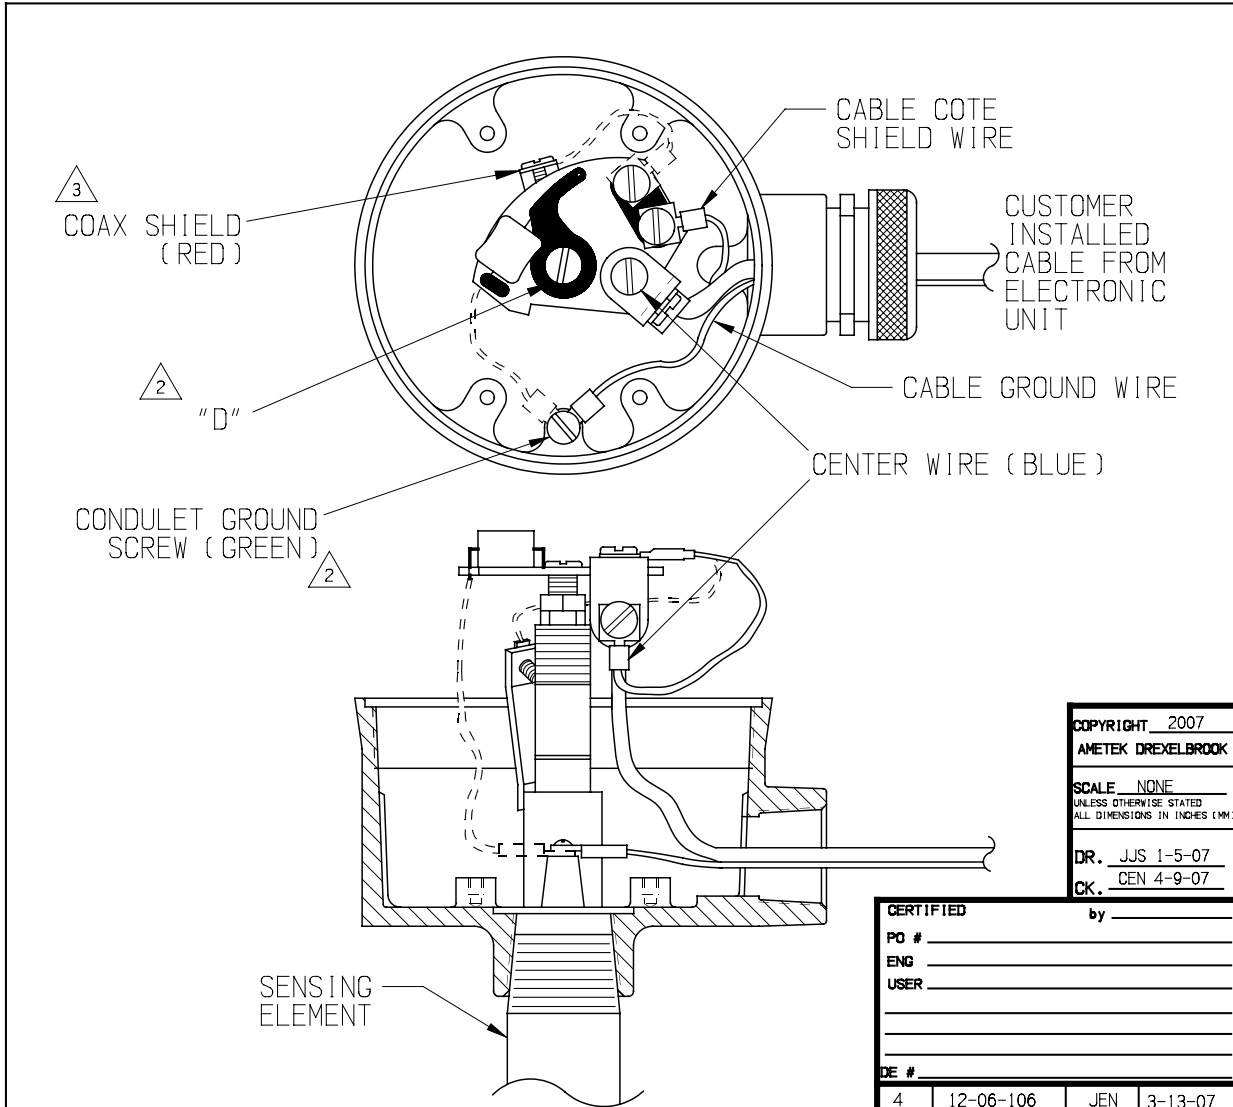

NOTES:

1. SPARK PROTECTOR IS SHOWN ON A 303-0029-10X PROBE. IT CAN BE INSTALLED ON OTHER COTE SHIELD PROBES IN THE SAME MANNER.
2. SPARK PROTECTOR IS MOUNTED IN CONDULET WITH LAND SIDE UP. CENTER ROD OF SENSING ELEMENT CONNECTION IS THROUGH HOLE "D". RING LUG IS ATTACHED TO GROUND SCREW (GREEN) BY D.E.
3. D.E. INSTALLED JUMPER WIRE 353-0002-047 TO JUMPER SHIELD OF PROBE TO SPARK PROTECTOR. RING LUG END GOES TO THE PROBE, SPADE LUG END GOES TO SPARK PROTECTOR PCB.
4. TEMPERATURE RANGE: -55°C TO +125°C.
5. ALL DASHED WIRES ARE FACTORY INSTALLED.

COPYRIGHT 2007
 AMETEK DREXELBROOK
 SCALE NONE
 UNLESS OTHERWISE STATED
 ALL DIMENSIONS IN INCHES (MM)
 DR. JJS 1-5-07
 CK. CEN 4-9-07

CERTIFIED		by _____	
PO #	_____		
ENG	_____		
USER	_____		
DE # _____			

4	12-06-106	JEN	3-13-07
3	1-01-304	JET	5-18-01
2	6-99-246	DL	8-16-99
1	4-99-303	JET	6-10-99
A	1-80-221	—	2-21-80

ISS.	EDO/DSR NO.	APP'D	DATE
------	-------------	-------	------

AMETEK®
DREXELBROOK
 205 KEITH VALLEY RD
 HORSHAM, PA 19044-9986
 215-674-1234
 FAX 215-674-2731

MOUNTING AND WIRING FOR
 SPARK PROTECTOR
 377-0001-016

377-0001-016-CD SH. 1 OF 4 ISS. 4

377-0001-016-CD SH. 1 OF 4

6.6 Adding a Padded Capacitor

NO. 330-0009-022-CD

SHT 1 OF 3

ADDING A PADDED CAPACITOR:
 THE TUNING RANGE OF EACH POINT LEVEL SWITCH IS LIMITED. LONG INSERTION LENGTH SENSING ELEMENTS OR SENSING ELEMENTS MOUNTED IN PIPES OR NEAR METAL OBJECTS MAY GENERATE ENOUGH STANDING CAPACITANCE TO EXCEED THE TUNING RANGE OF THE SWITCH.

THE ADDITION OF AN EXTERNAL PADDING CAPACITOR WILL INCREASE THE TUNING RANGE OF THE UNIT. TUNING RANGES AND EXAMPLES OF INCREASES CAN BE FOUND FOR EACH TYPE OF POINT LEVEL ELECTRONIC SWITCH ON SHEET THREE.

WHEN A PADDING CAPACITOR IS REQUIRED, AN NPO CAPACITOR SHOULD BE ADDED TO THE PADDING TERMINALS AS INDICATED ON SHEET 2. ADDITIONAL PADS CAN BE ADDED IN PARALLEL UNIT A SATISFACTORY TUNING RANGE IS REACHED. IF A TUNING RANGE CANNOT BE REACHED, OR, IF PADDING IS IN EXCESS OF THE MAXIMUM RECOMMENDED TUNING RANGE AS INDICATED IN THE TABLE ON SHEET 3, PLEASE CONTACT THE FACTORY SERVICE DEPARTMENT.

NOTE: ON SOME TRANSMITTERS, THE PAD CAPACITOR IS SOLDERED TO TURRETS. OTHER TRANSMITTERS ATTACH THE LEADS UNDER SCREWS.

CERTIFIED		by _____		COPYRIGHT © 2013		AMETEK DREXELBROOK		PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES	
PO #	3	9-13-101	WS	7-6-05	DR. JLS 9-20-13	SCALE	NONE	330-0009-022-CD	
ENG	2	6-05-243	WS	7-6-05	UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	215-674-1284 FAX 215-674-2731		SHT. 1 OF 3	
USER	1	7-01-303	JET	8-9-01	DR. JLS 9-20-13	205 KEITH VALLEY RD HORSHANK, PA 19044-9986		ISS	
DE #	ISS	EDD/DSR NO.	APP/D	DATE	CK			3	

6.6 Adding a Padded Capacitor (Continued)

INTELLIPOINT (TM)

CIRCUIT BOARD

PAD TERMINALS

NO. 330-0009-022-CD

SHT 2 OF 3

LCS (TM) & LCT (TM)

PAD TERMINALS

ThePoint (TM)

PAD CAPACITOR BETWEEN PAD TERMINAL AND PROBE TERMINAL

PAD TERMINAL

PROBE TERMINAL

REMOVE ELECTRONIC UNIT TO ACCESS PAD TERMINALS

AMETEK®
DREXELBROOK

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

PAD CAPACITOR KIT
FOR POINT LEVEL SWITCHES

330-0009-022-CD SHT. 2 OF 3

CERTIFIED	by _____	COPYRIGHT, 2013	AMETEK DREXELBROOK		
PO #	9-13-101	9-23-13	SCALE	NONE	
ENG	WS	7-6-05	ALL DIMENSIONS IN INCHES (IN)		
USER	7-01-303	JET	DR. JUS 9-20-13		
ISS. EDD/DSR NO.	APP'D	DATE	CK. <i>[Signature]</i>		
DE #					

6.6 Adding a Padded Capacitor (Continued)

No. 330-0009-022-CD

SH. 3 OF 3


PRODUCT	SENSITIVITY	MODEL NUMBERS	UN-PADDED TUNING RANGE	PADDING RATIO	PADDING EXAMPLE	MAX RECOMMENDED TUNING RANGE
THE POINT™ LINE POWERED	HIGH	PHL, PPL, PGL	0 TO 25pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 35pF	50 TO 75pF
THE POINT™ LINE POWERED	STANDARD	PNL, PLL, PTL, PVL, PML	0 TO 60pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 70pF	120 TO 180pF
THE POINT™ TWO WIRE	HIGH	PHT, PPT, PGT	0 TO 25pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 35pF	50 TO 75pF
THE POINT™ TWO WIRE	STANDARD	PNT, PLT, PTT, PVT, PMT	0 TO 60pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 70pF	120 TO 180pF
INTELLIPOINT™ LINE POWERED AND TWO WIRE	HIGH	RHL, RPL, RGL, RHT, RPT, RGT	0 TO 25pF	4.33:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 43pF TO 69pF	50 TO 75pF
INTELLIPOINT™ LINE POWERED AND TWO WIRE	STANDARD	RNL, RLL, RTL, RVL, RML, RNT, RLT, RTT, RVT, RMT	0 TO 100pF	4.33:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 43pF TO 143pF	200 TO 300pF
LCS	HIGH	406-6020, 406-6022	0 TO 8pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 18pF	16 TO 24pF
LCS	STANDARD	406-6000, 406-6002	0 TO 90pF	3:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 30pF TO 120pF	180 TO 270pF
LCT	HIGH	406-6220, 406-6222	0 TO 8pF	1:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 10pF TO 18pF	16 TO 24pF
LCT	STANDARD	406-6200, 406-6202	0 TO 90pF	3:1	ADDING A 10pF CAP WILL CHANGE THE RANGE TO 30pF TO 120pF	180 TO 270pF

CERTIFIED		by _____		COPYRIGHT 2013	
PO # _____	_____	_____	_____	AMETEK DREXELBROOK	_____
ENG _____	_____	_____	_____	SCALE NONE	_____
USER _____	_____	_____	_____	UNLESS OTHERWISE STATED	_____
_____	_____	_____	_____	ALL DIMENSIONS IN INCHES (MM)	_____
_____	_____	_____	_____	DR. JJS 9-20-13	_____
DE # _____	_____	_____	_____	CK. JET 9-22-13	_____
ISS. EDD/DSR NO. APP'D	DATE	DATE	DATE	205 WETLI VALLEY RD.	_____
_____	_____	_____	_____	10000147, PA 19014-9886	_____

PAD CAPACITOR KIT FOR POINT LEVEL SWITCHES	
330-0009-022-CD	SH. 3 OF 3




6.7 Dual Seal Assembly for 700 Series Sensing Elements

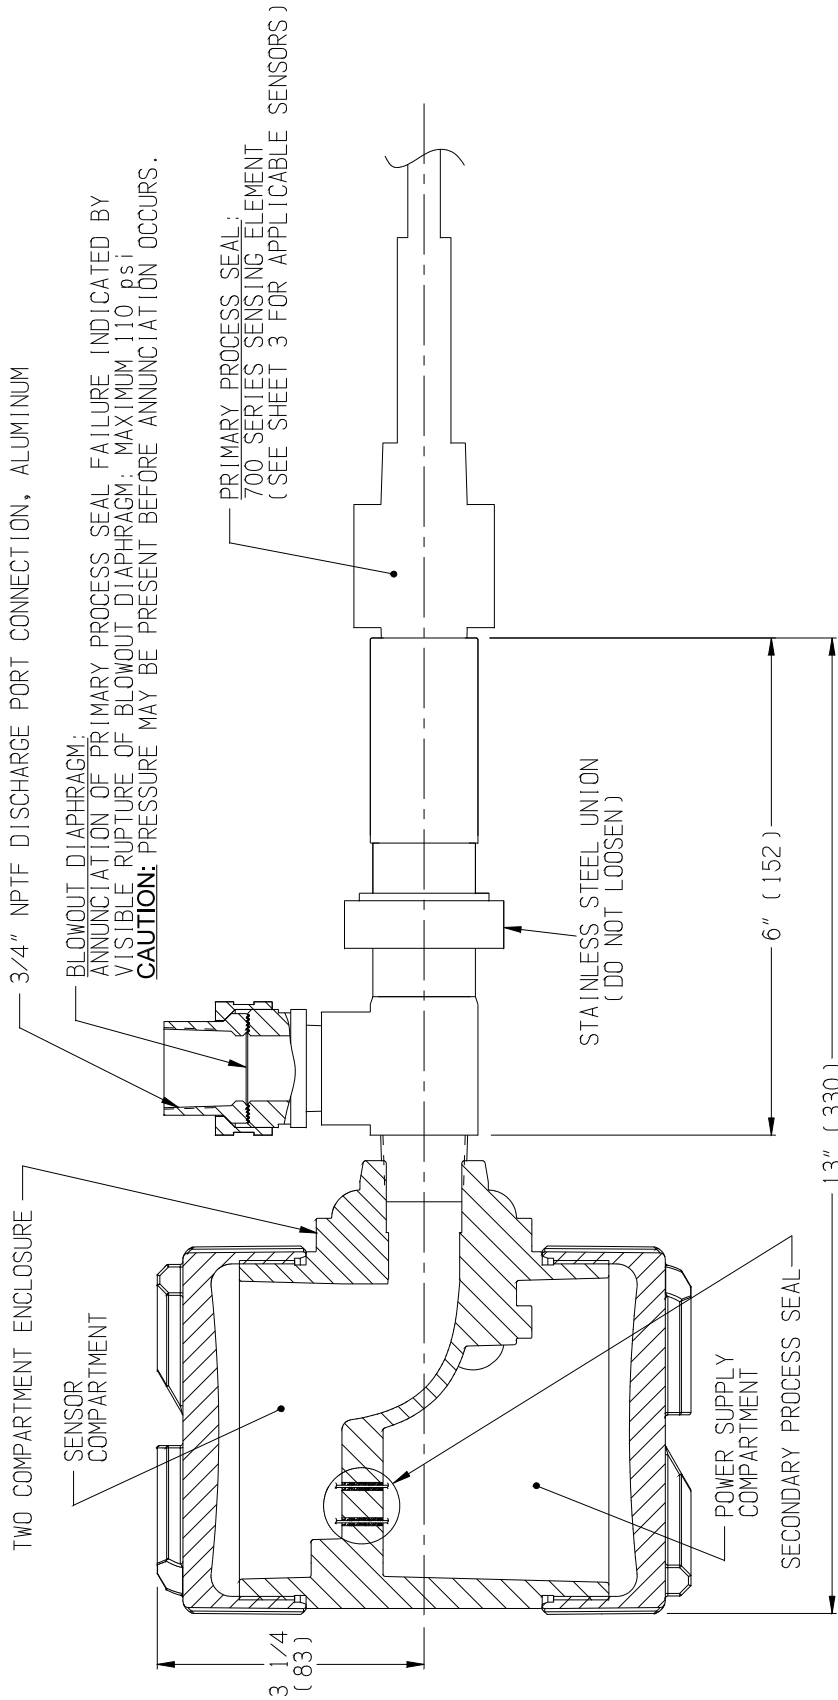

NOTES:


1. ANSI / ISA 12.27.01-2003 FM CERTIFIED "DUAL SEAL" WHEN USED WITH AMETEK DREXELBROOK 700 SERIES SENSING ELEMENTS
2. SEE SHEET 3 FOR 700 SERIES PRIMARY SEAL PROCESS WETTED MATERIALS.
3. REFER TO SENSING ELEMENT TAG FOR PROCESS TEMPERATURE AND PRESSURE RATINGS.

APPROVED	by _____	COPYRIGHT 2015	AMETEK DREXELBROOK	
DESIGN	3	2-15-111	THP	3-11-15
SERIAL	2	1-12-114	JEN	1-20-12
	1	4-08-106	TDH	9-10-08
ISSUED/DSR NO./APP'D			DR.	JEN 3-11-15
#			CK.	TDH 3-11-15
CONTROL DRAWING, DUAL SEAL ASSEMBLY FOR USE WITH 700 SERIES SENSING ELEMENTS			285-0003-0XX-CD	
			SHT. 1 OF 3	
			205 KEITH VALLEY RD HORSHAM, PA 19044-9986	
			215-674-1234 FAX 215-674-2731	

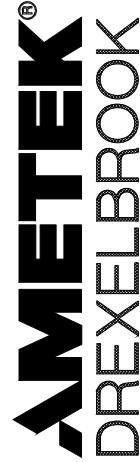


6.7 Dual Seal Assembly (Continued)

285-0003-02X DUAL SEAL CONFIGURATION FOR SINGLE COMPARTMENT ENCLOSURE

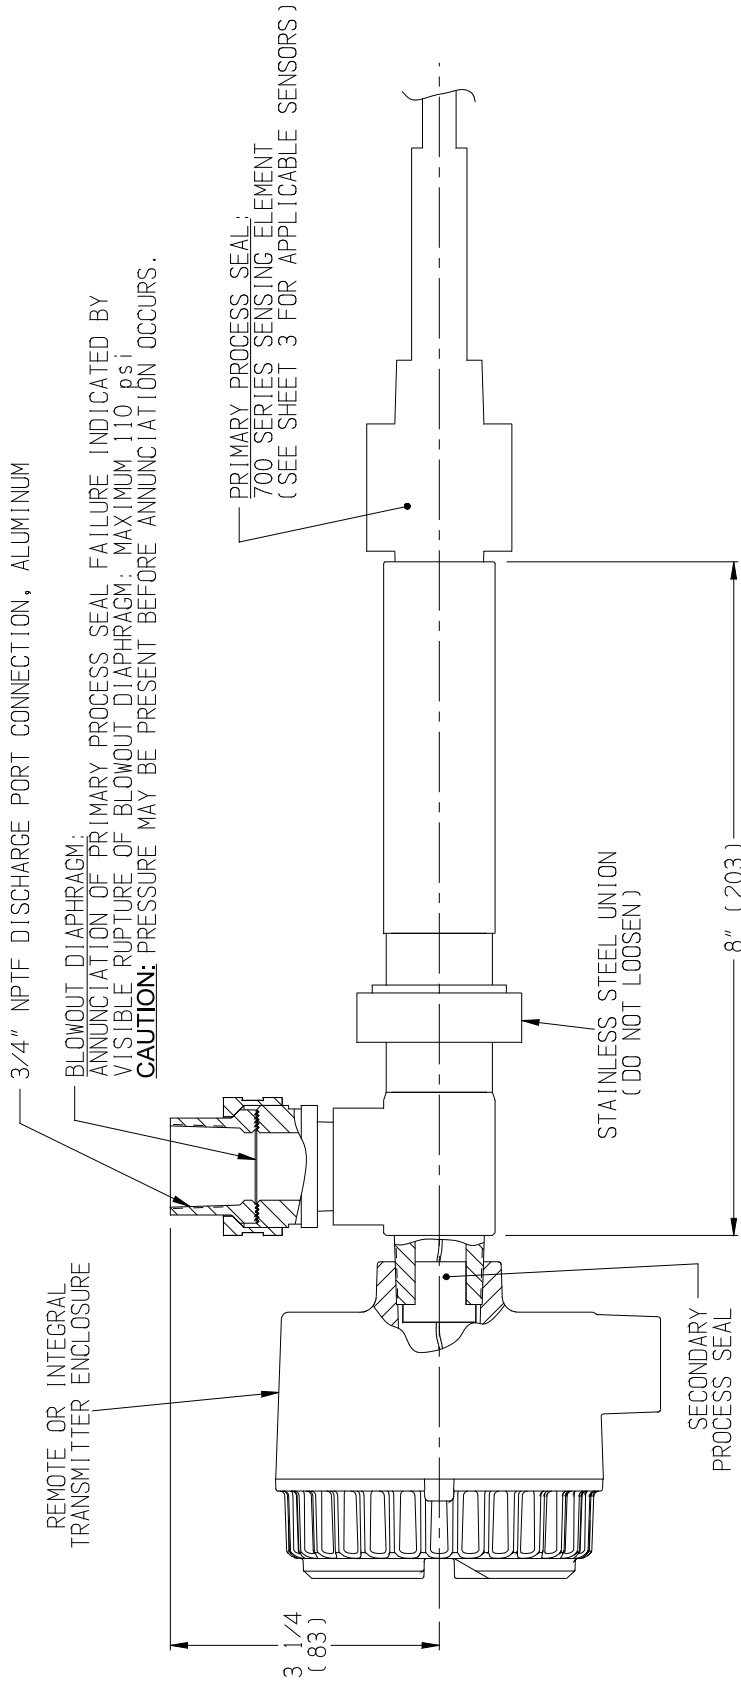

- NOTES:
- ANSI / ISA 12.27.01-2003 FM CERTIFIED "DUAL SEAL" WHEN USED WITH AMETEK DREXELBROOK 700 SERIES SENSING ELEMENTS
 - SEE SHEET 3 FOR 700 SERIES PRIMARY SEAL PROCESS WETTED MATERIALS.
 - REFER TO SENSING ELEMENT TAG FOR PROCESS TEMPERATURE AND PRESSURE RATINGS.

ERTIFIED	by _____	COPYRIGHT 2015	AMETEK DREXELBROOK	CONTROL DRAWING, DUAL SEAL ASSEMBLY FOR USE WITH 700 SERIES SENSING ELEMENTS
0 #				
NG	3 2-15-111	THP	3-11-15	
SER	2 1-12-114	JEN	1-20-12	
	1 4-08-106	TDH	9-10-08	
#	ISS, EDC/DSR NO. / APP. / D	DATE	DR. / JEN 3-11-15	
			CK. / TDH 3-11-15	
				285-0003-0XX-CD
				SHT. 2 OF 3

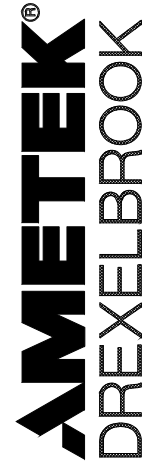

205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

6.7 Dual Seal Assembly (Continued)

SENSING ELEMENT IS AVAILABLE

SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS	SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS	SENSOR MODEL #	PRIMARY SEAL WETTED MATERIALS
700-0001-022	TFE/316SS	700-0002-054	FEP/TFE/316SS	700-0202-053	TFE/316SS
700-0001-024	TFE/316SS	700-0002-057	PVDF/TFE/316SS	700-0202-054	TFE/316SS
700-0001-026	TFE/316SS	700-0002-064	PVDF/TFE/316SS	700-0202-056	TFE/316SS
700-0001-034	TFE/CS	700-0002-224	TFE/316SS	700-1202-001	PEEK/316SS
700-0001-040	POLYETHYLENE/316SS	700-0002-321	FEP/TFE/316SS	700-1202-010	PEEK/316SS
700-0001-044	PFA/316SS	700-0002-360	PFA/TFE/316SS	700-1202-014	PEEK/316SS
700-0001-054	TFE/316SS	700-0005-054	PFA/TFE/316SS	700-1202-015	PEEK/316SS
700-0001-064	TFE/316SS	700-0201-005	TFE/316SS	700-1202-018	PEEK/316SS
700-0001-074	TFE/316SS	700-0201-025	TFE/316SS	700-1202-031	PEEK/316SS
700-0001-344	PFA/316SS	700-0201-026	TFE/316SS	700-1202-033	PEEK/316SS
700-0002-023	TFE/316SS	700-0201-027	TFE/316SS	700-1202-041	PEEK/316SS
700-0002-024	TFE/316SS	700-0201-028	TFE/316SS	700-1202-045	PEEK/316SS
700-0002-027	FEP/TFE/316SS	700-0201-035	TFE/316SS	700-1202-051	PEEK/316SS
700-0002-028	TFE/316SS	700-0201-051	TFE/316SS	700-1202-055	PEEK/316SS
700-0002-033	TFE/316SS	700-0201-052	TFE/316SS	700-1202-061	PEEK/316SS
700-0002-037	PVDF/TFE/316SS	700-0201-058	TFE/316SS	700-1202-081	PEEK/316SS
700-0002-040	UHMW PE/SILICONE/316SS	700-0201-059	TFE/316SS	700-9100-403	PEEK/316SS
700-0002-044	PVDF/TFE/316SS	700-0202-002	TFE/316SS	700-9100-404	PEEK/316SS
				700-1230-XXX-XX-XXX	PEEK/CS/316SS



DRAFTED # _____ BY _____ DATE _____ 3 2-15-111 THP 3-11-15 2 1-12-114 JEN 1-20-12 1 4-08-106 TDH 9-10-08	COPYRIGHT © 2015 AMETEK DREXELBROOK SCALE: NONE UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)	CONTROL DRAWING, DUAL SEAL ASSEMBLY FOR USE WITH 700 SERIES SENSING ELEMENT	285-0000-0XX-00 SHIT. 3 5

Appendix: A

Appendix A: Shortening or Lengthening the Sensing Element



CAUTION:


*The insulation length of either **Flush Sensing Elements** or **Insulated Sensing Elements** can **NOT** be changed. **Cable Sensing Elements** can only be shortened. Instructions are included with each unit.*

The Need

Sometimes your application calls for probe lengths other than the standard 18-inch or longer insertion lengths supplied. Shortening the sensing element is quite simple and can be done in the field. Lengthening the sensing element, however, is more difficult because the metal rod, typically 304 SS or 316 SS, must be welded.

NOTE:

*Cote-Shield element must **NEVER** be modified.*

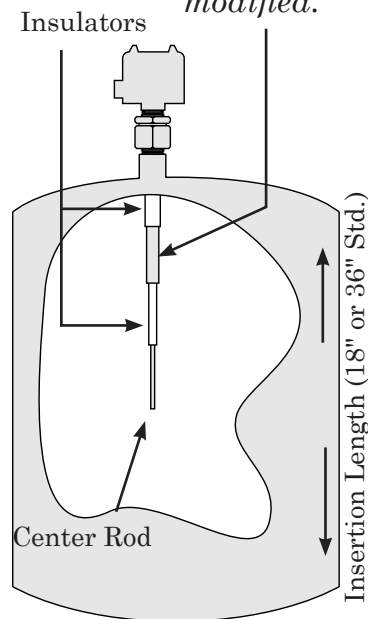

Before making any Adjustments:

- 1) Read the following instructions thoroughly.
- 2) Remove power.
- 3) Disconnect the electronics.
- 4) Protect electronics from any static discharge.
- 5) Protect electronics from any heat.

Shortening

The bare metal center rod of the sensing element can be shortened with a hacksaw. Be careful not to cut either of the two insulators. See Figure on this page.

In applications using conductive or water-based materials, shortening is not a problem. Leave a minimum bare metal center rod length of two (2) inches.

For dry granular materials, such as powder, sand, corn, clinker, etc., you must leave a minimum bare metal center rod length of eight (8) inches. Consult the factory before shortening beyond this point.

Lengthening

To lengthen the sensing element, an extension rod can be welded onto the end of the bare metal center rod. Make sure that the extension rod is the same metal as the sensing element.

An alternate option is to add a pipe coupling and a section of metal pipe after threading the tip of the sensing element. In this case, the metal pipe need not be identical to the metal of the sensing element.



Any changes to probe length after calibration requires re calibration to ensure proper operation.

CE Installation Supplement

Purpose: To provide additional information that is required to be in compliance with the CE mark of conformity and 2014/30/EU Directive.

- Definitions:**
1. I/O Sensor/Measurement/Control Port -- Any port which provides level measurement, control, and/or DC power.
 2. I/O AC Power -- Any port which provides AC main power to the instrument.
 3. Housing -- Any enclosure where the sensor and transmitter can be located.
 4. Non-metallic applications -- any application where the sensor is not surrounded by a metallic surface.

Installation Specifics:

1. I/O Sensor/Measurement/Control Ports

- Wiring must be twisted pair and run in conduit or an equivalent shielded environment (i.e. shielded braid, cable, etc.).
- The shield terminations must be grounded at the source and destination ports.
- Wiring must be run separate from AC main power and/or any signal exceeding 75 volts DC or 50 volts AC.

2. I/O AC Power Port

- Wiring must be run either in conduit or an equivalent shielded environment (i.e. shielded braid, cable, etc.).
- The shield terminations must be grounded at the source and destination ports.

CE Installation Supplement (Continued)

3. Remote Installations

- Sensor port must be connected to the transmitter port by one of the following means:
 - 401-16 Probe Filter
 - Coaxial cable run in conduit.
 - Triaxial cable.

4. Housings

- All installations require the sensor and transmitter to be located in a closed shielded/metal housing (i.e. typically explosion-proof or weatherproof housings meet this requirement)

5. Sensor Type/Mounting

- In all non-metallic applications the sensor must have a full concentric shield (i.e. needs to be considered when ordering).
- The sensor/sensor conduit must be grounded locally either to a metal support structure or an equivalent earth ground.

Comments:

- Any deviation from these installation requirements should be reviewed with factory, prior to implementation
- These instructions are essential to insure conformity with specified EC directives.

Appendix: B

EXIDA Management Summary



Proof test must be performed to certify proper operation for SIL performance. Reference Appendix B in the EXIDA Failure Modes, Effects and Diagnostic Analysis located on the Drexelbrook.com website under support/documentation.



Management Summary

This report summarizes the results of the hardware assessment in the form of a Failure Modes, Effects, and Diagnostic Analysis (FMEDA) of the IntelliPoint RF Series Point Level Switch, hardware and software revision per Section 2.5.1. A Failure Modes, Effects, and Diagnostic Analysis is one of the steps to be taken to achieve functional safety certification per IEC 61508 of a device. From the FMEDA, failure rates are determined. The FMEDA that is described in this report concerns only the hardware of the IntelliPoint. For full functional safety certification purposes all requirements of IEC 61508 must be considered.

The Ametek Drexelbrook IntelliPoint detects the presence of material in a vessel by sensing the change in capacitance when the material contacts the IntelliPoint sensing element. The IntelliPoint is designed to ignore the effect of buildup or material coating on the sensing element.

Table 1 gives an overview of the different versions that were considered in the FMEDA of the IntelliPoint.

Table 1 Version Overview

Loop	IntelliPoint with 4-20mA loop power and output – model SxRNTx-x0xx-xxxx
Relay	IntelliPoint with 18-200VDC or 85-250VAC power and dual relay output – model SxRNLx-x1xx-xxxx or SxRNLx-x2xx-xxxx

The IntelliPoint is classified as a Type B¹ element according to IEC 61508, having a hardware fault tolerance of 0.

The failure rate data used for this analysis meets the *exida* criteria for Route 2_H (see Section 5.2). Therefore, the IntelliPoint meets the hardware architectural constraints for up to SIL 2 at HFT=0 (or SIL 3 @ HFT=1) when the listed failure rates are used.

Based on the assumptions listed in 4.3, the failure rates for the IntelliPoint are listed in section 4.5.

These failure rates are valid for the useful lifetime of the product, see Appendix A.

The failure rates listed in this report are based on over 250 billion unit operating hours of process industry field failure data. The failure rate predictions reflect realistic failures and include site specific failures due to human events for the specified Site Safety Index (SSI), see section 4.2.2.

A user of the IntelliPoint can utilize these failure rates in a probabilistic model of a safety instrumented function (SIF) to determine suitability in part for safety instrumented system (SIS) usage in a particular safety integrity level (SIL).

EXIDA Report Results

4.5 Results

Using reliability data extracted from the *exida* Electrical and Mechanical Component Reliability Handbook the following failure rates resulted from the IntelliPoint FMEDA.

Table 3 Failure rates IntelliPoint (Loop)

Failure Category	Failure Rate (FIT)	
Fail Safe Undetected	28	
Fail Dangerous Detected	399	
Fail Detected (detected by internal diagnostics)	250	
Fail High (detected by logic solver)	77	
Fail Low (detected by logic solver)	72	
Fail Dangerous Undetected	103	
No Effect	312	
Annunciation Undetected	38	

Table 4 Failure rates IntelliPoint (Relay)

Failure Category	Failure Rate (FIT)
Fail Safe Detected	92
Fail Safe Undetected	189
Fail Dangerous Detected	175
Fail Dangerous Undetected	142
No Effect	252
Annunciation Detected	51
Annunciation Undetected	48

Table 5 Failure rates according to IEC 61508 in FIT

Device	λ_{SD}	λ_{SU}^3	λ_{DD}	λ_{DU}
IntelliPoint (Loop)	0	28	399	103
IntelliPoint (Relay)	92	189	226	142

Table 9 Proof Test Coverage – IntelliPoint

Device	λ_{DUPT} (FIT)	Proof Test Coverage
IntelliPoint (Loop), without process material	45	57%
IntelliPoint (Relay), without process material	38	73%
IntelliPoint (Loop), using process material	20	81%
IntelliPoint (Relay), using process material	18	87%

AMETEK, Inc.

TERMS AND CONDITIONS OF SALE

THE FOLLOWING TERMS/CONDITIONS, TOGETHER WITH ANY OTHER TERMS/CONDITIONS SPECIFICALLY AGREED TO IN WRITING BY SELLER, SHALL APPLY TO ALL ORDERS ("Order(s)") FROM, AND SALES OF PRODUCTS ("Products") OR SERVICES ("Services") TO BUYER. ANY ACCEPTANCE OF ANY ORDER OF BUYER IS CONDITIONED UPON THESE TERMS/CONDITIONS. ANY ADDITIONAL OR DIFFERENT TERMS/CONDITIONS PROPOSED BY BUYER IN ANY DOCUMENT ARE OBJECTED TO AND SHALL NOT BE BINDING UPON SELLER. No salesperson is authorized to bind Seller to any promise or understanding not expressed herein.

I. PRICES All prices are subject to change without notice in the event of any changes in cost of materials or labor, specifications, quantities, delivery schedules, customs duties, other factors beyond Seller's control, or in the event of delays caused by instructions of the Buyer, or failure of the Buyer to give Seller adequate information. Further, prices payable by the Buyer shall be subject to immediate increase, should the Seller as a result of governmental action or regulation including, without limitation, those contemplated by an investigation under Section 232 of the Trade Expansion Act of 1962 (19 U.S.C. §1862), incur additional duties, tariffs or restrictions on products sold hereunder, or on the raw materials that are used in making such products. In no event shall prices include any amounts imposed on the Buyer in connection with Buyer's purchases from Seller, such as taxes, including but not limited to Value Added Tax (VAT) or excise taxes, duties, tariffs, or any other costs assessed against the Buyer by a governmental authority.

II. DELIVERY Delivery dates are approximate and are dependent on prompt receipt by Seller of all necessary information. Seller may deliver all or any part of Products/ Services as early as 30 days in advance of agreed schedule. The point of delivery shall be "Ex-works" Seller's premises, unless otherwise specified by Seller. Upon delivery, title to Products and all risk of loss or damage thereto shall pass to Buyer. Where Buyer notifies Seller that it cannot take timely delivery of the Products, Seller may place such Products in storage, at the risk of Buyer, and Buyer shall reimburse Seller for all expenses incurred in connection with such storage. Buyer shall dispose of the packing materials for Products at its own expense, and shall defend, indemnify and hold harmless Seller from any legal obligations in connection with such packing waste.

III. PAYMENT A. The term of payment shall be net 30 days from date of Seller's invoice, unless otherwise specified. Payments shall be made by Buyer without any deduction or set-off. Unless otherwise agreed, payment shall be made in U.S. dollars. Seller may charge late payment fees at the rate of 1.5% per month, or the highest rate permitted by law, whichever is less, accruing daily.

B. If the financial condition of Buyer is unsatisfactory to Seller, Seller may require full or partial payment in advance, or satisfactory security, in the form of a letter of credit or otherwise. In the event of bankruptcy or insolvency of Buyer, Seller may immediately cancel any Order then outstanding.

C. Buyer grants Seller a purchase money security interest in Products located in the United States, or Services, as well as any proceeds, for the purpose of securing the obligations of Buyer hereunder. Buyer authorizes Seller to execute on Buyer's behalf and file such financing statements as Seller deems appropriate to perfect and notify Buyer's creditors of Seller's security interest.

IV. VARIATIONS IN QUANTITY; CHANGES. Buyer shall accept delivery of quantities greater or smaller than the quantity specified in Order(s), provided that any such variation shall not exceed 5% of the quantity originally specified, or 2 units, whichever is greater. Seller shall not be required to give notice of any such variations other than in the applicable shipping notice and invoice. Seller reserves the option to make changes to Products or Services which do not affect form, fit, or function, and shall deliver Products to the latest configuration part number at the time of delivery.

V. EXPORT CONTROLS; FCPA; ANTI-BOYCOTT

A. Buyer shall not make any disposition of the Products, by way of transshipment, re-export, diversion or otherwise, except as applicable U.S. export laws and regulations may expressly permit, and other than in and to the ultimate country of destination specified on Order(s) or declared as the country of ultimate destination on Seller's invoices or in the End Use Statement that Buyer supplies Seller. Seller shall not be named as shipper or exporter of record or U.S. principal party-in-interest

(USPPI) unless specifically agreed to in writing by Seller in which case, Buyer shall provide Seller with a copy of the documents filed by Buyer for Export clearance purposes. At Seller's request, Buyer shall supply end-use and end-user information to determine export license applicability. Failure of Buyer to comply with this section shall constitute a material default allowing Seller to cancel related Order(s) without liability.

B. Buyer warrants that it shall not violate or cause the Seller to violate the U.S. Foreign Corrupt Practices Act of 1977 (FCPA), as amended, the United Kingdom Bribery Act (UKBA) of 2010, as amended, or their respective implementing regulations in connection with Buyer's sale or distribution of the Products and/or Services, and that Buyer does not know or have reason to believe that any consultant, agent, representative or other person retained by Buyer in connection with the sale and/or distribution of Products/Services has violated, nor caused Seller to violate the FCPA and/or the UKBA. Where Buyer learns of or has reason to know of any violation of FCPA and/or UKBA in connection with the sale or distribution of Products/Services, Buyer shall immediately advise Seller.

C. Buyer further warrants that Buyer shall not violate or cause Seller to violate the U.S. Antiboycott Provisions of the U.S. Export Administration Regulations issued pursuant to the U.S. Export Administration Act of 1979, as amended, in connection with Buyer's purchase of Products/Services and that Buyer shall not request or require Seller to make statements or certifications against countries that are not subject to boycott by the U.S.

VI. WARRANTIES A. Seller warrants that Products manufactured by Seller, when delivered, shall be free from defects in material/workmanship. Seller warrants that Services shall be performed in accordance with generally accepted industry practice. Seller's obligations under this warranty shall be limited exclusively to repairing or replacing, at Seller's option, any part of Products which, if properly installed, used and maintained, proved to have been defective in material or workmanship within 1 year from the date of shipment, or re-performing the Services. Seller warrants for a period of 1 year from the date of shipment that software or firmware, when used with Products, shall perform in accordance with Seller's published specifications. Seller makes no warranty, express or implied, that the operations of the software or firmware shall be uninterrupted or error-free, or that functions contained therein shall meet or satisfy the Buyer's intended use/requirements. Buyer shall notify Seller of any defect in the quality or condition of Products (including software/firmware) or Services within 7 days of the date of delivery or performance, unless the defect was not apparent on reasonable inspection, in which case, within 7 days after discovery of the defect. If Buyer does not provide such timely notification, it shall not be entitled to reject Products (including software/firmware) or Services, and Seller shall have no liability for such defect.

B. Seller's warranty obligations shall not apply to Products which (1) have been altered or repaired by someone other than Seller, or (2) have been subjected to misuse, neglect, or improper use or application, or (3) are normally consumed in operation, or (4) have a normal life inherently shorter than the warranty period stated therein.

C. No Products may be returned unless authorized in advance by Seller, and then only upon such conditions to which Seller may agree. Buyer must obtain a Return Material Authorization (RMA) number from Seller prior to any return shipment, and such RMA number must appear on the shipping label and packing slip. Buyer shall be responsible for returned Products until such time as Seller receives the same at its facility, and for all charges for packing, inspection, shipping, transportation or insurance associated with returned Products.

D. This section VI sets forth the exclusive remedies and obligations for claims based upon defects in or nonconformity of Products/Services, whether the claim is in contract, warranty, tort (including negligence of any degree or strict liability) or otherwise. **THE FOREGOING WARRANTIES ARE IN LIEU OF ALL OTHER WARRANTIES,**

WHETHER ORAL, WRITTEN, EXPRESS, IMPLIED OR STATUTORY. NO IMPLIED OR STATUTORY WARRANTIES OF MERCHANTABILITY OR FITNESS FOR PARTICULAR PURPOSE SHALL APPLY.

VII. PATENTS/INDEMNITY If Buyer receives a claim that Products, or part thereof manufactured by Seller infringes a patent, Buyer shall notify Seller promptly in writing and give Seller information, assistance and exclusive authority to evaluate, defend and settle such claim. Where Buyer has furnished specifications/designs for the manufacture of the allegedly- infringing Products, Buyer shall defend, indemnify and hold harmless Seller against third-party claims for infringement arising out of Seller's use of such specifications/designs.

VIII. LIMITATION OF LIABILITY

The total liability of Seller on any claim, whether in contract, tort (including negligence of any degree and strict liability) or otherwise arising out of, connected with, or resulting from the manufacture, sale, delivery, resale, repair, replacement or use of any Products/Services, shall not exceed the price allocable to the Products/Services or part thereof which gives rise to the claim. **IN NO EVENT, WHETHER AS A RESULT OF BREACH OF CONTRACT, WARRANTY, TORT, (INCLUDING NEGLIGENCE OF ANY DEGREE, STRICT LIABILITY OR PATENT INFRINGEMENT) OR OTHERWISE, SHALL SELLER, ITS AFFILIATES, SUBCONTRACTORS, OR SUPPLIERS BE LIABLE FOR ANY LOSS OF PROFIT OR REVENUES, LOSS OF USE OF THE PRODUCTS OR SERVICES, OR ANY ASSOCIATED EQUIPMENT, COST OF CAPITAL, COST OF SUBSTITUTE GOODS, FACILITIES, SERVICES OR REPLACEMENT POWER, DOWNTIME COSTS OR CLAIMS OF BUYER'S CUSTOMERS FOR DAMAGES OR FOR ANY SPECIAL, PROXIMATE, CONSEQUENTIAL, INCIDENTAL, INDIRECT OR EXEMPLARY DAMAGES.** If Buyer transfers title to, or leases Products sold hereunder to, or otherwise permits or suffers use by, any third party, Buyer shall obtain from such third party a provision affording Seller and its subcontractors/suppliers the protection of the preceding sentence. Any action against Seller must be brought within 18 months after cause of action accrues.

IX. EXCUSABLE DELAYS A. Seller shall not be liable for delays in delivery or failure to perform due directly or indirectly to causes beyond Seller's reasonable control including but not limited to: acts of God; war; terrorism; civil commotion; riots; embargoes; government regulations, orders, instructions or priorities; port congestion; acts of or failure to act on the part of Buyer or its agents/employees; fires; floods; sabotage; nuclear incidents; earthquakes; storms; epidemics; strikes; lockouts or other labor difficulties; shortages of or inability to timely obtain proper labor, materials, components, shipping space or transportation, fuel, supplies or power at current prices; or due to limitations imposed by the extent of availability of Seller's normal manufacturing facilities.

B. If a delay excused per the above extends for more than 90 days and the parties have not agreed upon a revised basis for continuing providing Products/Services at the end of the delay, including adjustment of the price, then either party (except where delay is caused by Buyer, in which event only Seller) upon thirty (30) days' notice may terminate the Order with respect to the unexecuted portion of the Products/Services, whereupon Buyer shall promptly pay Seller its reasonable termination charges upon submission of Seller's invoices thereof.

X. SOFTWARE/TECHNICAL/PROPRIETARY INFORMATION

A. Buyer shall not acquire any rights to any software which may be delivered with Products, except as granted in Seller's standard software license. Any software license granted in connection with Products shall be an interim license, which may be withdrawn, pending payment for Products in full.

B. The purchase of Products shall not include any right to supply of technical information such as drawings or specifications.

C. Proprietary information, including drawings, documents, technical data, reports, software, designs, inventions and other technical information supplied by Seller in connection herewith (hereinafter called "Data"), shall remain Seller's sole property and shall be held in confidence by Buyer. Data shall not be reproduced, used or disclosed to others by Buyer without

Seller's prior written consent. Upon completion of Order, Buyer shall promptly return all Data to Seller together with all copies or reprints thereof then in Buyer's possession or control, and Buyer shall thereafter make no future use, either directly or indirectly, of any Data or any information derived therefrom without Seller's prior written consent. The foregoing shall in no way obligate Seller to provide or supply Data.

XI. DIES, TOOLS, PATTERNS Seller's charges for dies, molds, patterns and the like represent the Buyer's proportionate cost thereof, it being expressly understood that they remain the property of Seller. Modifications made to dies, molds, patterns and the like in order to manufacture Products shall be at the discretion of Seller.

XII. GENERAL A. The rights and obligations of the Buyer and Seller hereunder shall be governed in all respects by the law of the Commonwealth of Pennsylvania, U.S.A. The exclusive forum for adjudication of any disputes shall be the federal or state courts of the Commonwealth of Pennsylvania, and Buyer/Seller hereby consent to personal jurisdiction and venue in such courts in any proceeding. The United Nations Convention on the International Sale of Goods shall not apply.

B. These Terms and Conditions of Sale together with any other terms specifically agreed to in writing by Seller constitute the entire agreement between Buyer and Seller and supersede any prior or contemporaneous representations, agreements, proposals, warranties, or understandings, oral or written, express or implied. No waiver, modification, amendment, rescission or other change to these Terms and Conditions of Sale shall be binding unless specifically agreed to in writing by an authorized representative of Seller.

C. The invalidity, of any part hereof shall not affect the validity of the remainder. The failure of Seller to assert any right at any time hereunder shall not prevent Seller's subsequent assertion of the same or different rights.

D. Buyer may not assign this contract without the prior written approval of the Seller.

XIII. PROHIBITION FOR HAZARDOUS USE

Products sold hereunder are not intended for application in, and shall not be used by Buyer in construction or application of a nuclear installation or in connection with use or handling of nuclear material or for any hazardous activity or critical application, where failure of a single component could cause substantial harm to persons or property, unless Products have been specifically approved for such activity or application. Seller disclaims all liability for loss or damage resulting from such unauthorized use and Buyer shall defend, hold harmless and indemnify Seller against any such liability, whether arising under breach of contract, warranty, tort (regardless of the degree of fault or negligence), strict liability or otherwise.

Where Seller approves the application of the Products in a nuclear facility, the Buyer shall, before such use or provision, arrange for insurance or governmental indemnity protecting the Seller against liability and hereby releases and agrees to indemnify the Seller and its suppliers for any nuclear damage, including loss of use, in any manner arising out of a nuclear incident, whether alleged to be due, in whole or in part to the negligence or otherwise of the Seller or its suppliers.

XIV. STATUTORY REQUIREMENTS

Seller reserves the right to make any changes in the general specifications of the Products which are required for the Products to conform to any statutory requirement.

XV. GOVERNMENT CONTRACTS

Only Federal Acquisition Regulation ("FAR") supplement clauses expressly accepted in writing by Seller shall be included or incorporated by reference herein. Seller shall not be bound by and makes no representation of compliance with any FAR or FAR supplement clauses that Seller shall not have expressly accepted in writing.

AMETEK[®]
DREXELBROOK
An ISO 9001 Certified Company

SXRXTXX1-LM Issue 04
EDO# 05-19-110

205 Keith Valley Road, Horsham, PA 19044
Telephone: +1 215-674-1234
Fax: +1 215-674-2731
E-mail: drexelbrook.info@ametek.com
Website: www.drexelbrook.com