

How to Avoid Sewage Stench and Corrosion



You might think sewer stench should be expected, considering what's flowing through the pipes. But that's not the expectation of the public — nor should it be, since there are tools available to greatly mitigate offensive odours.

The sewer stench scientists tell us that the odours we smell from sewers does not come in with the wastes, but it is generated in the sewer itself. The same conditions that cause the odours also cause corrosion, so an understanding of those conditions, as well as techniques for abatement, is essential for proper collection system design, operation, and maintenance.

An overview of wastewater odour generation and sewer corrosion was presented by Jim Joyce, PE, of V&A Consulting Engineers during a recent webinar conducted by the Water Environment Federation (WEF). Joyce notes that while some of the odours in sewers come from wastes discharged into the sewer (e.g., fecal, grease, and industrial discharges) the strongest and most noticeable odours — and those responsible for the corrosion of sewers, resulting in degradation and/or collapse — arise from inorganic compounds produced in the sewer by the natural biology.


The Problem: Hydrogen Sulphide (H₂S)

H₂S is nasty stuff. The colourless gas is not only unpleasant, giving off that all-too-familiar “rotten egg” smell, it is also poisonous, flammable (even explosive in high concentrations), and ultimately corrosive to metal and concrete. But H₂S generation in sewers depends upon a fairly complicated biological, chemical, and physical process that is worthy of its own production pathway.

The process starts when natural microbiology that lives below the waterline in a sewer converts sulphate (which occurs naturally and harmlessly in almost all drinking water supplies), into ionic sulphate, which is then chemically changed into dissolved H₂S. The dissolved H₂S is then released from the water by turbulence and splashing to exist as H₂S gas, which causes the stench. Finally, H₂S gas is converted to sulphuric acid by a second type of bacteria (Thiobacillus) that live above the water line; the sulphuric acid drips back down into the wastewater where it is neutralized back into sulphate, and the process begins all over again. This is what Joyce terms the “Sewer Sulphide Cycle,” which can be used to identify ways to solve many of the problems it causes.

Breaking The Cycle

Naturally occurring sulphate-reducing bacteria live in a “slime layer” that covers all surfaces below the waterline in a sewer, including the bottom half of the pipes themselves, as well as any settled debris or other materials. Rocks, sand, and other debris that finds its way into the sewer settles to the bottom and greatly increases the surface area of the slime layer per foot of length. As a result, sulphate conversion and dissolved sulphide production is also greatly increased. However, there are ways to interrupt the “sulphide cycle,” reduce dissolved sulphide concentration, avoid H₂S gas release, and prevent corrosion as discussed below.

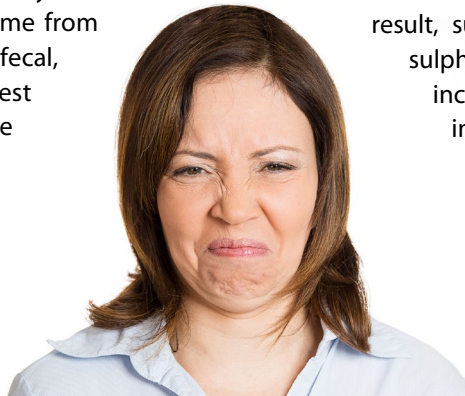

Registered Address

ABLE Instruments & Controls Ltd
Cutbush Park, Danehill, Lower Earley,
Reading, Berkshire, RG6 4UT. UK.

Reading

Tel: +44 (0)118 9311188 | Email: info@able.co.uk

Aberdeen

Tel: +44 (0)1224 725999 | Email: ab@able.co.uk

Web

able.co.uk

E-commerce

247able.com



- Reduce slime layers by removing debris
- Control dissolved sulphide through chemical addition
- Reduce H₂S gas release through turbulence reduction
- Protect sensitive surfaces from the effect of acid generation

The first solution is pretty easy to figure out: Clean sewers of settled debris to reduce the area of slime layer and minimize dissolved sulphide generation. Next, consider chemical addition to control the dissolved sulphide that is generated. Iron chemicals, nitrate, hydrogen peroxide, and caustic in the form of sodium hydroxide and magnesium hydroxide are all common choices that can effectively control dissolved sulphide concentrations, according to Joyce. He notes that the advantages of chemical-addition facilities are quick installation and low capital cost, but also cautions that chemicals can have high long-term costs, are most often hazardous to handle and dangerous to transport, and can be maintenance-intensive.

Iron, nitrate, and peroxide react stoichiometrically with dissolved sulphide, meaning that higher levels of dissolved sulphide require higher doses of chemical to prevent the release of H₂S gas. Magnesium hydroxide is not stoichiometric; it can be effective at a single addition rate regardless of the dissolved sulphide concentration, but it can have a higher cost than the other chemical alternatives at lower sulphide concentrations.

Ironically, improvements in environmental regulations have caused an increase in the wastewater-related odour and corrosion issues commonly experienced today. The Clean Water Act (Title III) reduced the amount of heavy metals in collection systems by requiring industrial pretreatment. Those metals, including chromium, copper, mercury, cadmium, nickel, and many others, were passing through treatment plants, bio-accumulating in receiving waters and causing damage to flora and fauna. It was discovered that these dangerous metals had been inhibiting the growth of sulphate-reducing bacteria in the slime layer, making them produce less dissolved sulphide. Once these heavy metals were removed, the slime layer became very active, resulting in a general increase in dissolved sulphide in the sewers in the U.S. Furthermore, decreased infiltration

and inflow (I&I) and the separation of combined sewers, as well as water conservation practices, have increased biochemical oxygen demand (BOD), which is the main food source for the slime layer. The combination of these factors has increased dissolved sulphide production in sewers and caused utilities to spend much more on sulphide controls, chemicals, odour scrubbers, and repair of corrosion damage.

Worst-Case Scenario

With high dissolved sulphide comes excessive odour and corrosion problems, and we have seen the conditions under which sulphide generation thrives. The conditions that lead to excessively high sulphide production are listed below, and although some are more controllable than others, Joyce warns that having two or more of these conditions present in your sewer system could lead to significant problems and costly solutions.

- Warm annual sewage temperatures (Average > 70 degrees F)
- Long force mains and/or flat sewers with debris
- High BOD wastewater (> 250 mg/L)
- High sulphate wastewater concentrations (> 40 mg/L)

Protect Your Pipes

So it happens that you are prone to the effects of the Sewer Sulphide Cycle and thus vulnerable to corrosion. What are some methods you can use to protect your pipes? Joyce offers the following tips:

Minimize turbulent stripping of hydrogen sulphide gas – The splashing and turbulence from falling water and outfalls in the collection system causes H₂S gas to be stripped out of the water and into the air, where it can cause odours and be further oxidized to sulfuric acid. Reducing turbulence at drop manholes, Parshall flumes, and other hydraulic outfalls will reduce the H₂S gas concentration, resulting in less odour and corrosion.

Use inert pipe materials – Fiberglass reinforced plastic (FRP), PVC, HDPE, and clay are examples of pipe materials that are inert (chemically inactive) when exposed to sulphuric acid.

Registered Address

ABLE Instruments & Controls Ltd
Cutbush Park, Danehill, Lower Earley,
Reading, Berkshire, RG6 4UT. UK.

Reading

Tel: +44 (0)118 9311188 | Email: info@able.co.uk

Aberdeen

Tel: +44 (0)1224 725999 | Email: ab@able.co.uk

Web

able.co.uk

E-commerce

247able.com



Use only 316L stainless steel or plastics for attachments – According to Joyce, 316 stainless steel and 316L (the low-carbon version of 316 stainless steel) are the only metals shown to stand up to the effects of sulfuric acid in sewers. No other metals should be used unprotected in a sewer environment.

Use liners to protect concrete surfaces – Joyce recommends plastic liners to protect concrete surfaces, as opposed to applied coatings, due to the former's longer demonstrated lifespan. Options include:

1. Mechanically attached plastic liners, which require punctures, bolts, and welding for application. They are acceptable for structures in low-hydraulic-energy situations, but not good for pipelines.
2. "T-lock" cast-in-place liners, where the flexible PVC is "locked" via anchoring T's into the interior of concrete sewer pipes during manufacture or rehabilitation. The process and product is "very secure," notes Joyce, with a long track record (over 50 years) of successful service in sewers.
3. Applied liners, in which PVC sheets are essentially "glued" to the concrete surface with either a sprayed urethane bonding agent or an epoxy mastic. "It's basically wallpaper for sewers," describes Joyce, adding that applied liners are widely deployed and "can be very successful when used appropriately."

Use coatings only where easily visible to catch repairs – Joyce notes that "coatings have a role... in applications where they can be viewed easily to catch repairs when damage is done, when pinholes start to erupt, and when coatings start to fail." Such applications would include manholes, junction boxes, and channels at treatment plants where re-coating can be accomplished fairly easily.

Lingering Problem

While Joyce remains optimistic that the wastewater industry can effectively deal with its current sulphide odour and corrosion problems, he estimates that a staggering 90 percent of all the H₂S gas released in a collection system never makes it out. It is instead converted to sulphuric acid, which in turn causes potentially catastrophic corrosion. Despite the natural and circumstantial obstacles conspiring against sewer system managers, it is a problem in need of a fix. That smell is more than just a nuisance — it's a warning.

Registered Address

ABLE Instruments & Controls Ltd
Cutbush Park, Danehill, Lower Earley,
Reading, Berkshire, RG6 4UT. UK.

Reading

Tel: +44 (0)118 9311188 | Email: info@able.co.uk

Aberdeen

Tel: +44 (0)1224 725999 | Email: ab@able.co.uk

Web

able.co.uk

E-commerce

247able.com

